

# KARUK TRIBE HOUSING AUTHORITY

P.O. Box 1159 • 635 Jacobs Way  
Happy Camp, CA 96039  
Ph: (530) 493-1414 • Fax: (530) 493-1415



1836 Apsuun Street  
Yreka, CA 96097  
Ph: (530) 842-1644 • Fax: (530) 842-1646

## NOTICE TO BIDDERS

<b>Date:</b>	May 5, 2023
<b>General Description:</b>	
All necessary materials, labor, and equipment required for all concrete and masonry work as required in provided plans and documents, for seven (7) homes, on Second Avenue, Happy Camp, California.	
<b>Contact Information:</b>	
Karuk Tribe Housing Authority 635 Jacobs Way, PO Box 1159, Happy Camp, CA 96039 Adia Supahan, (530) 493-1414, Extension 3110, <a href="mailto:asupahan@karuk.us">asupahan@karuk.us</a>	
<b>Project Manager:</b>	Doug Goodwin (530) 598-3911 <a href="mailto:dgoodwin2@karuk.us">dgoodwin2@karuk.us</a>
<b>Project Name:</b>	Second Avenue Foundations
<b>MANDATORY Site Visit:</b>	<b>Pre-Bid Site Visit NOT REQUIRED</b>
<b>Bid Submission Criteria:</b>	Hand Submission: 635 Jacobs Way, Happy Camp, CA Mail Delivery: PO Box 1159, Happy Camp, CA 96039 Email: <a href="mailto:asupahan@karuk.us">asupahan@karuk.us</a> NO FAXES
<b>Bids Due:</b>	<b>Friday, May 19, 2023 by 5pm</b>

# KARUK TRIBE HOUSING AUTHORITY

P.O. Box 1159 • 635 Jacobs Way  
Happy Camp, CA 96039  
Ph: (530) 493-1414 • Fax: (530) 493-1415



1836 Apsuun Street  
Yreka, CA 96097  
Ph: (530) 842-1644 • Fax: (530) 842-1646

## KARUK TRIBE HOUSING AUTHORITY REQUEST FOR LUMP SUM FIXED QUOTATION

### SOLICITATION FOR LUMP SUM FIXED-PRICE QUOTATIONS BASED ON PRICE ONLY (Small Purchases of \$250,000 or less)

**Due Date:** Friday, May 19, 2023 by 5pm

**Mandatory Site Visit:** Not Required

**More Information:** Doug Goodwin, (530) 598-3911 [dgoodwin2@karuk.us](mailto:dgoodwin2@karuk.us)

1. The Karuk Tribe Housing Authority (KTHA) requests lump sum fixed-price quotations for all necessary materials, labor, equipment, execution and fees required for all concrete and masonry work as required in provided plans and documents, for seven (7) homes, on Second Avenue, Happy Camp, California as described further in the Scope of Work.
2. KTHA is requesting these quotations under the small purchase procedures. This is a less formal, simplified process which will help us to expedite our selection. Because KTHA is following this process, we will not be able to accept quotations that are more than \$250,000.
3. Quotations are invited from non-Indian as well as Indian-owned economic enterprises or organizations.
4. Quotations may be submitted by email, mail, or hand delivery. All quotations must be submitted to KTHA in writing and can be emailed to [asupahan@karuk.us](mailto:asupahan@karuk.us), mailed or hand delivered to PO Box 1159, 635 Jacobs Way, Happy Camp, CA 96039 by **Friday, May 19, 2023 by 5pm**. NO FAXES will be accepted.
5. The Scope of Work is as set forth on Appendix A attached to this Solicitation. Anyone submitting a quotation for this work may visit the job site(s) to ascertain the nature and location of work and to satisfy itself as to the general and local conditions which can affect the work.
6. **Indian Preference.** Any firm seeking Indian preference in this award must provide evidence that it is not less than 51% Indian owned and controlled. If claiming this preference, please contact us immediately so that we can fax you a pre-qualification statement that you must fill out and return within two days of your receipt. KTHA will then review the statement and determine eligibility for preference. All bids must be accompanied by a TERO Compliance Plan as included in Appendix D.
7. **Award.** The contract will only be awarded to a responsive, responsible individual or firm. The contract will be awarded to a qualified Indian enterprise submitting the lowest responsive quotation if such quotation is within budgeting limits established for this solicitation and is within the limits identified in the KTHA Procurement Policy regarding Indian preference in contracting. If no responsive quotation by a qualified Indian enterprise is within the above-stated limits, then award will be made to the individual or firm with the lowest responsive quotation.
8. All quotations must contain a commitment to provide Indian preference in 1) subcontracting, 2) training, and 3) employment, and must contain a statement describing the methods that will be used to provide such preferences. This statement is part of the submitted quotation. This statement will be evaluated as part of the submitted quotation, and any quotation failing to contain such preference statement or failing to adequately address such preference requirements shall be deemed non-responsive. If you believe it is infeasible to provide Indian preference in subcontracting, training, or employment, you must include in your quotation a certification as to the reasons why.

9. The form of Contract which contains the terms and provisions of the contract agreement between KTHA and the individual or firm selected for this work is available for review upon request. By submitting a quotation, you hereby agree that if selected, you shall deliver to the Authority, within the time later designated by the Authority, a properly executed Contract and to be bound by all terms and conditions set forth therein, including but not limited to assurance of performance, completion dates, prevailing wage rates, warranties, other federal requirements, and other terms and provisions as set forth therein.
10. All quotations must commit to remaining open for at least 45 days.
11. The selected contractor will be responsible for paying all Tribal license fees and taxes, as well as permits that may be required, if any.
12. The successful individual or firm on this solicitation must comply with the Tribe's TERO Ordinance, including any licensing requirements. This includes, but is not limited to, paying a 2% TERO fee on the work to be performed. Tribal minimum wage rates shall apply. For a copy of the TERO Ordinance and more information, the Karuk Tribe TERO Director, should be contacted at (530) 493-1600 ext. 2030.
13. This solicitation does not commit KTHA to award a contract or to pay any costs incurred in the preparation of quotation or the procurements of supplies. KTHA reserves the right to reject any and all quotations or to re-solicit when it is deemed by KTHA to be in its best interest to do so.
14. If there are any questions, please contact **Doug Goodwin, Project Manager (530) 598-3911, [dgoodwin2@karuk.us](mailto:dgoodwin2@karuk.us)** KTHA will let you know the decision of the award.

**APPENDIX A**  
**To Request for Lump Sum Fixed-Price Quotation**

**SCOPE OF WORK**

1. Successful bid shall include all necessary materials, labor, equipment, execution and fees required for all concrete and masonry work as required in provided plans and documents, for seven (7) homes, on Second Avenue, Happy Camp, California.
2. Work shall be in accordance with applicable sections of Chapter 19 of the Uniform Building Code and all local building codes per plans.
3. All concrete shall be a 5 sack mix and have a minimum compressing strength of 2500 psi at 28 days.
4. Reinforcing steel, as required, shall be properly anchored and tied in place before pouring concrete. Lap all splices a minimum of 32 bar diameters. Reinforcing steel shall conform to ASTM designation A-615, Grade 40.
5. Bid shall include all trenching necessary, including backfill.
6. Bidders shall acknowledge that the seven (7) homes will be erected at separate times, shall be flexible to scheduling, and shall account for such in their bids (ex; multiple trips required). Successful bidder will be given two weeks notification that work is ready to begin.
7. Questions may be directed to Doug Goodwin, Project Manager at (530) 598-3911.
8. No pre-bid site visit is required.
9. Bidder shall have appropriate license, certification, and insurance for the work to be performed.
10. Proposals must be received no later than 5pm on Friday, May 19, 2023 at the Happy Camp KTHA Office located at 635 Jacobs Way, Happy Camp, CA 96039. Proposals may be submitted electronically to [asupahan@karuk.us](mailto:asupahan@karuk.us) Faxes will NOT be accepted.
11. All bids must include a TERO fee of 2%, and Tribal wage rates (as attached) and Indian preference will apply.

**APPENDIX A**  
**To Request for Lump Sum Fixed-Price Quotation**

**TRIBAL WAGE RATES**

<b>KARUK TRIBAL WAGE RATES</b>	
<b>Updated April 2011</b>	
<b>Position:</b>	<b>Rate:</b>
CARPENTER	17.00
CEMENT MASON	16.00
ELECTRICIAN	18.00
LABORER	12.00
PAINTER	13.00
PLUMBER	18.00
ROOFER	14.00
SHEET METAL WORKER	18.00
BRIDGE BUILDER	17.00
PILE DRIVER	23.00
MILLWRIGHT	18.00
LINE CONSTRUCTION	22.00
COMMUNICATION SYS	18.00
HEAVY EQUIP OPERAT	16.00
IRON WORKERS	17.00
PLASTERER	16.00
BRICK TENDER	16.00
LANDSCAPE/GARDEN	12.00
DRYWALL FINISHER	16.00
GLAZIER	14.00
SOFT FLOOR LAYER	15.00
TRUCK DRIVER	13.00
TILE SETTER	15.00
BRICK LAYER	17.00

**APPENDIX C**  
**To Request for Lump Sum Fixed-Price Quotation**

**LUMP SUM FIXED PRICE QUOTATION**

<b>ITEM</b>	<b>PRICE</b>
<b>CULTURAL MONITOR:</b>	<b>\$ 4,000</b>
<b>SUBTOTAL:</b>	<b>\$</b>
<b>TERO FEE (2% OF SUBTOTAL):</b>	<b>\$</b>
<b>TOTAL QUOTATION AMOUNT:</b>	<b>\$</b>

Respectfully Submitted by,

Signature: \_\_\_\_\_

Name/Title: \_\_\_\_\_

Firm: \_\_\_\_\_

Address: \_\_\_\_\_

License Number: \_\_\_\_\_

Phone Number: \_\_\_\_\_

**APPENDIX D**  
**To Request for Lump Sum Fixed-Price Quotation**

**TRIBAL EMPLOYMENT RIGHTS OFFICE  
COMPLIANCE PLAN FOR BIDDERS**

Bidder/Employer Name: \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City, State and Zip Code: \_\_\_\_\_

Contact Person: \_\_\_\_\_ Phone Number: \_\_\_\_\_

E-mail: \_\_\_\_\_

Bid Amount: \$\_\_\_\_\_ TERO Fee (2%): \$\_\_\_\_\_

**THIS IS AN AGREEMENT BETWEEN THE KARUK TRIBE'S TRIBAL EMPLOYMENT RIGHTS OFFICE (TERO) AND \_\_\_\_\_, HEREINAFTER KNOWN AS "EMPLOYER" CONDUCTING COMMERCE AND EMPLOYMENT ACTIVITY WITHIN THE ANCESTRAL TERRITORY OF THE KARUK TRIBE.**

- Employer shall provide the completed compliance plan with the submission of bid.
- Upon notification of the award, Employer shall contact the TERO Office within ten (10) days prior to any work to be performed.
- Employer shall contact the TERO Office and Contract/Project Manager immediately, in writing, advising of any contract or sub-contractor changes to obtain approval prior to working on the job site.
- Employer understands and agrees to comply with the requirements and procedures in the selection of contractors, sub-contractors, employees and recruitment of viable Indian applicants in accordance with the Karuk Tribe's Employment Rights Ordinance and the Karuk Tribe's Workforce Protection Act (WPA).

By signing below the Employer certifies the position information is true and correct and there have been no omissions in the completion of the labor force projections. Falsification of the information provided will result in sanctions, penalties, fines and/or debarment with the Karuk Tribe.

---

Employer Signature

Date

### **PRE-AWARD LABOR FORCE PROJECTION**

**Core Crew:** Is defined as a member of a business, Contractor or Subcontractor's crew who is a regular employee and is in a supervisory or other key position such that the employer would face a serious financial loss if that position were filled by a person who had not previously worked for that employer.

**All other positions** will be filled by the TERO office unless sufficient justification can be made that they are not replaceable for the work that is to be done or unless TERO does not have an individual to refer.

List Core Crew (Full Name):	Job Title/ Years w/Company/Justification:

### **List Native American Contractors/Sub-contractors to be hired for this Project:**

Contractor/Sub-contractor Contact Person, Phone # and E-mail:	Work to be Performed:



**List Non-Native Contractor/Sub-contractors to be hired for this Project:**

Contractor/Sub-contractor Contact Person, Phone # and E-mail:	Work to be Performed:

**Open Positions:** Employer agrees to hire 100% of all its open positions/Sub-contractors for this project through the TERO Skills Bank. If Employer is unable to hire 100% then company representatives will need to meet with the TERO Director. Failure to comply with this hiring requirement will result in sanctions and/or penalties.

Job Title/Sub-contractor Needed:	Skills Required:

Number of positions to be filled for this project: \_\_\_\_\_

Contact person/info for job referrals: \_\_\_\_\_

Date TERO referrals needed: \_\_\_\_\_ Job start date: \_\_\_\_\_

**For Internal Use Only:**

Contract Number #: \_\_\_\_\_ Project Manager: \_\_\_\_\_

TERO Office Approval \_\_\_\_\_ Date: \_\_\_\_\_

**Comments:**

	COLUMN LINE
	LETTERS IN ONE DIRECTION
	NUMBERS IN THE OTHER DIRECTION
101A	DOOR SYMBOL DOOR NUMBER
	WINDOW TYPE
	SKIP LETTERS "I" AND "O"
	LOUVER TYPE
	EQUIPMENT TYPE
	TYPE OF EQUIPMENT, X=X-RAY; F=FOOD SERVICE
	EQUIPMENT GROUP
	REVISION
	CLOUD AROUND REVISION
	MATCH LINE SHADED PORTION IS THE SIDE CONSIDERED
	WORK POINT, CONTROL POINT OR DATUM POINT
	SECTION SECTION IDENTIFICATION SHEET WHERE SECTION IS DRAWN
	DETAIL DETAIL IDENTIFICATION SHEET WHERE DETAIL IS DRAWN
	INTERIOR ELEVATION(S) ELEVATION NO. ELEVATION IDENTIFICATION (NO ARROWS MEANS ELEVATION NOT SHOWN) SHEET WHERE ELEVATION IS DRAWN
OFFICE	ROOM IDENTIFICATION
101	ROOM NAME ROOM NO.
	NEW FINISH GRADE DRAWN @ 45°
	EXISTING GRADE SHOWN HORIZONTALLY
	PROPERTY LINE
	NEW OR FINISHED CONTOURS
	EXISTING CONTOURS
	TOP OF WALL
	TOP OF CURB
	TOP OF PAVEMENT
	ACOUSTIC TILE OR BOARD
	BITUMINOUS CONCRETE SHOW PROFILE ONLY
	BRICK
	CERAMIC TILE SHOW PROFILE ONLY
	CONCRETE CAST IN PLACE OR PRECAST
	CONCRETE BLOCK
	EARTH
	GLASS
	OMIT INDICATION IN THIN MATERIAL
	GYPSUM BOARD OMIT DOUBLE LINES AT SMALL SCALE
	INSULATION, BATT
	INSULATION, RIGID
	METAL
	OMIT INDICATION IN THIN MATERIAL
	METAL LATH
	MORTAR
	PLASTER
	PLYWOOD
	ROCK FILL
	SAND
	STONE
	INCLUDES MARBLE
	TERRAZZO SHOW PROFILE ONLY
	WOOD, FINISH
	WOOD, FRAMING THROUGH MEMBER
	WOOD, FRAMING INTERRUPTED MEMBER
	REMOVE OR DEMOLISH

# TYPICAL SYMBOLS

A large, empty rectangular frame with a thin black border, occupying the right half of the page. It appears to be a placeholder for a technical drawing or image related to the structural criteria listed on the left.

[illegible]

GENERAL

1. DO NOT SCALE DRAWINGS
2. The drawings and specifications, and copies thereof are legal instruments of services for use by the owner and authorized representatives on the designated property only.
3. All work shall be executed in accordance with the 2010 edition of the California Building Code and/or all other governing agencies requirements.
4. Contractor shall comply with the regulations of "Occupational Safety and Health Act."
5. All dimensions and conditions shall be checked and verified on the job site by the contractor before work begins. Any errors, omissions, or discrepancies shall be brought to the attention of the architect and owner before construction begins.
6. In the event there are found discrepancies or ambiguities in or omissions from the specifications or the drawings, or should there be doubt as to their meaning or intent, the Architect shall be notified, and shall provide a written clarification prior to the commencement of construction or the purchasing of the materials. Failure on the part of the Contractor to follow this procedure shall relieve both the Architect and the owner of damages, costs, and time delays created by these conditions.
7. Contractor shall examine the condition of the project area and verify the sizes and locations of existing facilities at the site, report any discrepancies between the drawings and existing conditions to the owner and the architect, and shall not commence until the conditions are further clarified or authorization to proceed is given.
8. Dimensions shown on the drawings are to centerline of column or face of stud, unless otherwise noted.
9. Work shall conform to all local, state, and federal codes and ordinances in effect and all safety provisions shall be strictly adhered to.
10. There will be no substitutions without the Owner's written prior approval.
11. The Architect makes no guarantee for products identified by trade name or manufacturer, nor their availability; however, the Contractor shall be responsible for meeting the performance requirement of the specification.
12. Contractor shall be responsible for and obtain all permits and licenses and pay required fees. Certificates of insurance for Workers Compensation shall be filed prior to issuing of permit.
13. Each Contractor shall guarantee, be responsible for and make good any and all defects due to faults of his/her trade for labor, leaks or materials, for a period of one year minimum following the acceptance of the work by the Owner
14. All damages to, both on and off property (alleys, sidewalks, curbs, streets, etc.) occurring as a result of construction shall be replaced or repaired by the Contractor at no cost to the Owner.
15. No materials or refuse shall be kept outside work area. Provide area for combustible rubbish storage.
16. Typical details shall apply where no specific details or sections are given.
17. The Contractor shall be responsible for continuous clean-up of the site and of all debris.
18. Abbreviations throughout the plans are those in common usage. Architect will define intent of any in question.
19. Provide and maintain Fire Extinguishers as required by the Local fire department field inspector during construction.
20. This project shall comply with title 24 and 2013 UBC, UMC and UPC and 2010 HEC.

SITE WORK

1. All site work shall comply with any applicable approved drawings or local codes as required.
2. Soils Report not required.
3. All excess materials shall be disposed of at the Contractor's expense.
4. All concrete curbs and sidewalks shall be installed per the California Department of Transportation Standard Specifications-July 2010, Section 73

EARTHWORK

1. All grading and earthwork shall be executed in accordance with those ordinances of the governing agencies
2. Carry all footings into solid natural or compacted soil a minimum of 12" regardless of elevations shown on the drawings.
3. All fill material shall be compacted to a minimum 95% relative compaction per Cal 216.

CONCRETE

1. The labor, materials and execution required for all concrete work as indicated on the drawings shall be in accordance with those applicable sections of chapter 19 of the latest adopted editions of the uniform building code.
2. All concrete shall be a 5 sack mix and have a minimum compressive strength of 2500 psi at 28 days.
3. Reinforcing steel as required shall be properly anchored and tied in place before pouring concrete. Lap all splices a minimum of 32 bar diameters. Reinforcing steel shall be deformed bars conforming to ASTM designation A-615, Grade 40.

MASONRY

1. The labor, materials and execution required for all masonry work as indicated on the drawings shall be in accordance with those applicable sections of chapter 21 of the latest adopted editions of the uniform building code.

METALS

1. Use approved metal connectors, joist and rafter hangers, post base and cap connectors as required on plans, by code and Building Inspector.
2. All fasteners and hardware in contact with pressure treated lumber shall be hot-dipped galvanized or stainless steel

STEEL

1. The labor, materials and execution required for all structural steel work as indicated on the drawings shall be in accordance with those applicable sections of Chapter 22 of the latest adopted edition of the Uniform Building Code.
2. Structural steel shall conform to the latest specifications of the A.S.T.M. and have a min. yield of 36,000 PSI
3. Bolted or welded connections shall conform to A.I.S.C. specifications unless noted otherwise on the drawings.
4. Structural steel not encased in concrete shall be shop painted with one coat of zinc chromate

WOOD

1. All lumber shall be grade marked #2 DF minimum except as noted on plans.
2. All posts to be #1 DF.
3. All horizontal lumber shall be #1 DF or better.
4. All studs shall be DF standard.
5. Plywood shall be DF conforming to PSI-74 U. S. Dept of Commerce, and shall be grade stamped "D.F.P.A."
6. Wood bearing directly on concrete shall be pressure treated Doug. Fir or Redwood

CARPENTRY

1. All framing and carpentry shall be done in accordance with those applicable sections of Chapter 23 of the latest adopted edition of the Uniform Building Code and details indicated on the drawings.
2. Nailing as per C.B.C. Table 25-Q
3. Structural Members shall not be cut for pipe, conduit or etc.
4. 2 inch solid blocking shall be placed between joists or rafters at all supports
5. Use approved metal connectors, joist and rafter hangers, post base and cap connectors as required on plans, by code and Building Inspector.

MILLWORK

1. All Millwork shall be manufactured in accordance with the standards in the latest edition of Chapter 23 of the Manual of Millwork of the Wood Working Institute in the Custom Grade hereinafter specified or as shown on the drawings
2. Submit Shop Drawings in conformance to Section 1 "Guidelines for Architectural Millwork Shop Drawings".
3. Millwork and installation shall be in accordance with Custom Grade of the Manual of Millwork latest edition
4. Deliver all materials only when project is ready for installation and the General Contractor has provided a clean storage area as defined in the Manual of Millwork

SHEET METAL

1. All sheet metal work shall be in accordance with the latest addition of the "Architectural Sheet Metal Manual" of the Sheet Metal and Air Conditioning Contractors National Association, Inc. SMACNA
2. Flashings, gutters and other galvanized iron (G.I.) shall be 26 gage minimum unless noted otherwise, galvanized hot dip process.

THERMAL & MOISTURE PROTECTION

1. Where penetrations are made through the roof, provide watertight assembly

ROOFING

1. Asphalt composition shingles to be installed per mfrg. recommendations. Manufactured by Malarkey Lifetime Warranty Comp. Arch. Shingle, or equal, Color selected by Owner Or Metal Roof FABRAL SSR 1-1/2" or equal, Color selected by Owner
2. All roofing and flashing materials shall be installed in strict conformance with the manufacturer's specification and in accordance with Chapter 15 of the latest adopted edition of the Uniform Building Code.
3. All roof and flashing materials shall be installed to form a waterproof system and the roofing contractor shall issue a written guarantee to the Owner to maintain the roofing and all flashings in a watertight condition for a period of two (2) years after acceptance of the project.

INSULATION

1. Wall insulation R-13 and R-19
2. Ceiling insulation R-30
3. All insulation shall comply with standards established by the State of California "Energy Design Manual" and Energy Regulations of California Administrative Code, Title 25

WEATHER STRIPPING

1. Comply with title 24 requirements for weather stripping at all openings

DOORS & WINDOWS

1. See Sheet A-7
2. Vinyl Low E Double paned Windows and Sliding Glass Doors manufacturer selected by KTHA
3. Exterior Doors 6 Panel Metal Doors with standard Kwikset locks and deadbolts
4. Interior Doors 6 Panel HC with Kwikset hardware

GLAZING

1. All labor, materials and execution required for the glass and glazing work as indicated on the drawings shall be in accordance with those applicable sections of Chapter 24 of the latest adopted edition of the Uniform Building Code.
2. Glass doors, adjacent panels, glazing within 24" of a door, and all glazed openings within 1'-6" of the adjacent floor shall be of tempered glass as approved for impact hazard.
3. All windows shall be certified and labled to meet A.N.S.I. infiltration standards

FINISHES

1. Contractor shall supervise all finish work.
2. Contractor shall provide galvanic insulation between dissimilar metals.
3. All materials and finishes indicated on drawings shall be new, unused, and of serviceable condition except as specifically noted.
4. Wall and Ceiling materials shall not exceed the flame spread classifications in UBC table 8-B

EXTERIOR SIDING

1. Siding: LP Siding with 8" grooves
2. Trim: primed spruce 3/4"x4" around windows and doors
3. Soffit: NA

GYPSUM WALLBOARD

1. The Gypsum Wallboard work shall be done in accordance with the recommendations of ASTM C754,GA 151, GA 201, GA 216 and shall conform with Chapter 25 of the latest adopted edition of the California Building Code
2. Interior walls to be finished with orange peel texture through out

CERAMIC TILE

1. Ceramic tile work shall be in accordance with the best recommended standards of the "Tile Council of America"

PAINTING

1. All painting work, which includes back priming, sealing, staining, lacquering or other work reasonable incidental to the painting of all exterior and interior woodwork, plywood, gypboard, sheet metal, ironwork, etc, shall be in accordance with the recommended standards as set forth in the "Painting Specifications" of the Painting and Decorating Contractors Association of America.
2. Colors of all areas being patched and repaired shall match existing and all new work shall be as directed and per schedule provided by Contractor
3. Paint shall be 100% acrylic, applied per manufacturers recommendations and per schedule provided by Contractor and Owner
4. Interior Walls- prime and paint with two coats semi-gloss latex enamel  
Exterior Walls-one coat primer and two coats eggshell finish  
Exterior Trim-one coat primer and two coats semi-gloss finish

CARPET

1. Manufactured by NA
2. Color as selected by Owner from manufacturers standards.
3. Install in accordance with manufacturers recommendations.

VINYL

1. Manufactured by Armstrong, Product: NA
2. Color as selected by Owner from manufacturers standards.
3. Install in accordance with manufacturers recommendations.

MECHANICAL

1. See Mechanical Notes sheet M-1

PLUMBING

1. See Plumbing Drawings Sheet P-1, P-2

ELECTRICAL

1. See Electral Drawing Sheet E-1

ENERGY CONSERVATION

1. All work shall conform to the energy conservation requirements set forth in the California Administrative Code, Title 24.
2. See sheet CF1 and CF2 Energy Statement

SECURITY PROVISIONS

1. All Pin-type hinges which are accessible from outside a secured area when the door is closed shall have non-removable hinge pins. In addition, they shall have minimum 1/4" diameter steel jamb stud with 1/4" minimum protection unless the hinges are shaped to prevent removal of the door if the hinge pins are removed.

FIRE PROTECTION

1. All smoke detectors to be hard wired with battery backup.
2. Penetrations of fire resistive walls, floor - ceiling and roof shall be protected as required in UBC Sections 709 and 710.
3. Provide noncombustible blocking behind all fixtures, handles, grab bars, etc., where indicated or required.

EXITS

1. All exits are to be openable from the inside without the use of a key or special knowledge

JMB  
ARCHITECTURE  
ARCHITECTURE  
PLANNING

4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: jmbarchitect@snowcrest.net




67 Walnut Way PO BOX 1567  
WILLOW CREEK, CA 95573  
707.629.3000 fax 707.629.3011  
email: tvce@tvce.biz

Electrical Consultant	Pace Engineering
Address	1730 South Street Redding, CA 96001
Phone	530 244-0202
Fax	530 244
e-mail	
Bldg. Energy Consultant	Abbey Technical Services
Address	Anny McQuerny 1125 16th Street, Ste. 216 Arcata, CA 95521
Phone	707.826.1433
Fax	707-826-1430
e-mail	anny@abbeytechnicalservices.com

KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House

No.	Description	Date
GENERAL NOTES		
Project number	ktha 2015	
Date	07/05/2015	
Drawn by	RKH	
Checked by	JMB	
G2		
Scale		

4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: [jmbarchitect@snowcrest.net](mailto:jmbarchitect@snowcrest.net)

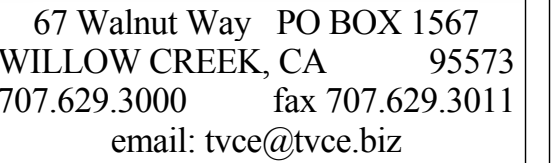

Address 1730 South Street  
Redding, CA  
96001  
Phone 530 244-0202  
Fax 530 244  
e-mail



Bldg. Energy Consultant Address	Abbey Technical Services Anny McQuenny 1125 16th Street, Ste. 216 Arcata, CA 95521
Phone	707.826.1433
Fax	707-826-1430
e-mail	anny@ abbaytechnicalservices.com


KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House

[illegible]

Project number	ktha 2015
Date	07/05/2015
Drawn by	RKH
Checked by	JMB


Scale	As indicated
-------	--------------



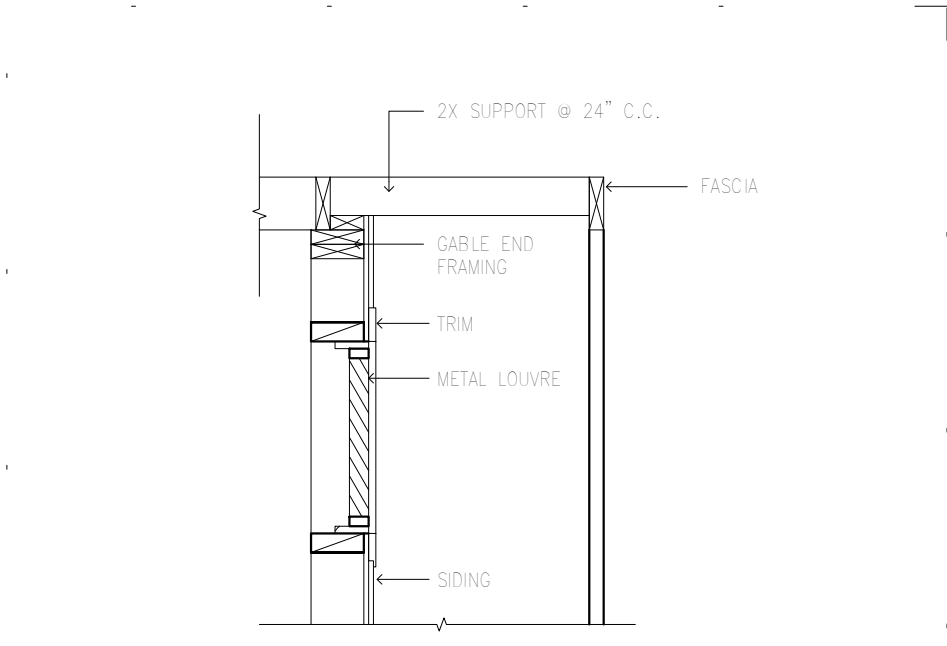

GABLE VENT


SCALE: 3/4"=1'-0"

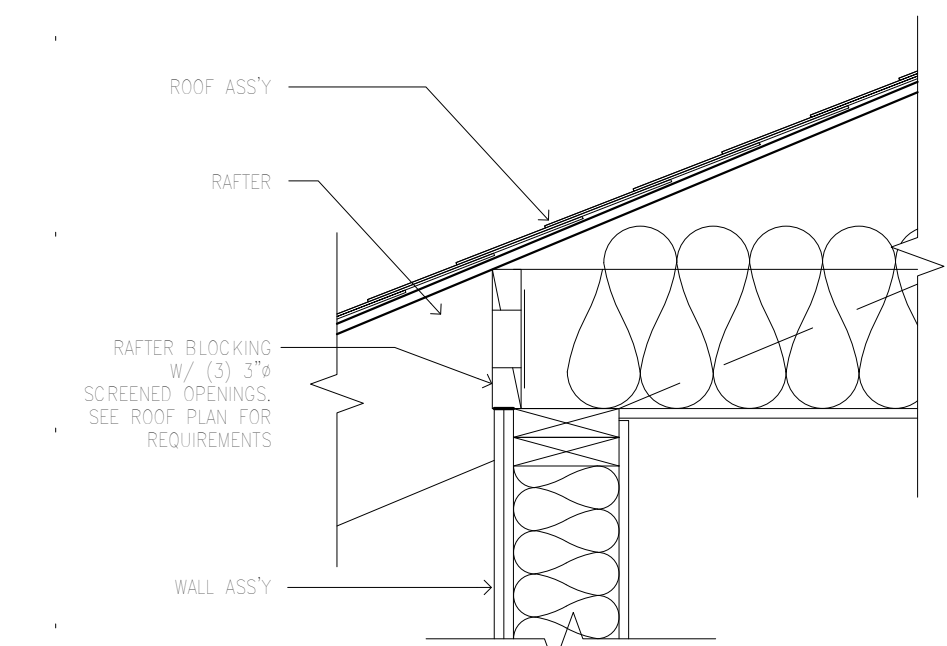

\*NOTE: ENSURE ATTIC INSULATION DOES NOT RESTRICT FREE FLOW OF VENT

SOFFIT VENT

SCALE: 1-1/2"=1'-0"

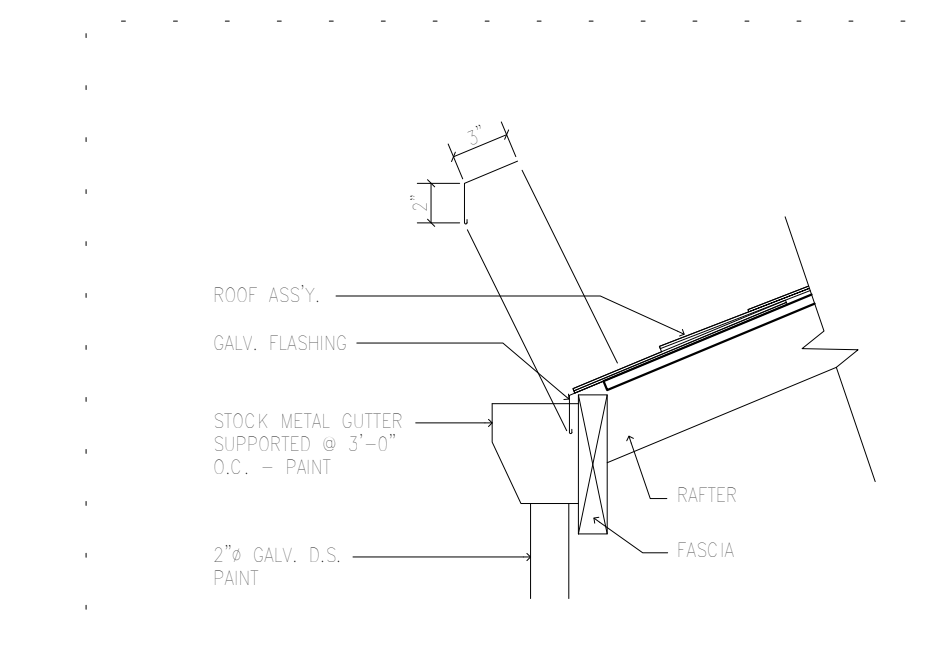


GUTTER DETAIL

SCALE: 1-1/2"=1'-0"

Note:  
All Headers 6X12 DF #2 U.N.O.

Shearwall Schedule

Wall Line	Story	Sheathing	Framing	Nailing	Anchor Bolts	Connections	Other
1-1	1	T-111 Siding	2X6 @ 16" o.c.	8d @ 6" edge, 12" field	5/8" X 10" @ 48" o.c.	H2.5 @ EA Truss	
2-1	1	T-111 Siding	2X6 @ 16" o.c.	8d @ 6" edge, 12" field	5/8" X 10" @ 48" o.c.	H2.5 @ EA Truss	
A-1	1	T-111 Siding	2X6 @ 16" o.c.	8d @ 6" edge, 12" field	5/8" X 10" @ 48" o.c.		
B-1	1	T-111 Siding	2X6 @ 16" o.c.	8d @ 6" edge, 12" field	5/8" X 10" @ 48" o.c.		

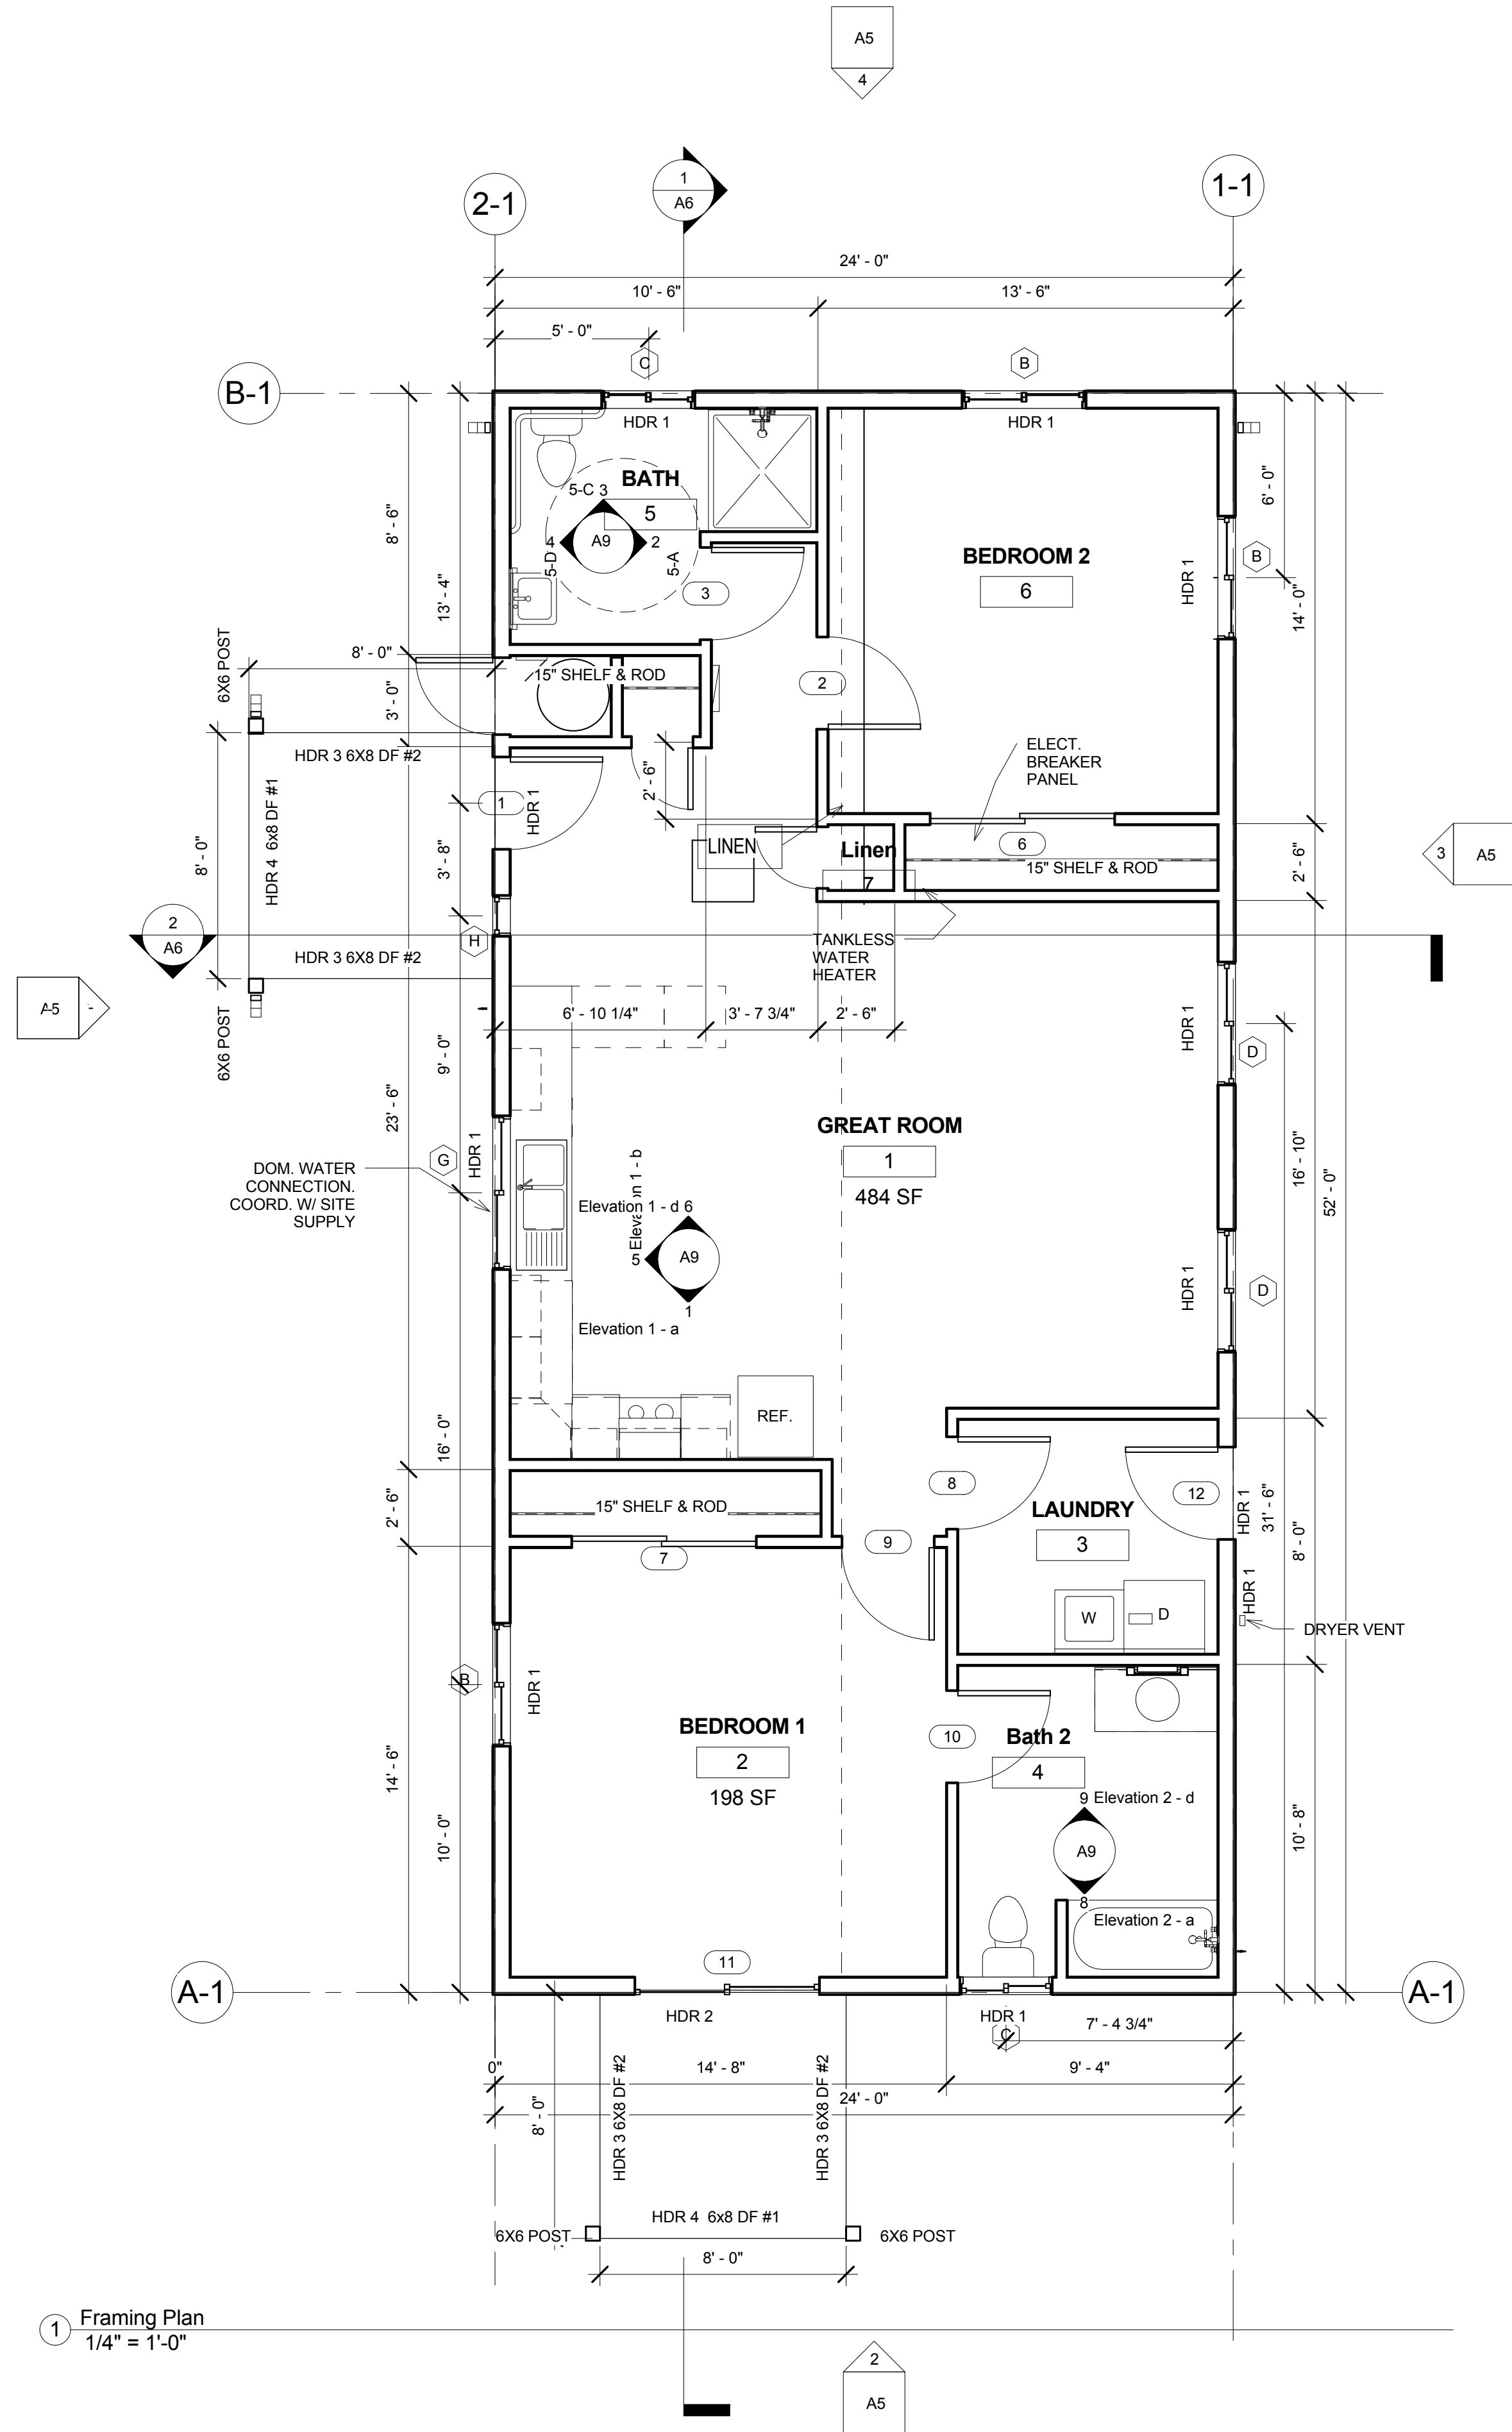

JMB  
ARCHITECTURE



ARCHITECTURE  
PLANNING

4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: jmbarchitect@snowcrest.net



67 Walnut Way PO BOX 1567  
WILLOW CREEK, CA 95573  
707.629.3000 fax 707.629.3011  
email: tvce@tvce.biz

Electrical Consultant Pace Engineering

Address 1730 South Street  
Reading, CA 96001  
Phone 530 244-0202  
Fax 530 244  
e-mail

Bldg. Energy Consultant Abbey Technical Services  
Address Anny McQuerry  
1125 16th Street, Ste. 216  
Arcata, CA 95521  
Phone 707.826.1433  
Fax 707.826-1430  
e-mail annymc@abbaytechnicalservices.com

KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House

No.	Description	Date

Framing Plan

Project number ktha 2015  
Date 07/05/2015  
Drawn by RKH  
Checked by JMB



S2

Scale 1/4" = 1'-0"



ATTIC VENT REQUIREMENTS  
ATTIC AREA: 1248 sf  
1248/150= 8.32 sf  
GABLE VENTS MUST PROVIDE 8.32 sf VENT AREA  
Corrosion resistant, non-combustible Vent  
with openings between 1/8" and 1/4"

3 Roof Plan  
1/4" = 1'-0"

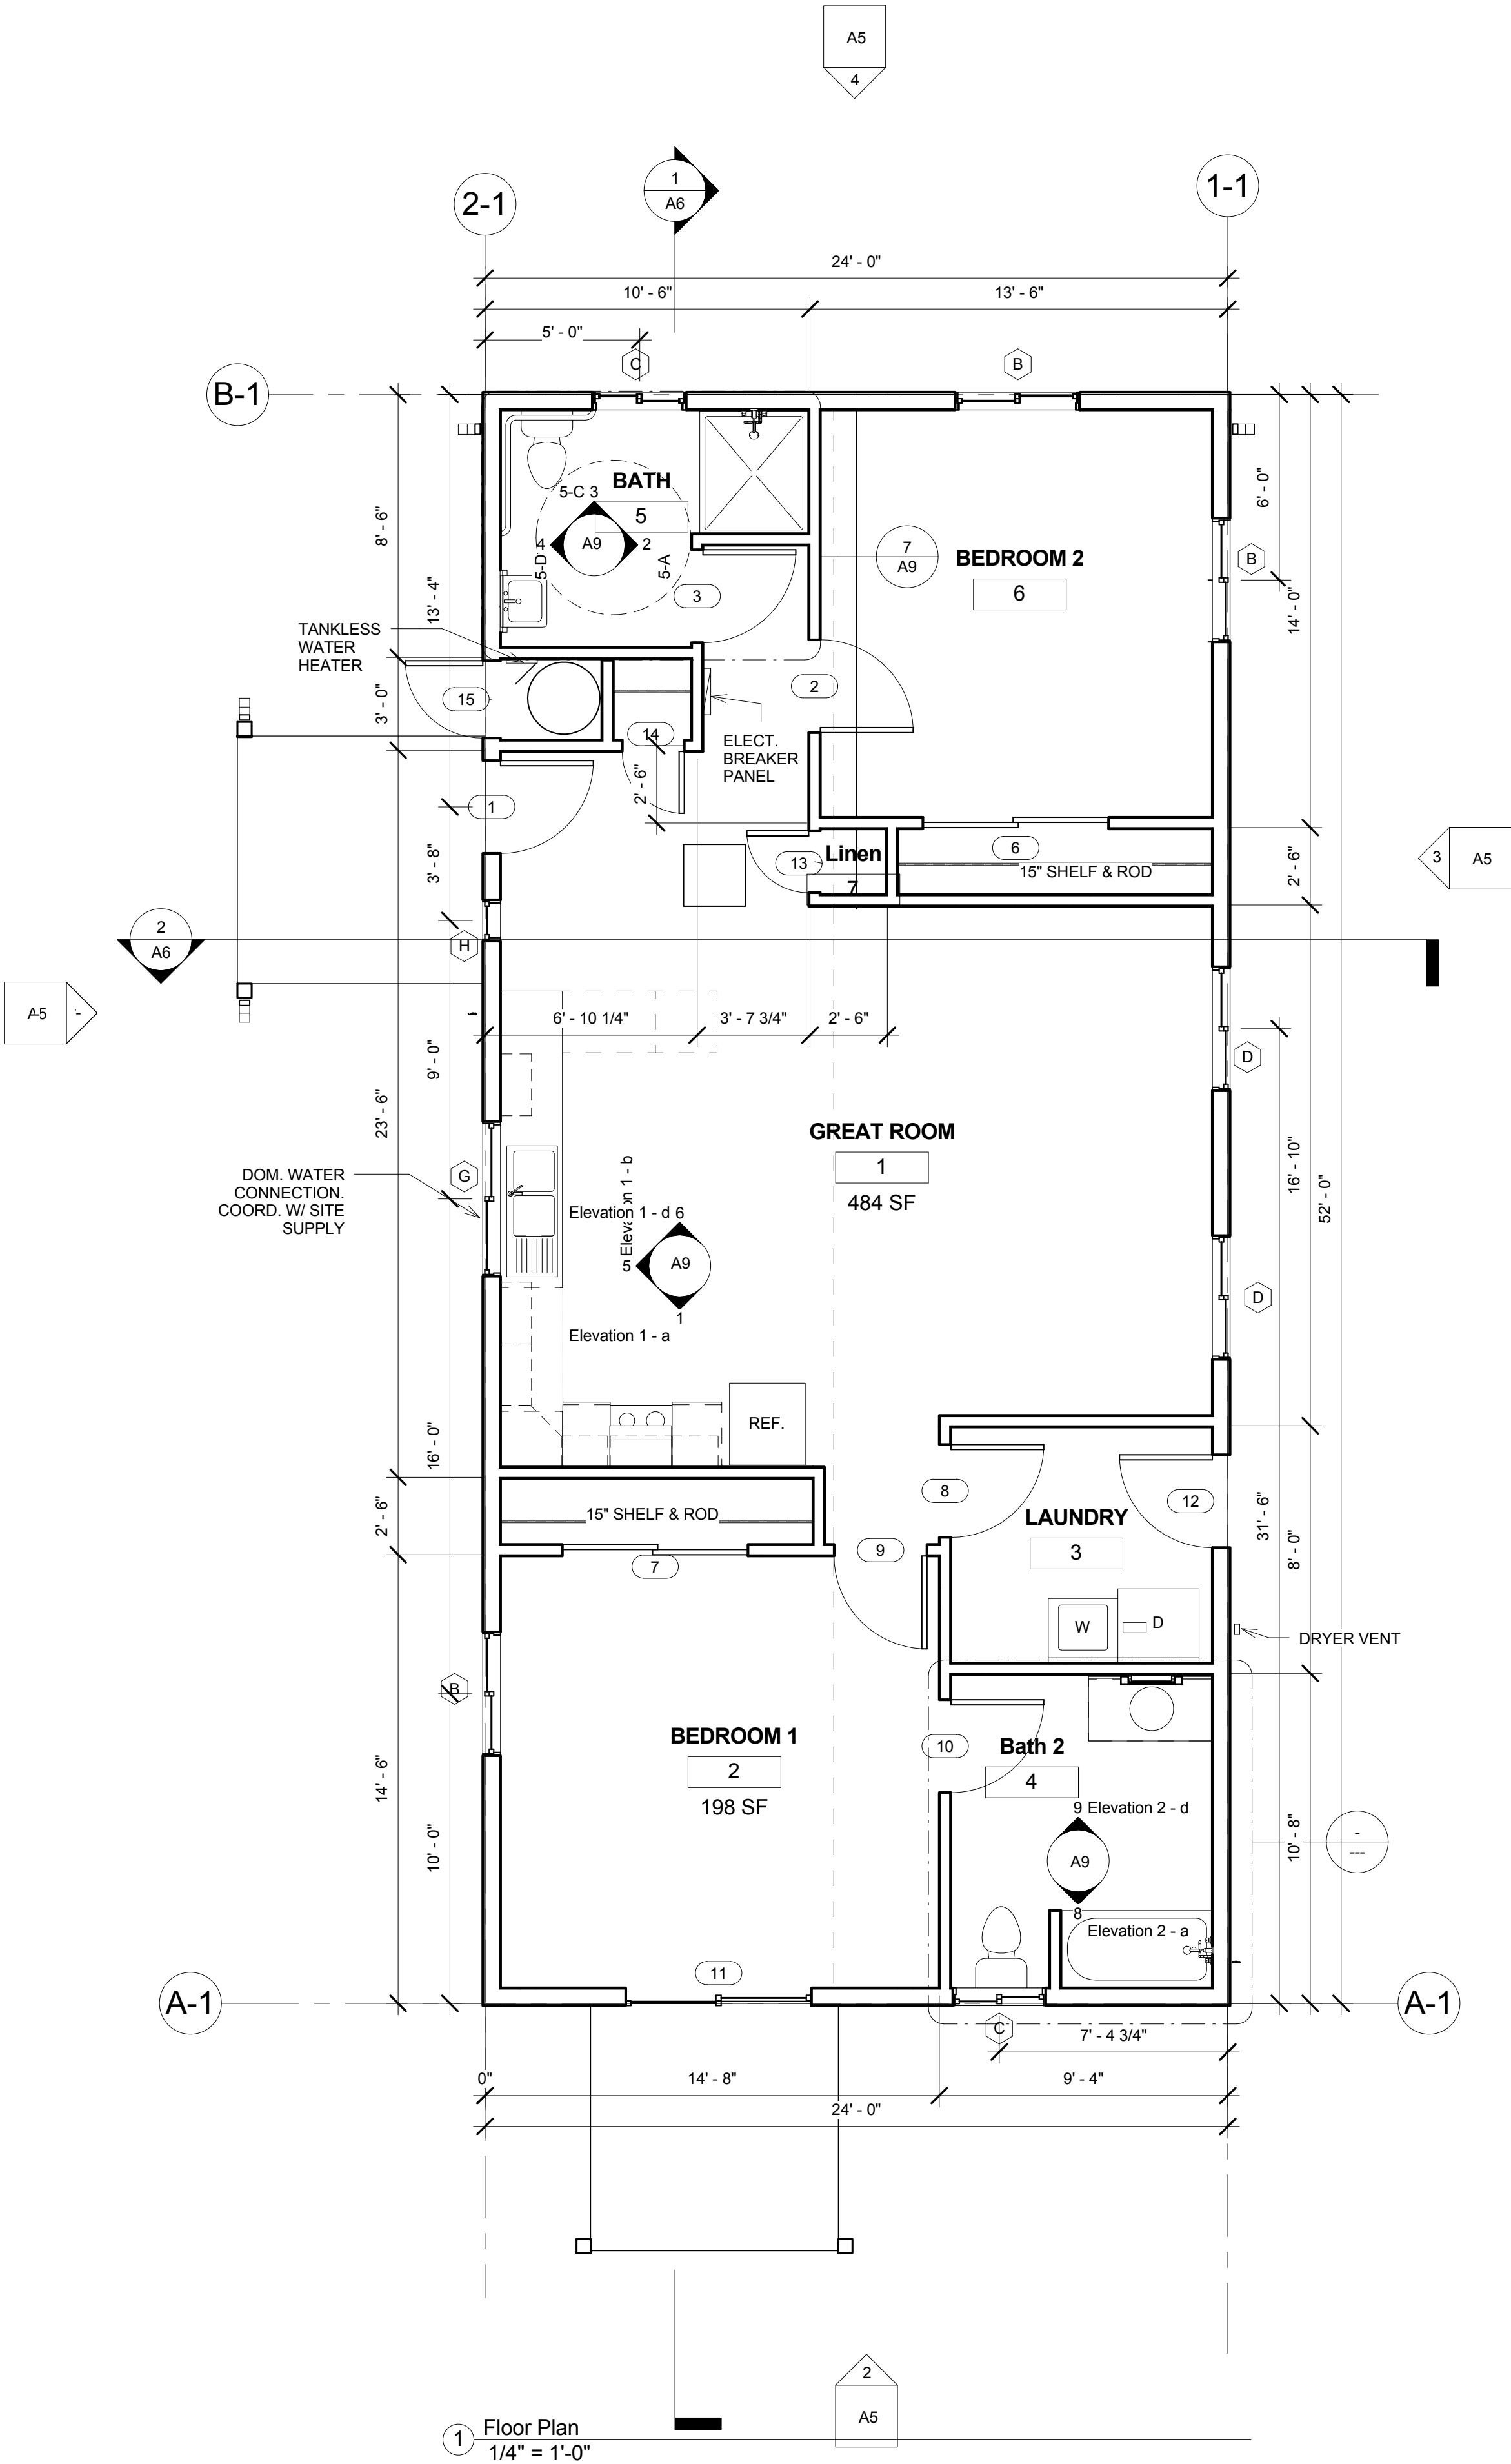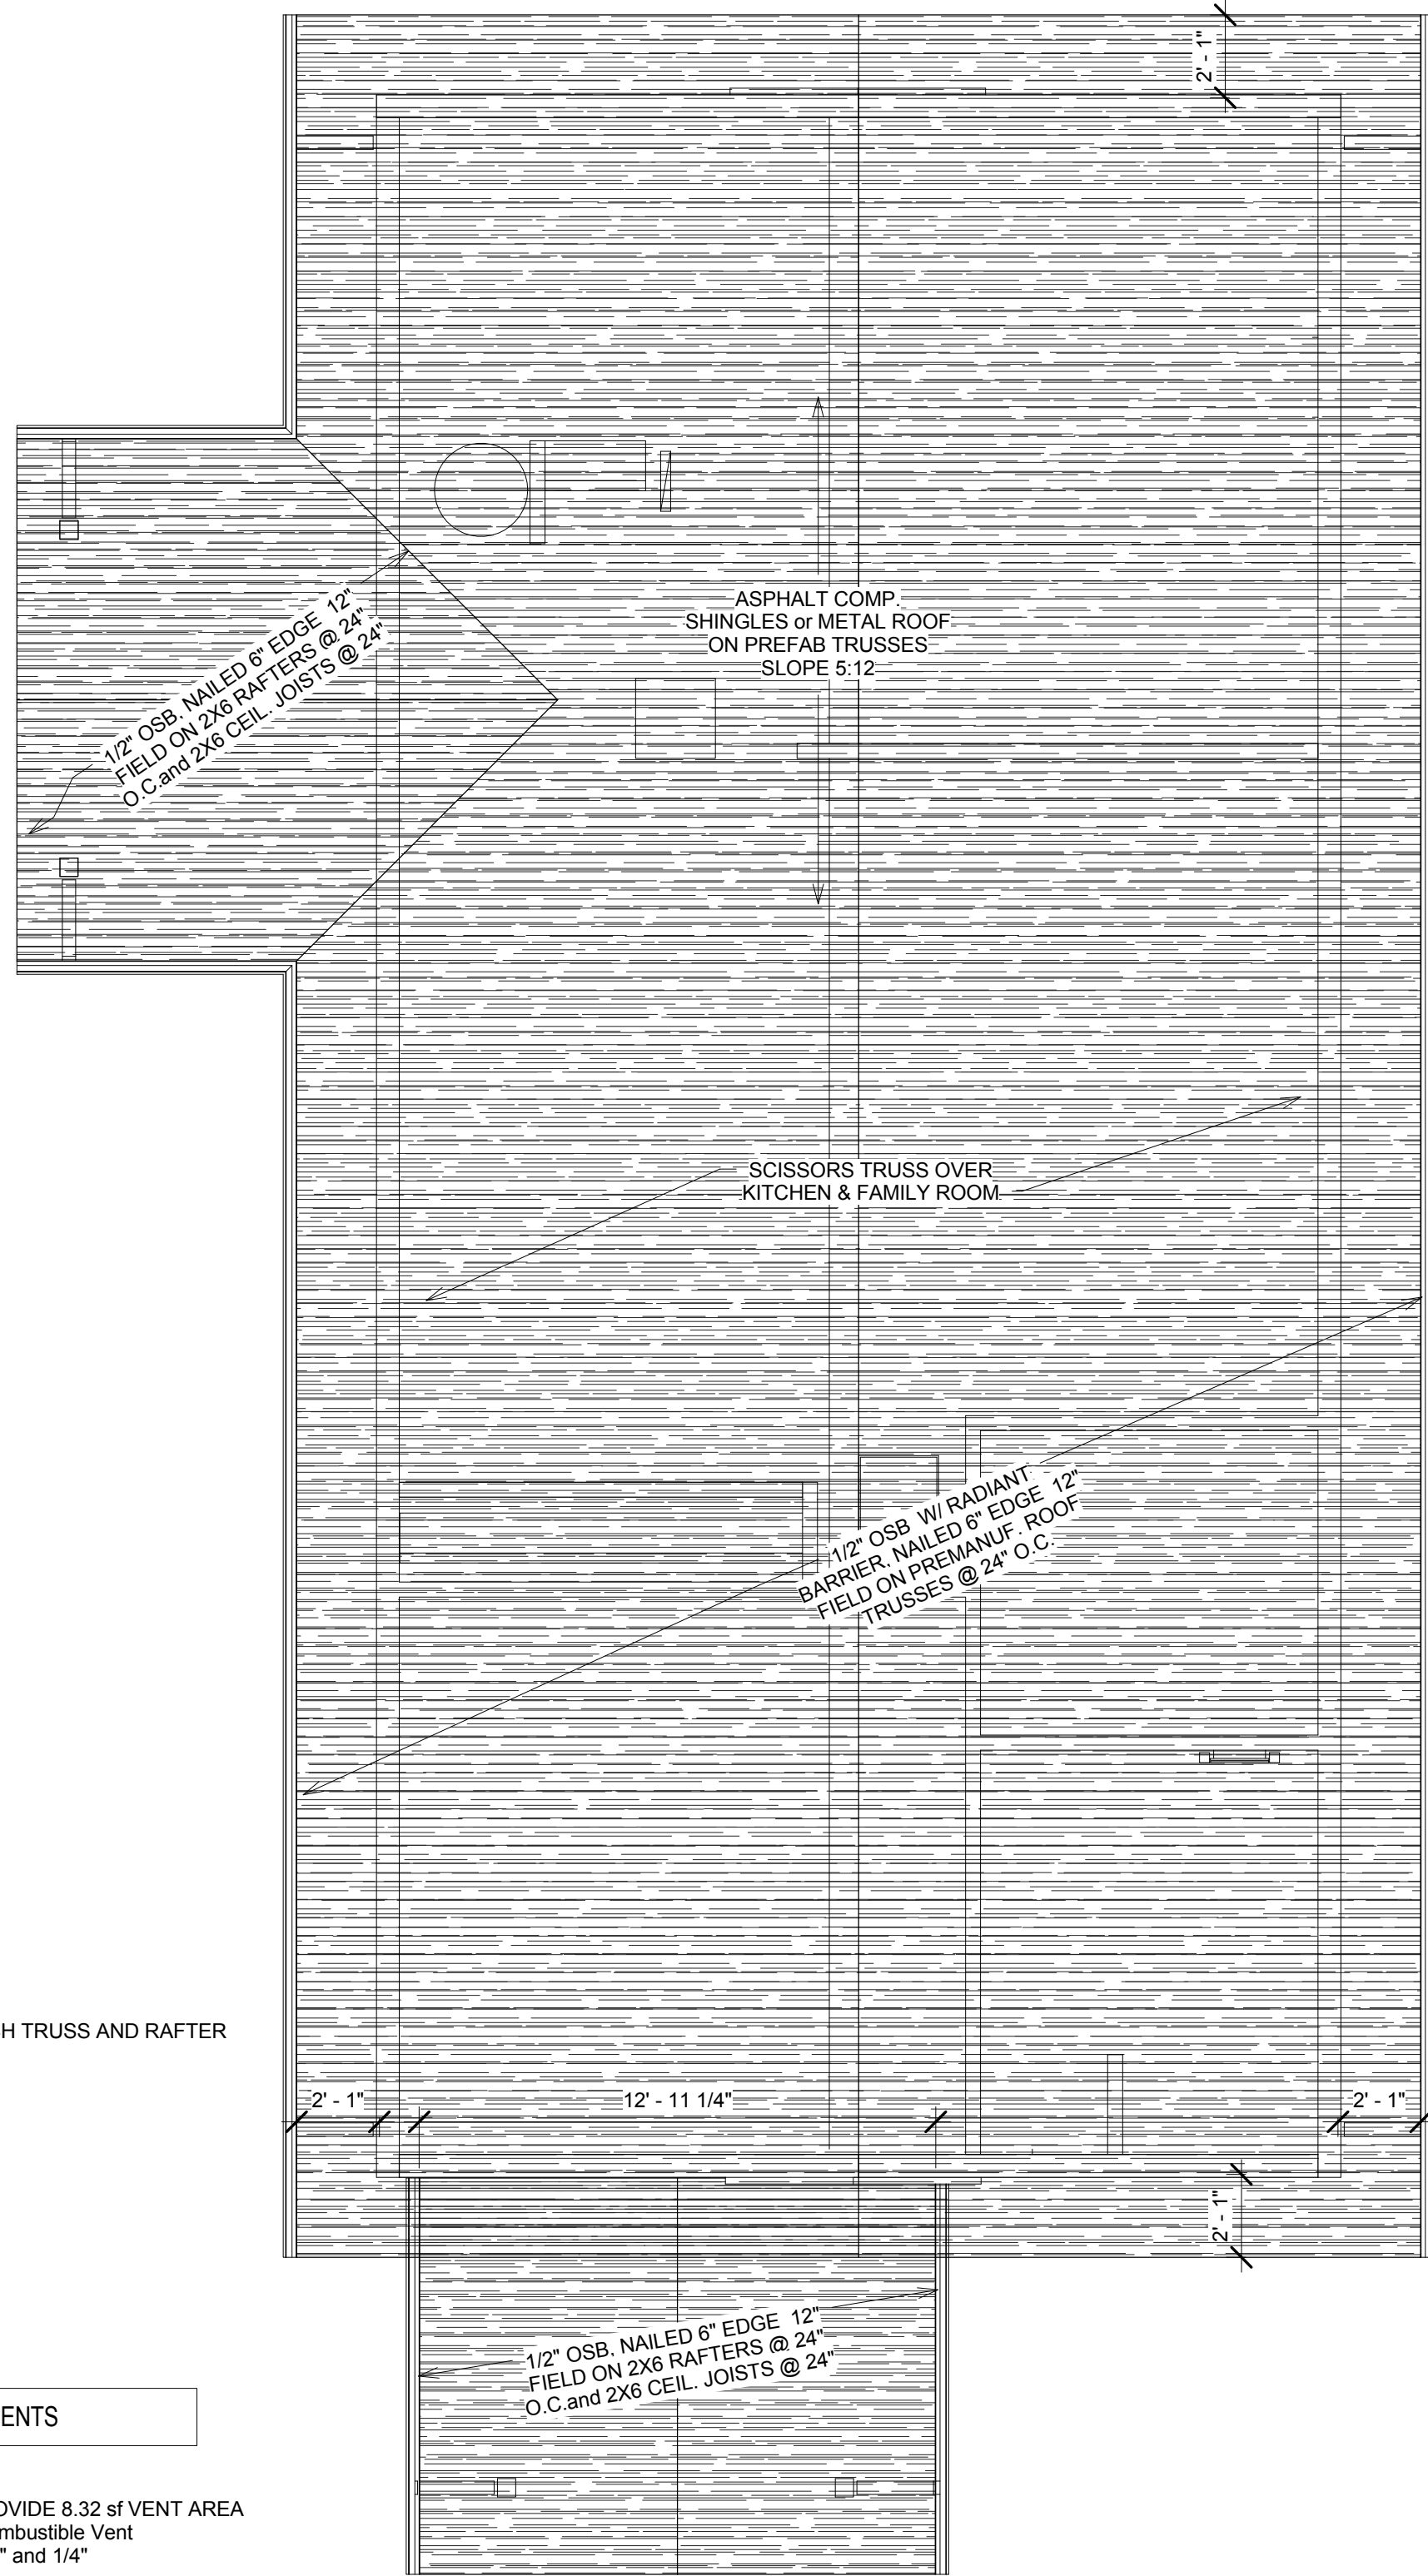

JMB  
ARCHITECTURE

ARCHITECTURE  
PLANNING

4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: jmbarchitect@snowcrest.net



67 Walnut Way PO BOX 1567  
WILLOW CREEK, CA 95573  
707.629.3000 fax 707.629.3011  
email: tvce@tvce.biz

Electrical Consultant Pace Engineering

Address 1730 South Street  
Reading, CA 96001  
Phone 530 244-0202  
Fax 530 244  
e-mail

Bldg. Energy Consultant Abbey Technical Services  
Address Anny McQuinn  
1125 16th Street, Ste. 216  
Arcata, CA 95521  
Phone 707.826.1433  
Fax 707-826-1430  
e-mail annymc@abbaytechnicalservices.com

KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House

No.	Description	Date


FLOOR PLAN &  
ROOF PLAN

Project number ktha 2015  
Date 07/05/2015  
Drawn by RKH  
Checked by JMB

A1

Scale 1/4" = 1'-0"


4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: [jmbarchitect@snowcrest.net](mailto:jmbarchitect@snowcrest.net)

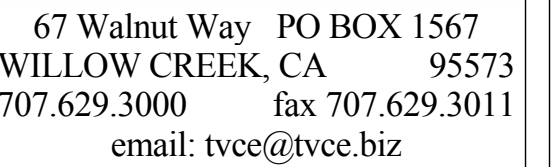


KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House

[illegible]

08/17/2013 4:33:31 PM

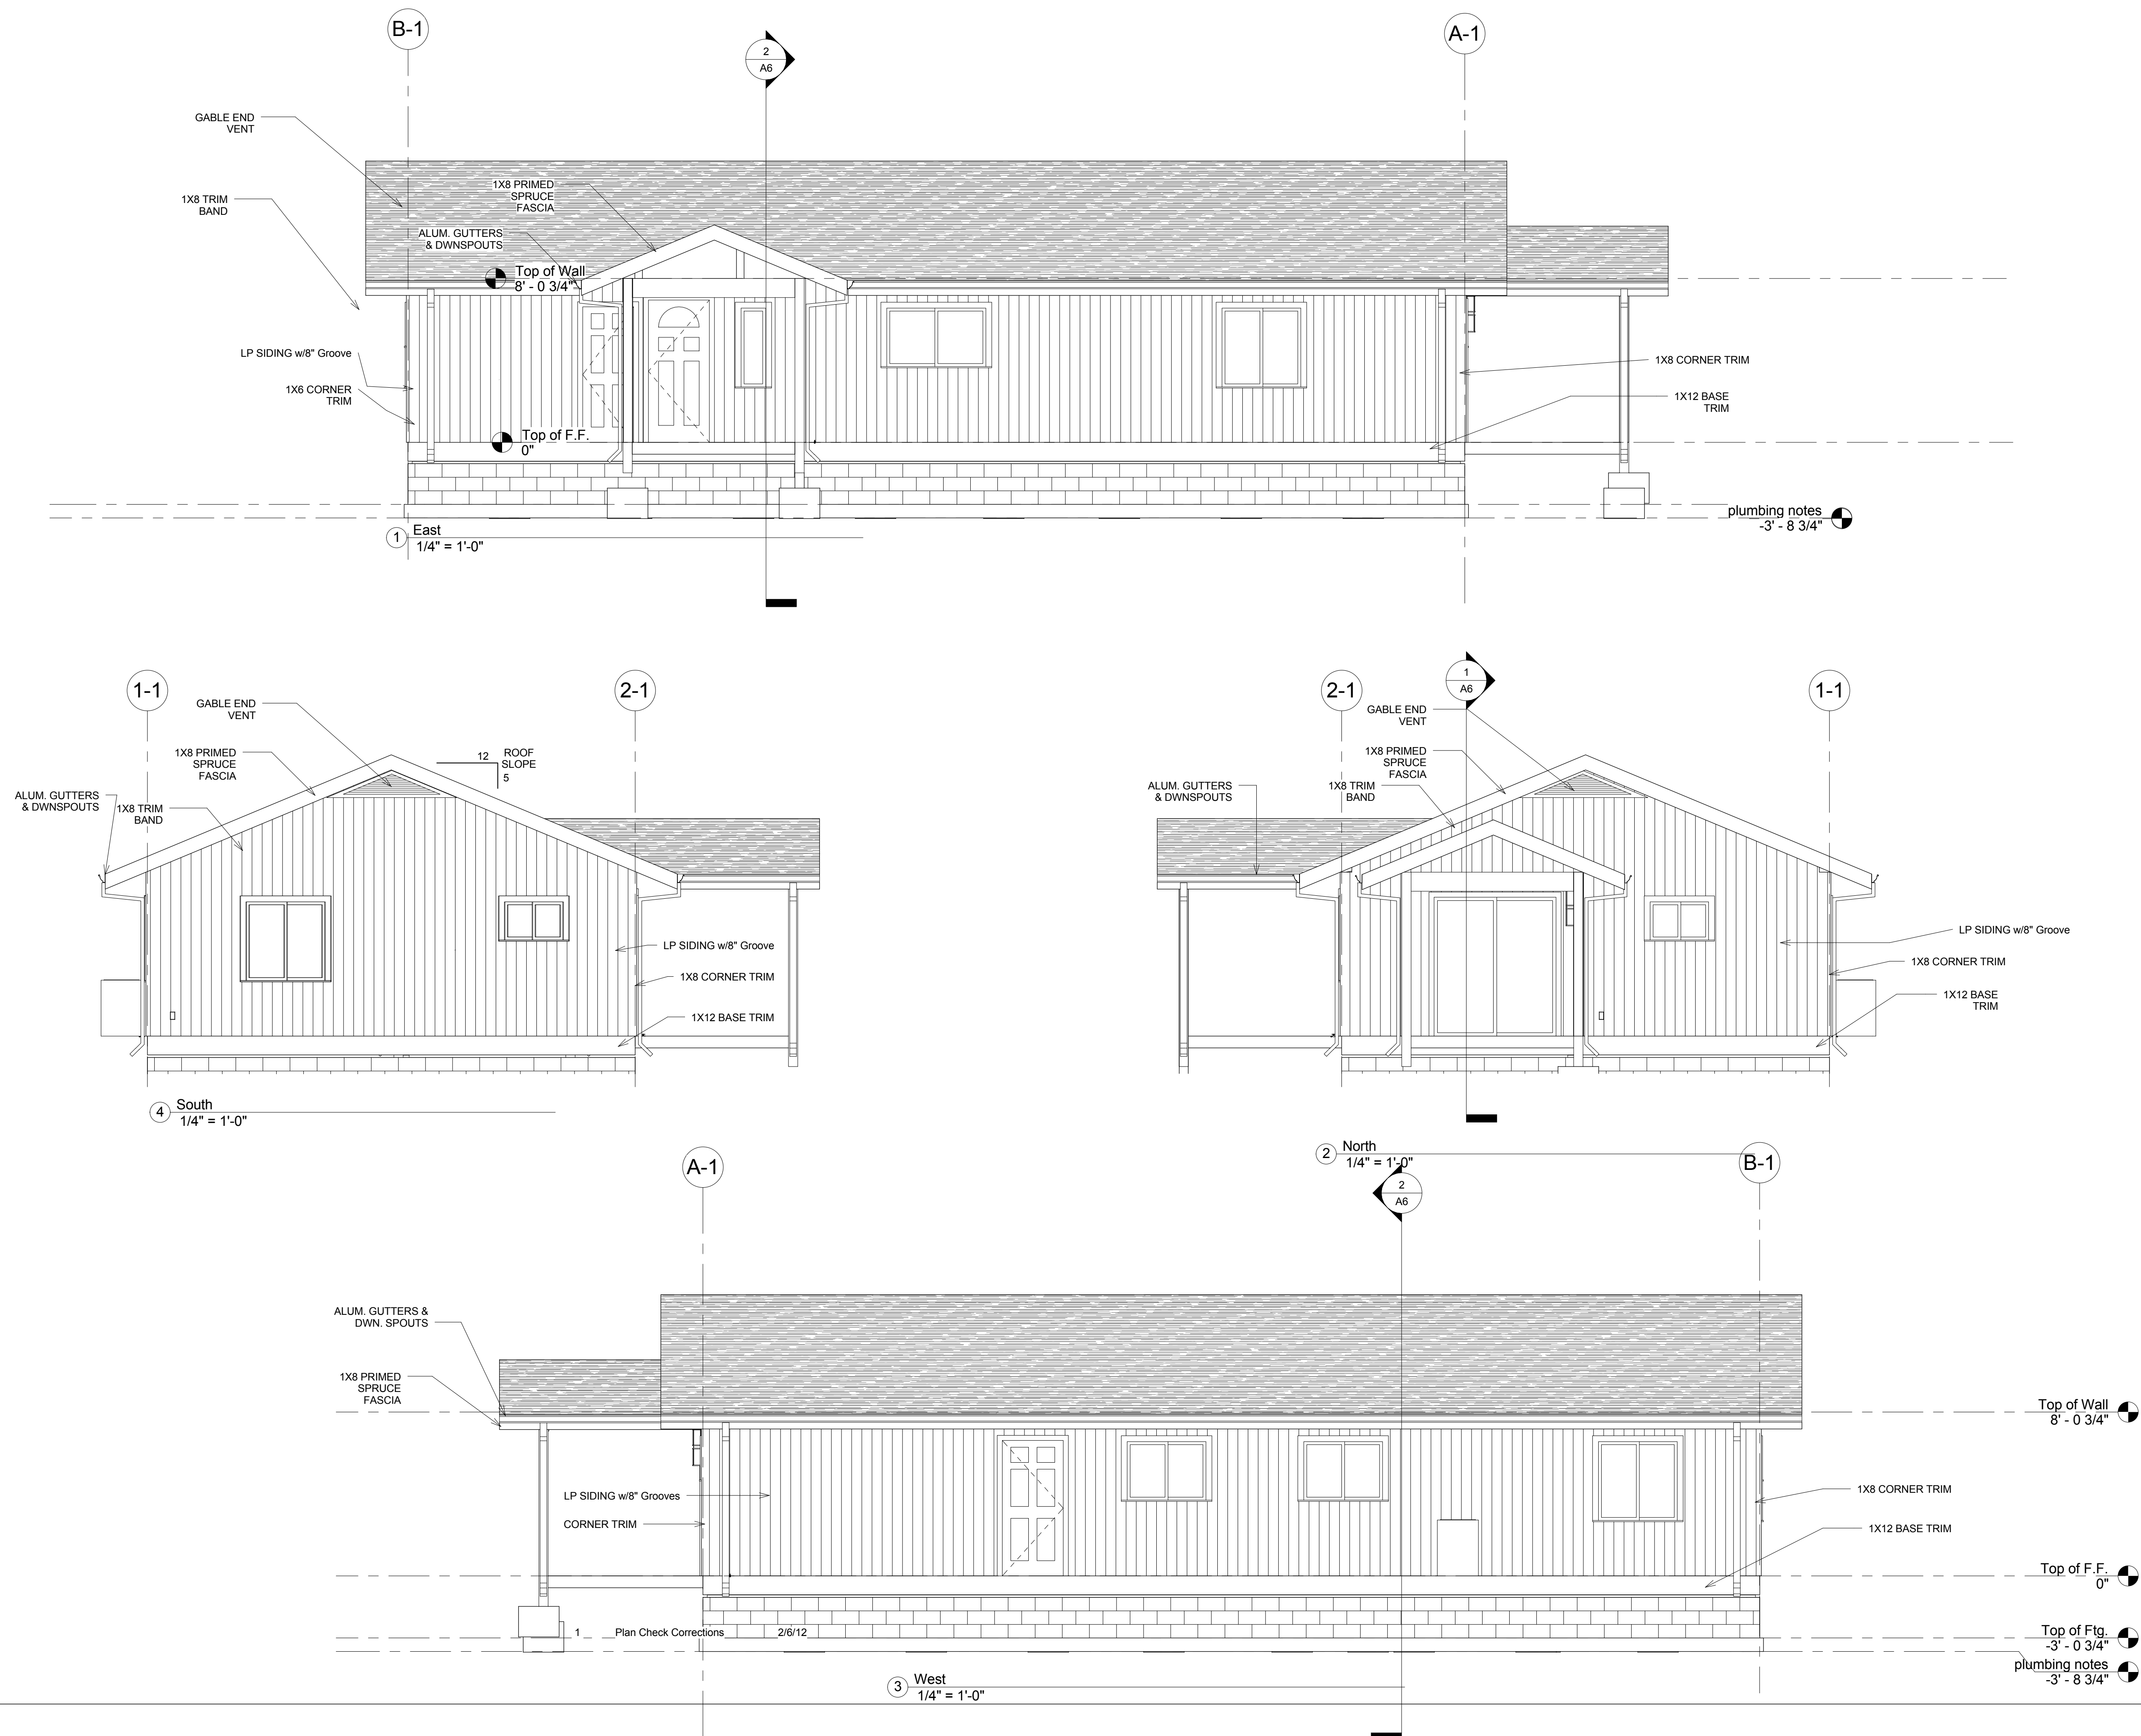

4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: [jmbarchitect@snowcrest.net](mailto:jmbarchitect@snowcrest.net)

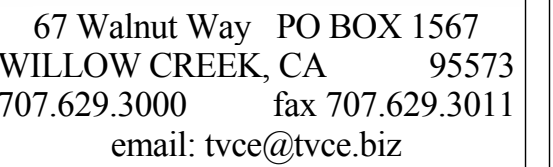


Bldg. Energy Consultant Address	Abbey Technical Services Anny McQuenny 1125 16th Street, Ste. 216 Arcata, CA 95521
Phone	707.826.1433
Fax	707-826-1430
e-mail	anny@ abbaytechnicalservices.com

KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House




[illegible]

Project number	ktha 2015
Date	07/05/2015
Drawn by	RKH
Checked by	JMB

Scale  $1/4" = 1'-0"$

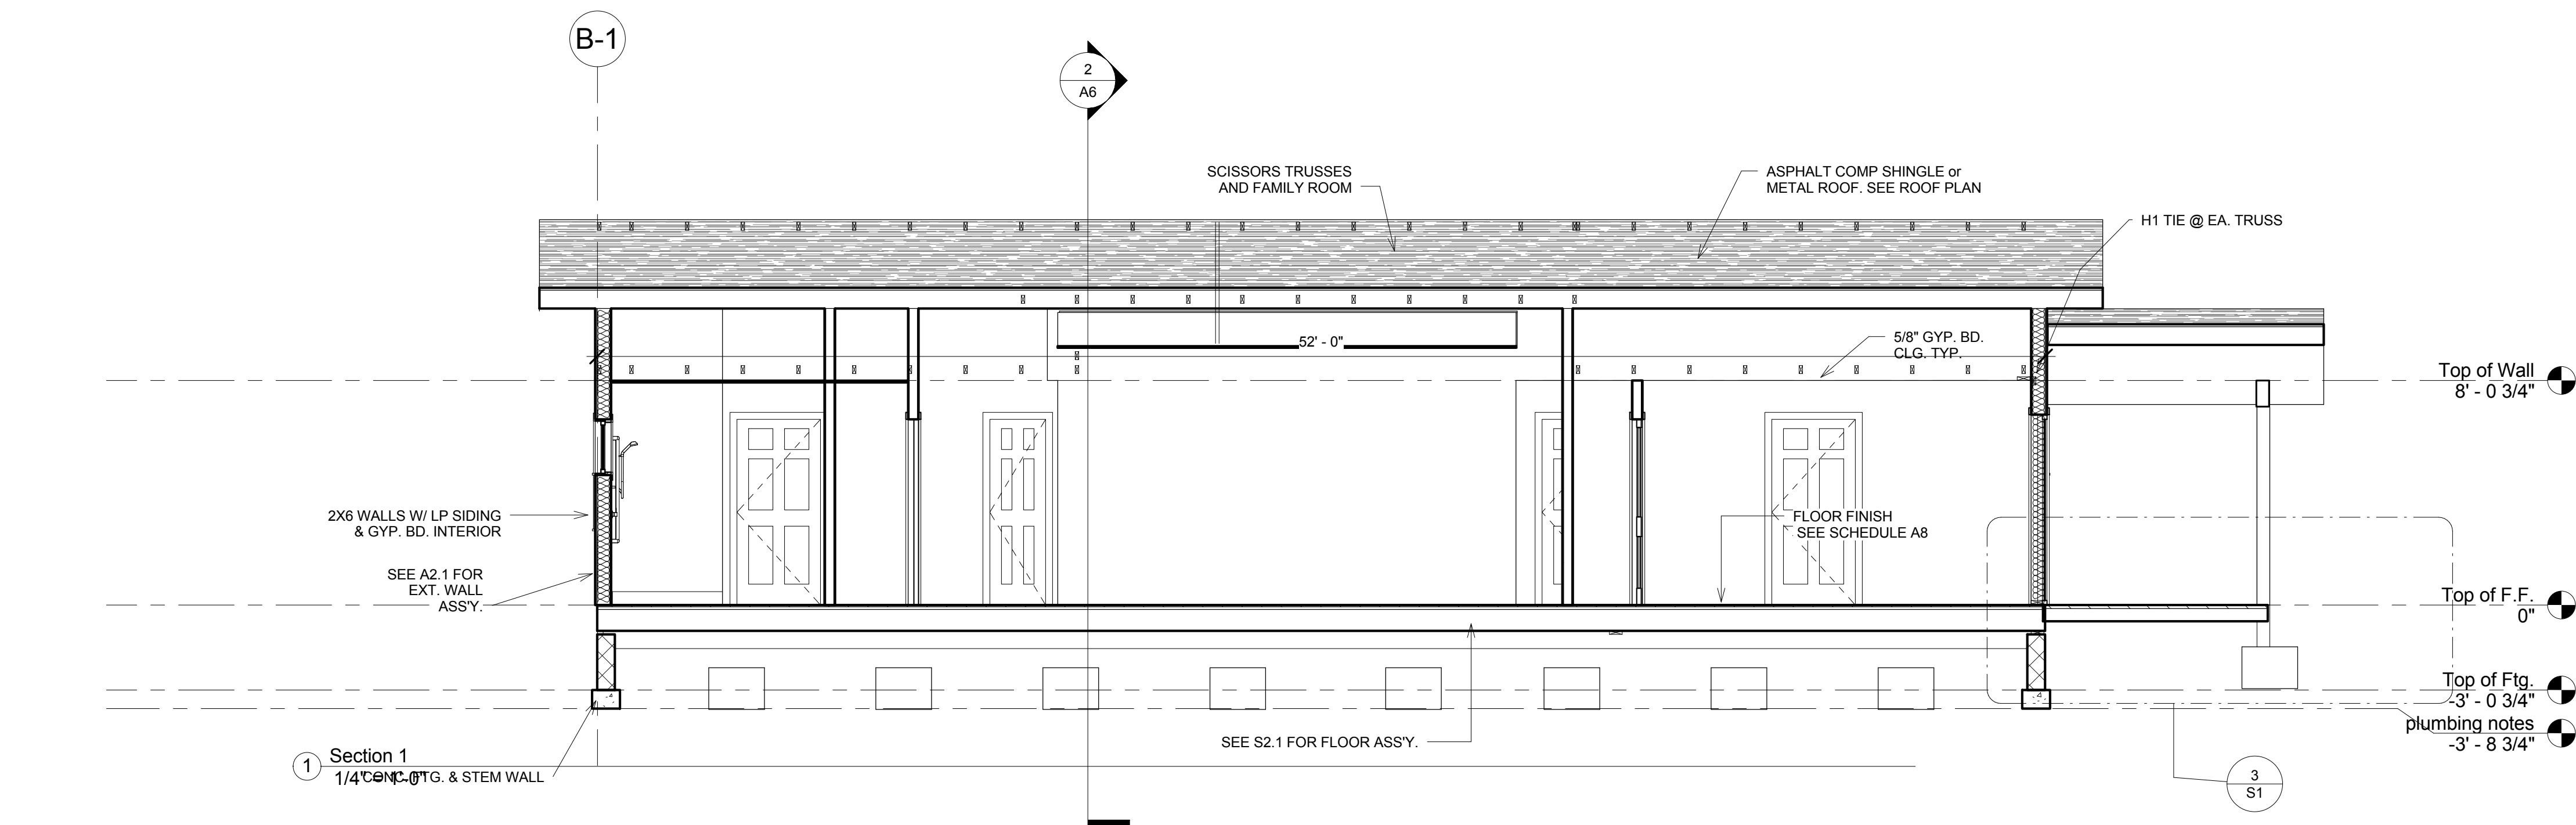


1. KEYNOTE LEGEND
1. ROOFING - ASPHALT COMP. SHINGLES  
OVER 1/2" OSB SHTG. OVER 2 LAYERS  
#15 FELT OVER MANUFACTURED  
TRUSS (34" O.C.)  
NAILING PER TABLE 23-II-B-2.
2. WALLS - SIDING OVER 2 LAYERS #15  
FELT OVER 1/2" OSB SHTG. ON 2X6  
STUDS @ 16" O.C.
3. FLOORING - 1-1/8" SHTG. OVER  
2X12 SILL @ 16" O.C. UNO  
SEE SCHEDULE SHEET A8 FOR FLR. FINISH
4. 2X6 DBL TOP PLATE
5. BLOCKING
6. R38 INSULATION
7. R21 INSULATION
8. 1/2" DRYWALL
9. 2X6 P.T. SILL
10. 3/4" DIA. A.B. @ 4'-0" O.C.
11. CMU STEM WALL W VERTS @ 24" C.C.  
AND 1/4" HORIZ. CONT.
12. 6X12 FLOORING W/ (1) #4 T&B
13. GABLE END
14. GPM GUTTER & DWN SPOUT
15. 2X10 FASCIA
16. SOFFIT VENT
17. TRUSSES W/5/8" GYP. DB CEILING
18. CONC. PIER BLOCK & 24"x24"x12" FTG  
W/ (3) #4 BARS EA WAY
19. H1 TEI @ EA TRUSS
20. A35 @ 32' O.C. TRUSS BLOCKING TO  
TOP PLATE
21. A35 @ 32' O.C. RIM JOIST TO SILL

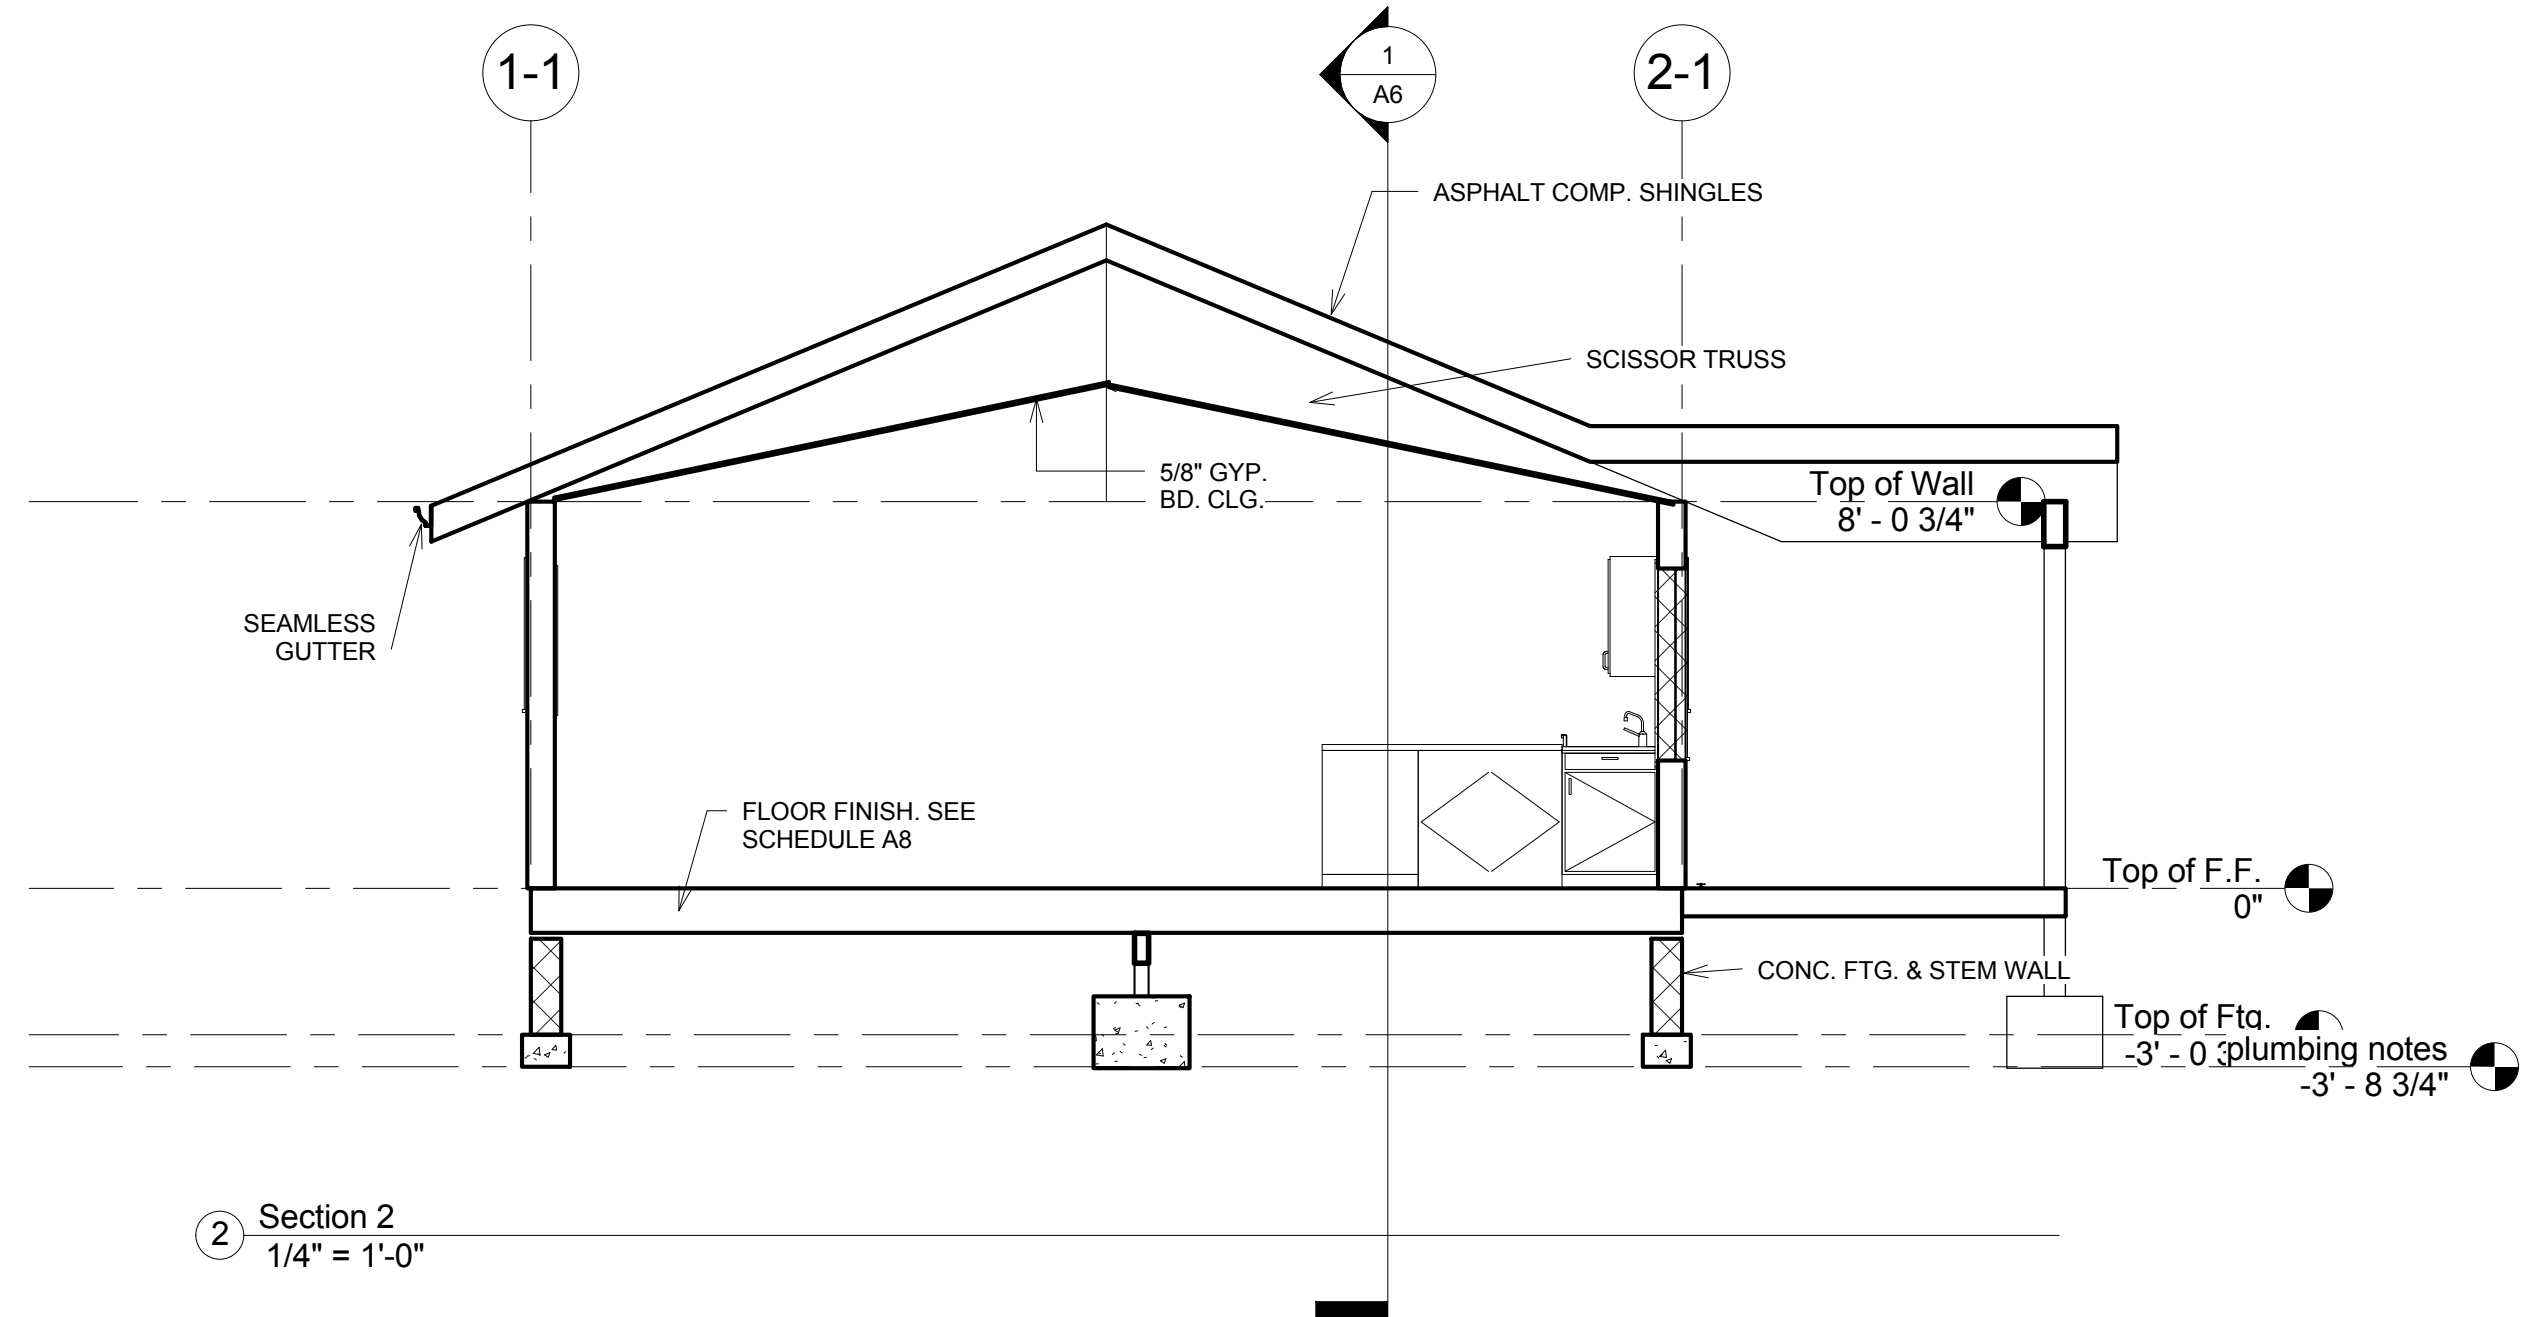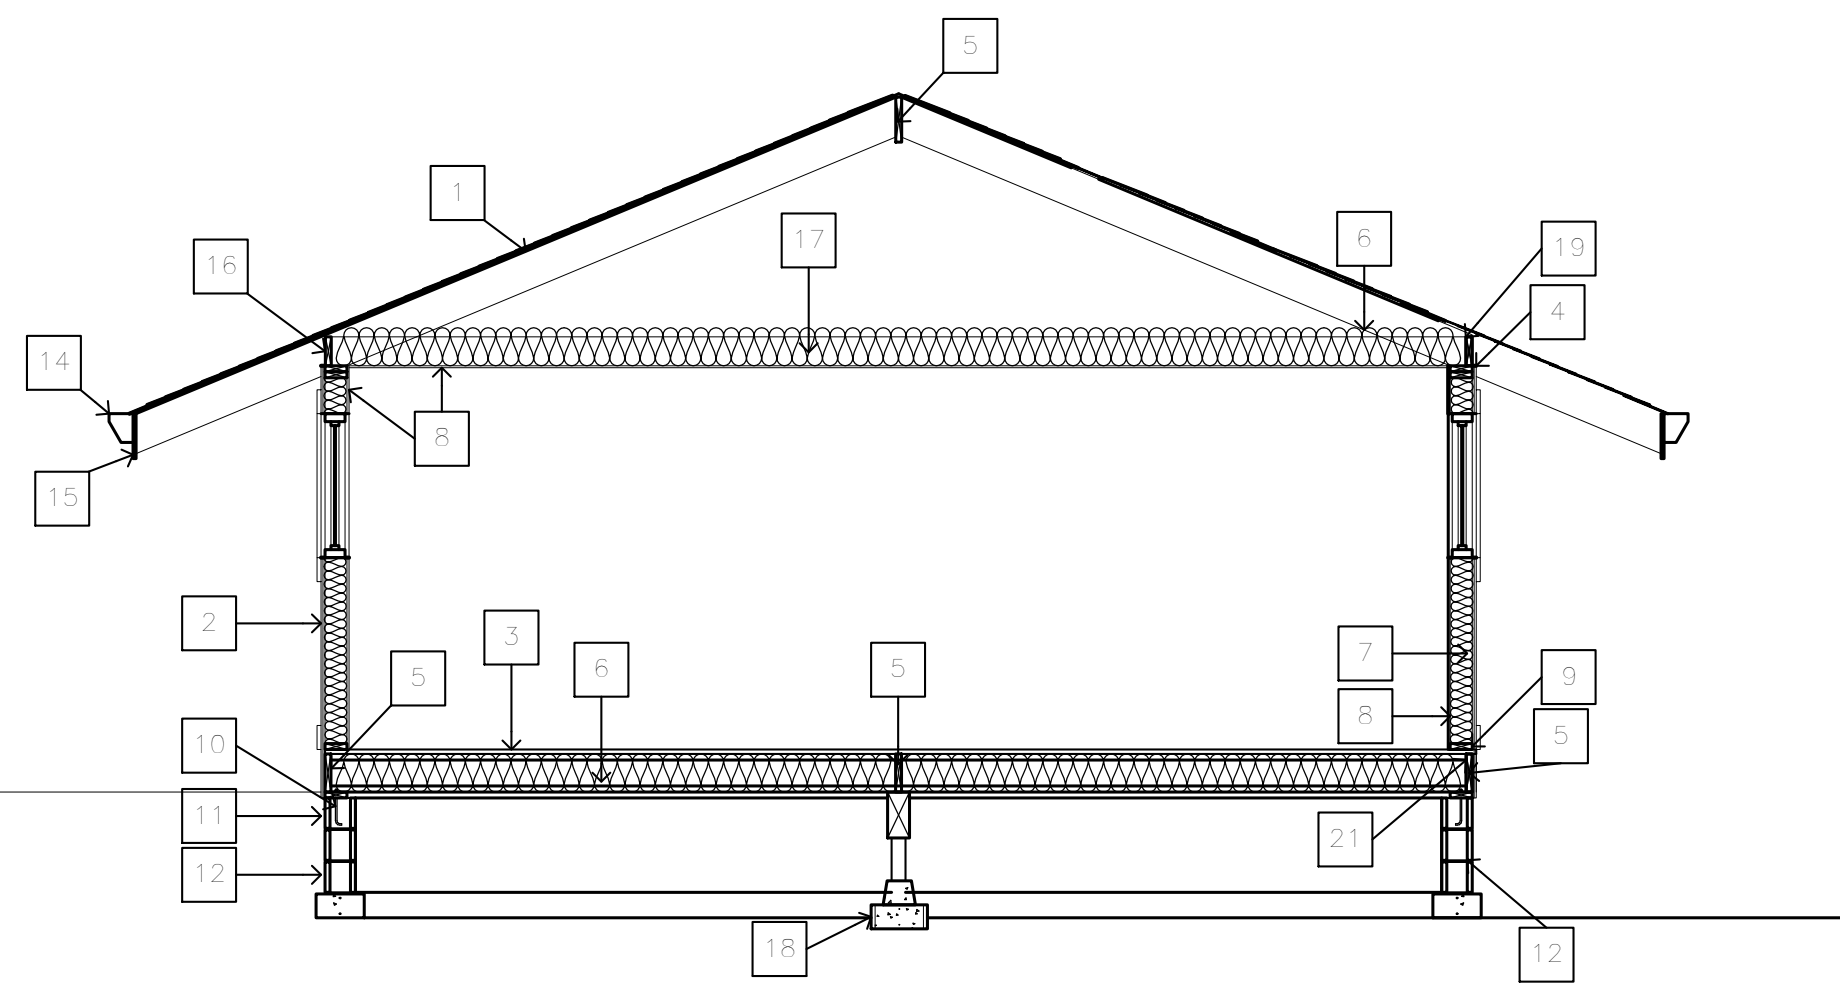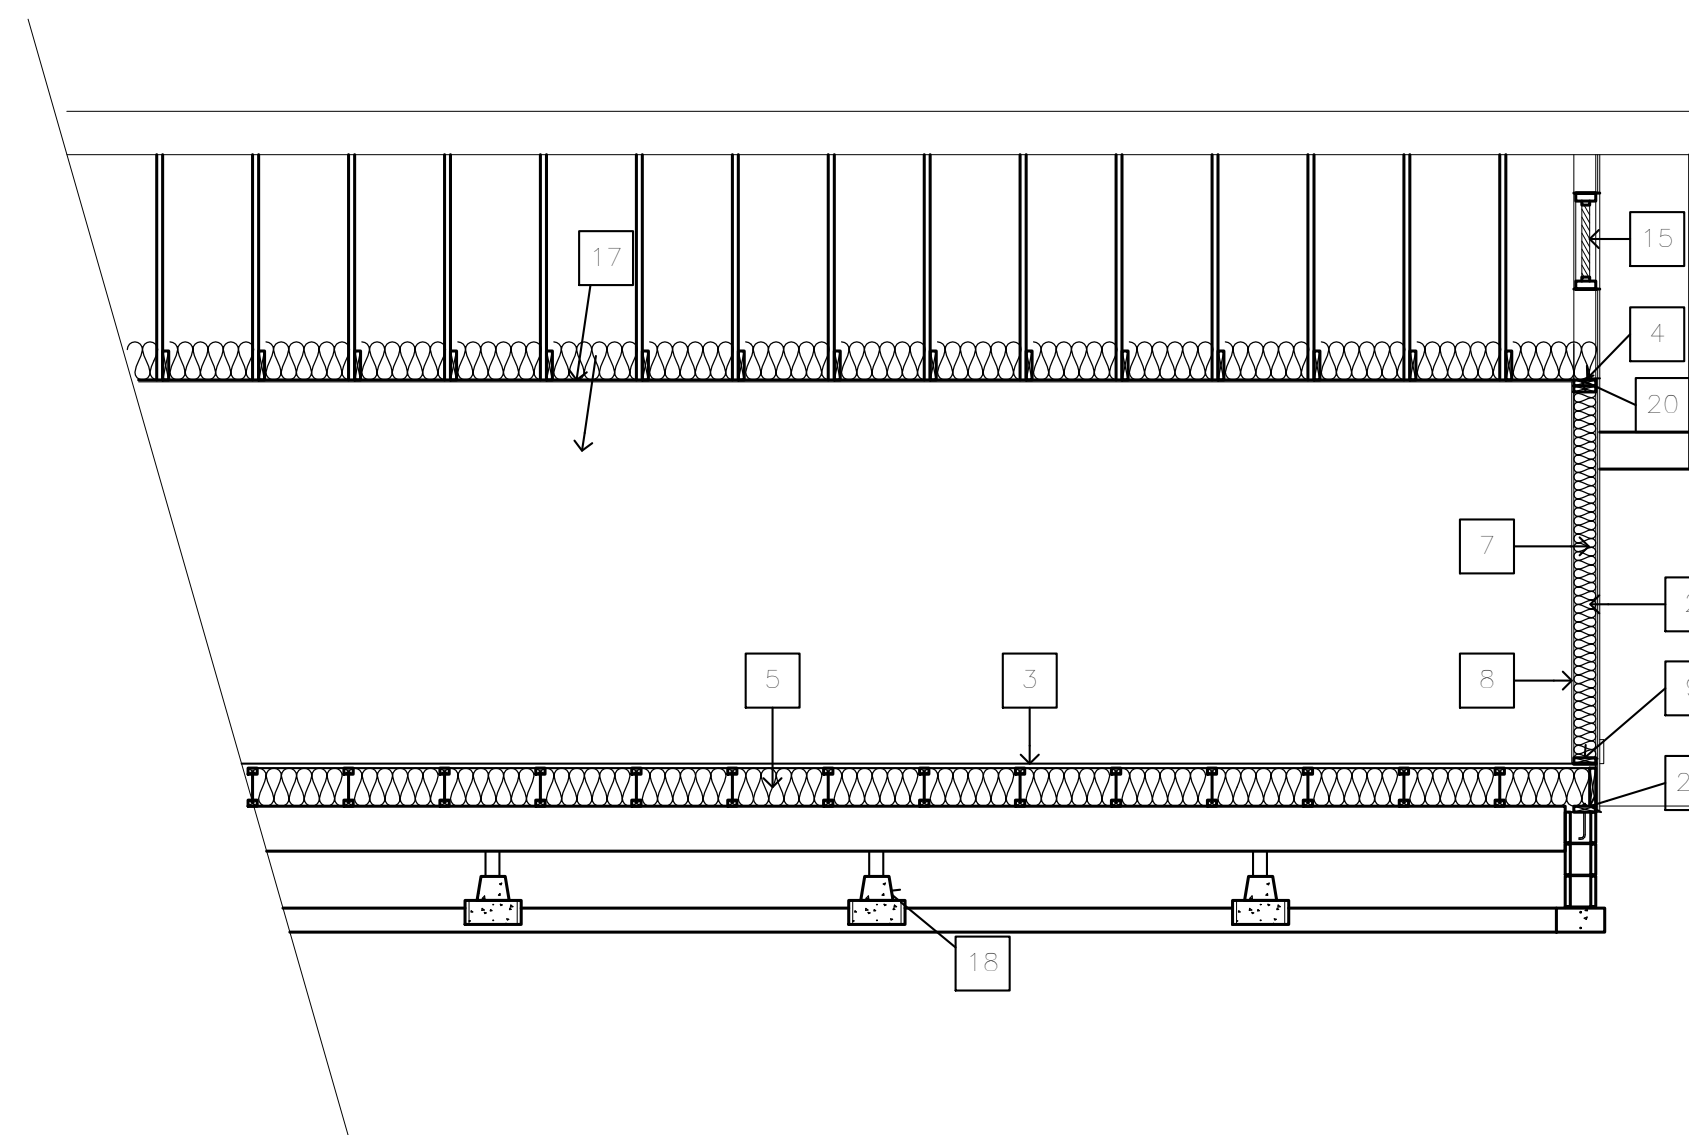





4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: [jmbarchitect@snowcrest.net](mailto:jmbarchitect@snowcrest.net)

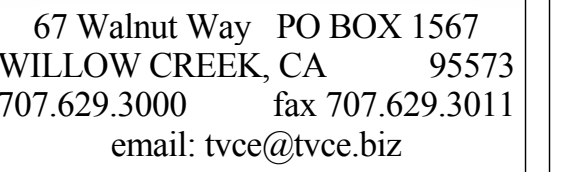

Address 1730 South Street  
Redding, CA  
96001  
Phone 530 244-0202  
Fax 530 244  
e-mail

Bldg. Energy Consultant Address	Abbey Technical Services Anny McQuenny 1125 16th Street, Ste. 216 Arcata, CA 95521
Phone	707.826.1433
Fax	707-826-1430
e-mail	anny@ abbaytechnicalservices.com

KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House

No.	Description	Date
	RKH	

## Details


Project number	ktha 2015
----------------	-----------

Date	07/05/2015
------	------------

Drawn by	NOTED	RKH
----------	-------	-----


## A7

Scale

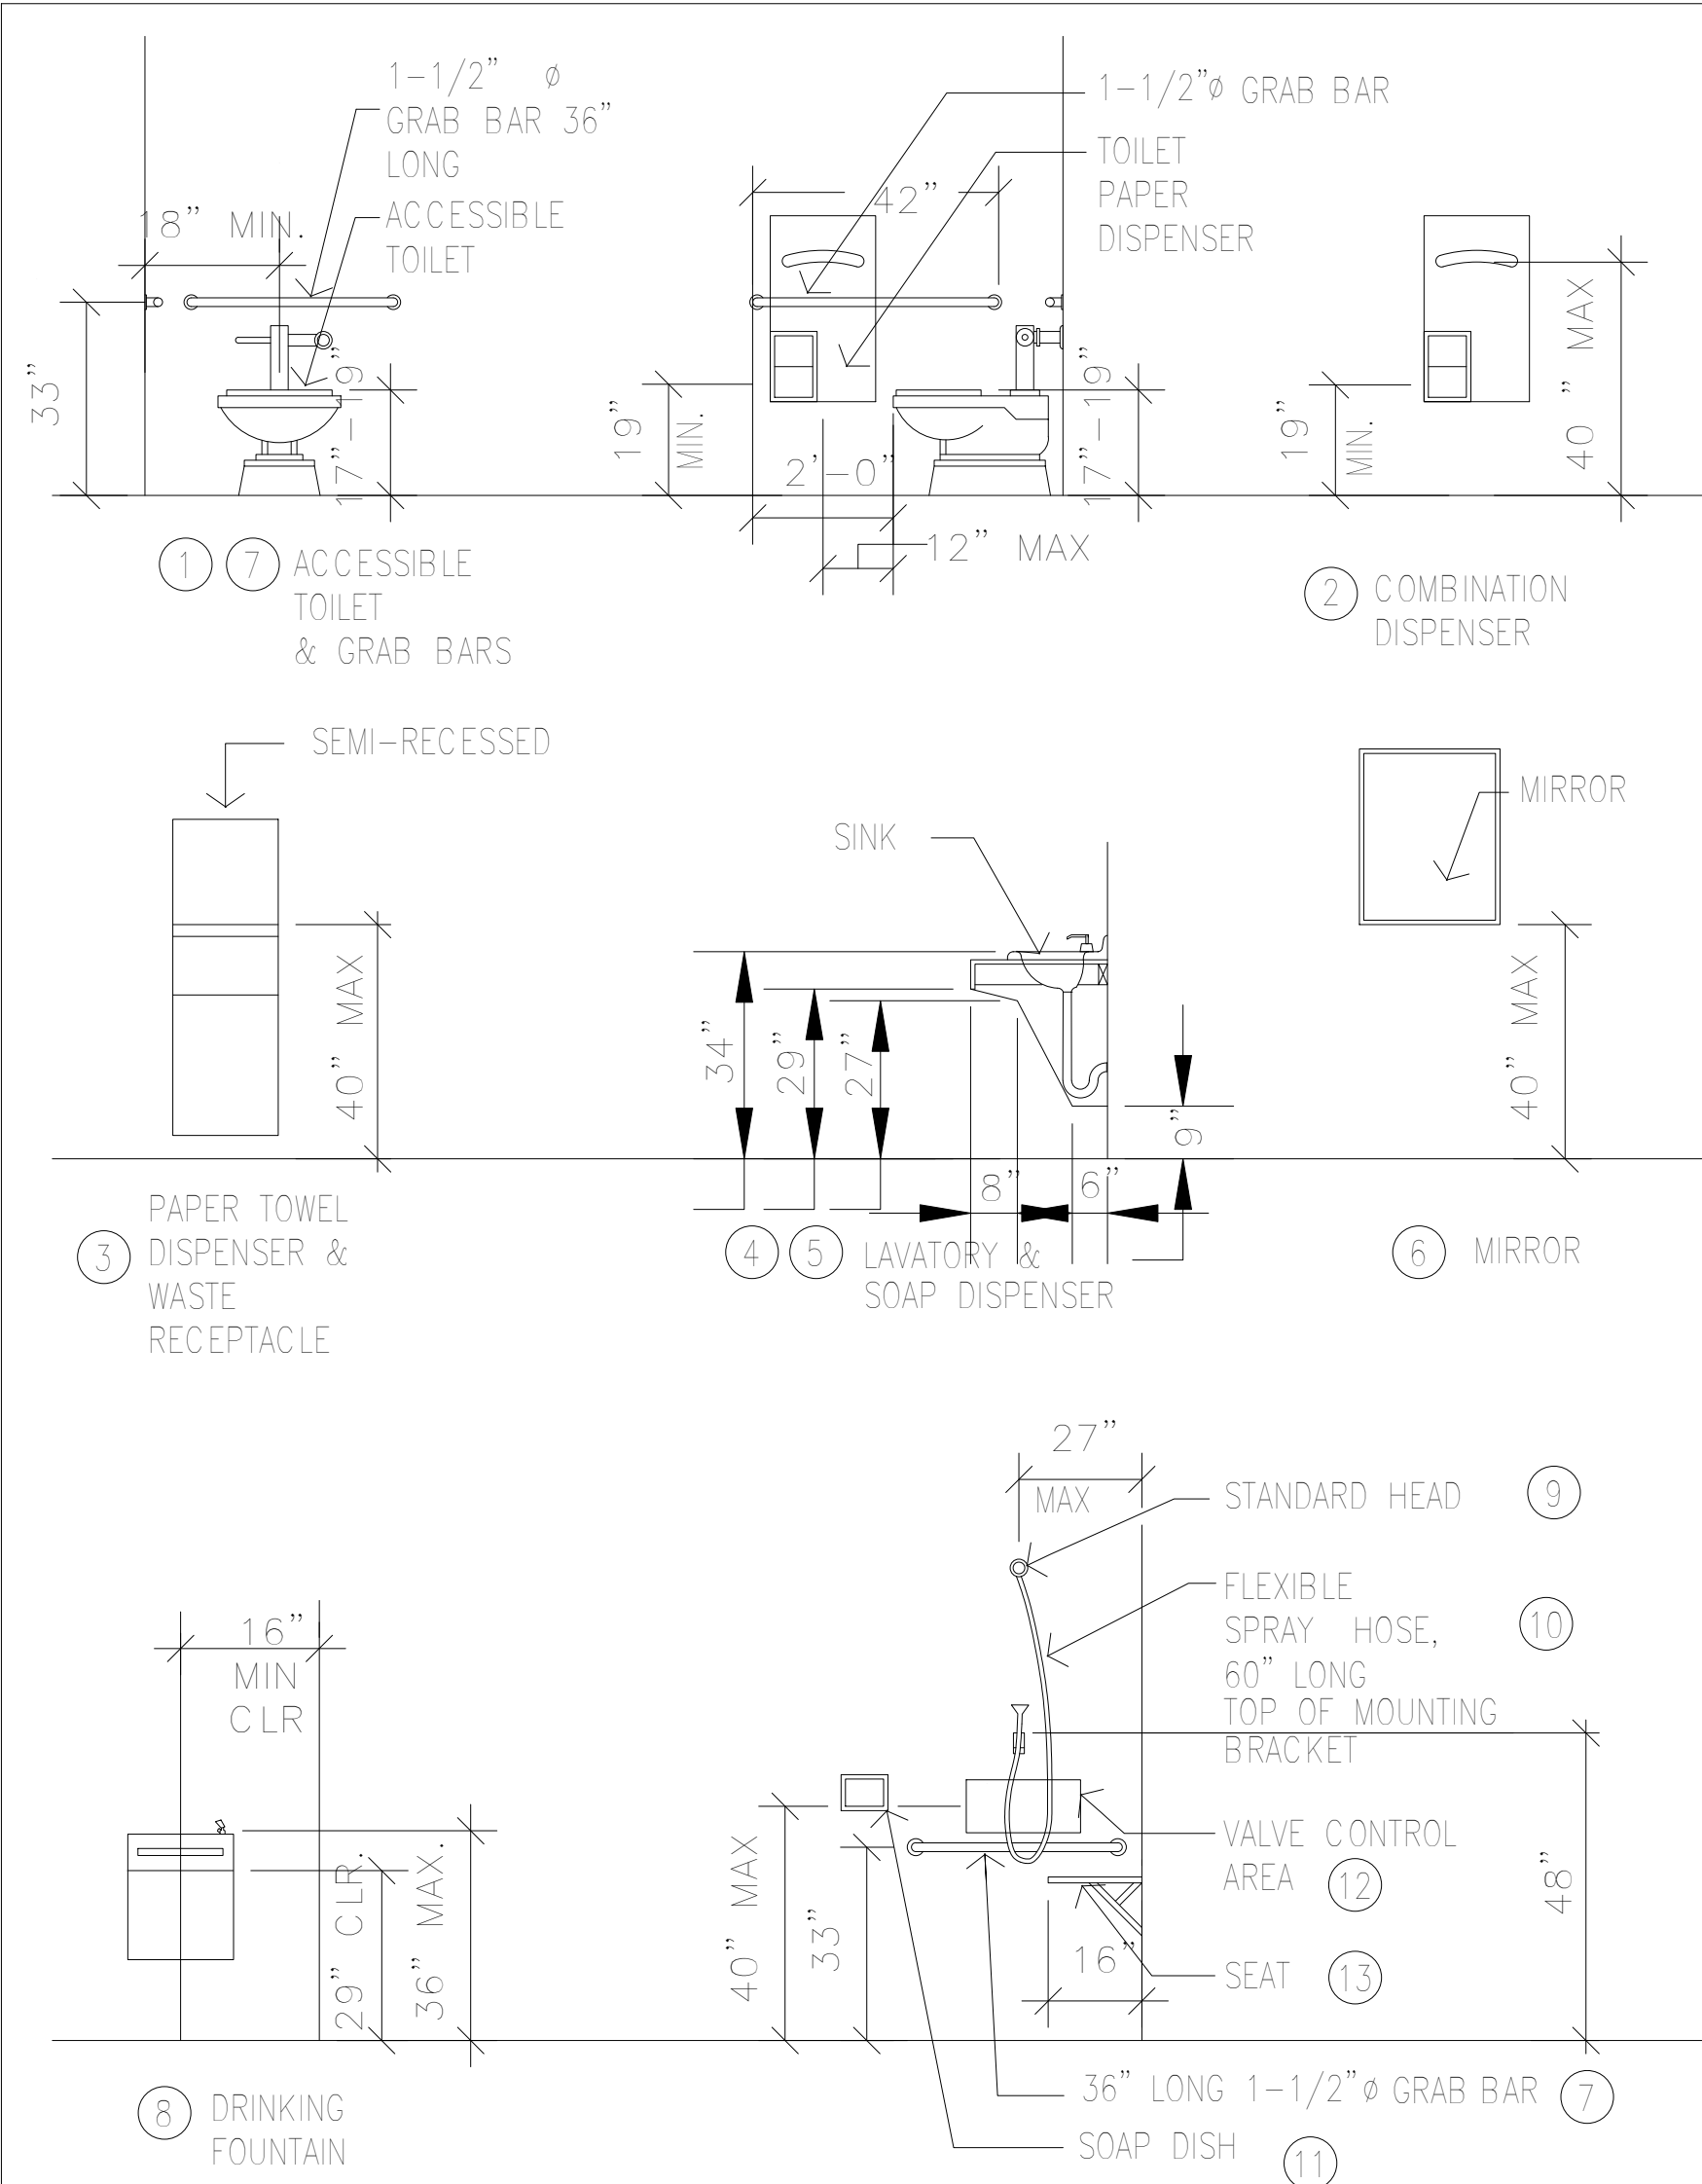


- |  |  |
|--|--|
| ① ACCESSIBLE TOILET  | ⑥ DRINKING FOUNTAIN  |
| ② SEMI-RECESSED TOILET PAPER, TOILET SEAT COVER DISPENSER – BOBRICK # B-3471 | ⑨ STANDARD SHOWER HEAD   |
| ③ WALL MOUNTED PAPER TOWEL DISPENSER AND WASTE RECEPTACLE                    | ⑩ FLEXIBLE SPRAY HOSE, 60" LONG  |
| ④ LAVATORY WITH ACCESSIBLE LEVERS  | ⑪ WALL MOUNTED SOAP DISH   |
| ⑤ COUNTER TOP MOUNTED SOAP DISPENSER   | ⑫ HANDICAP SHOWER CONTROLS TO BE SINGLE LEVER WITH A MAXIMUM FORCE OF 5 LBS TO OPERATE |
| ⑥ FLOAT PLATE GLASS MIRROR   | ⑬ 16" X 36" FOLDING SEAT   |
| ⑦ 1-1/2" ø GRAB BAR  |  |

## MOUNTING HEIGHTS

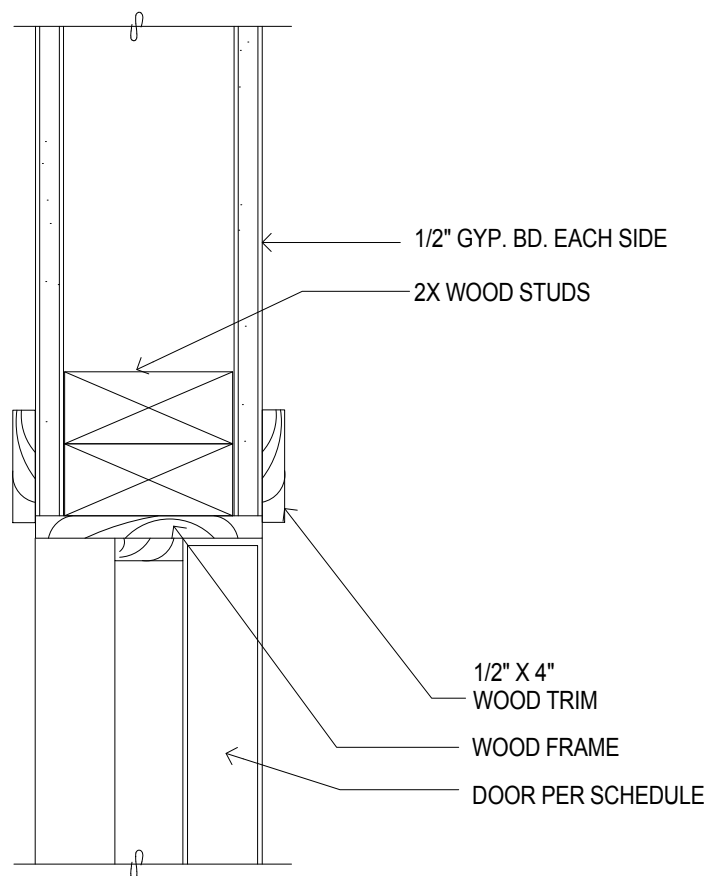


HEAD@INTERIOR DOOR

SCALE: 3"=1'-0"

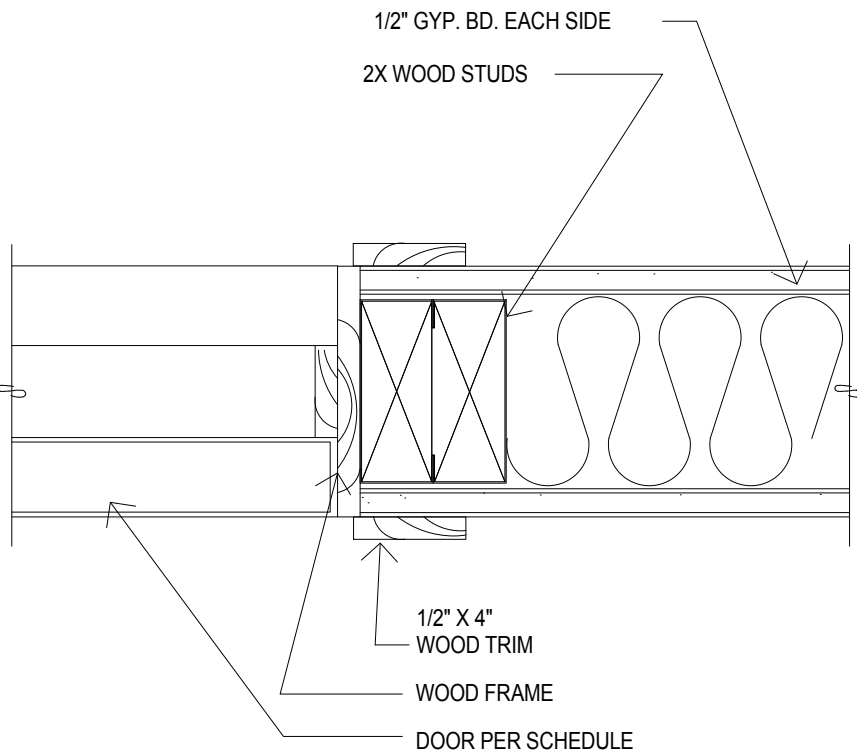


JAMB@INTERIOR DOOR

SCALE: 3"=1'-0"

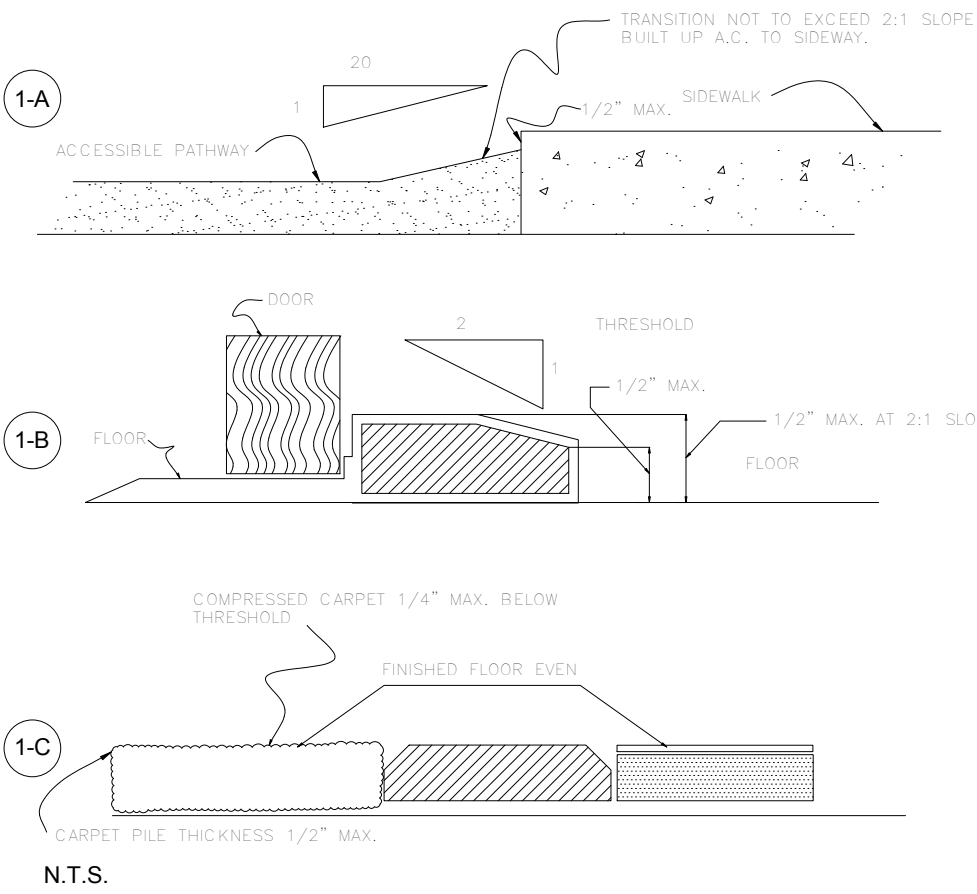


THRESHOLD DETAIL

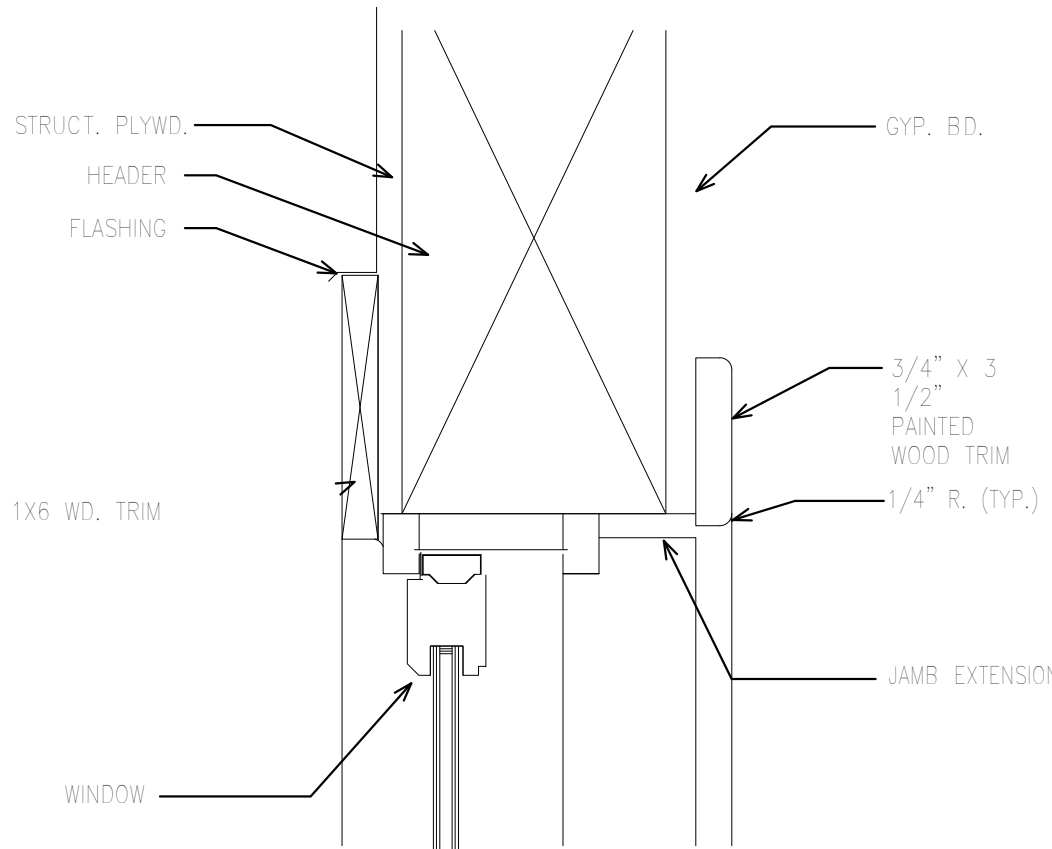


WINDOW HEAD DETAIL

SCALE: 3"=1'-0"

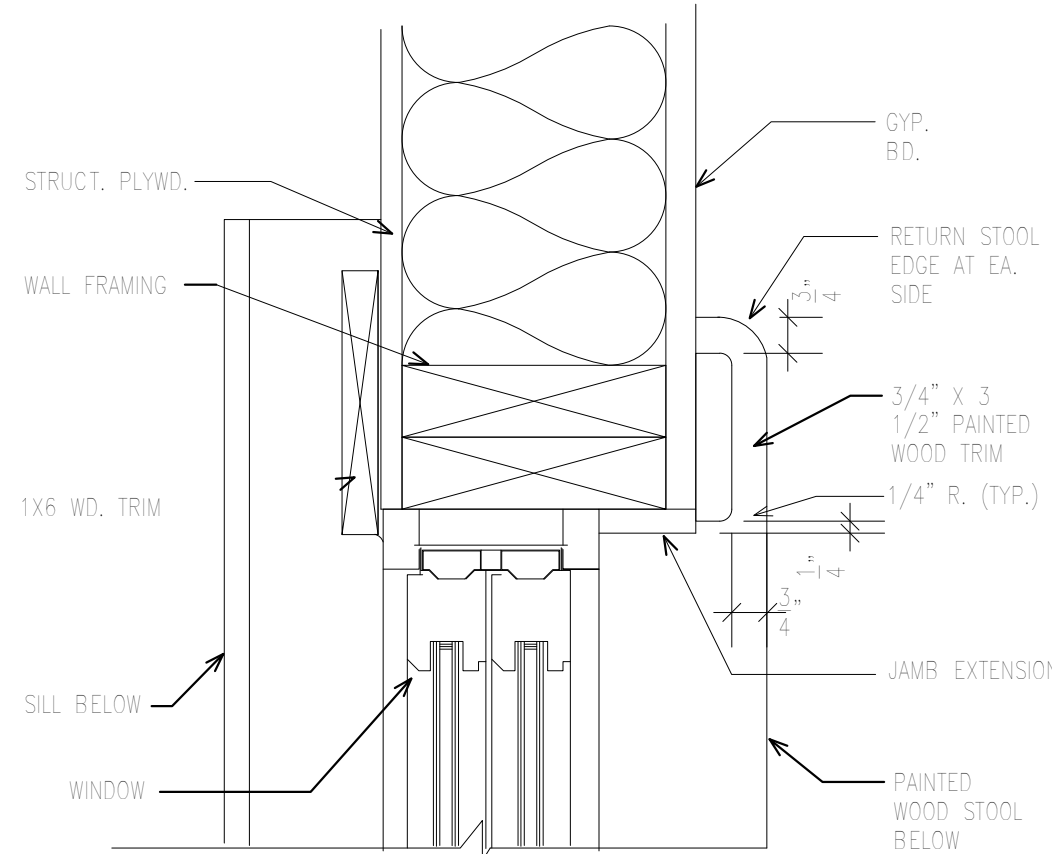

WINDOW JAMB DETAIL

SCALE: 3"=1'-0"

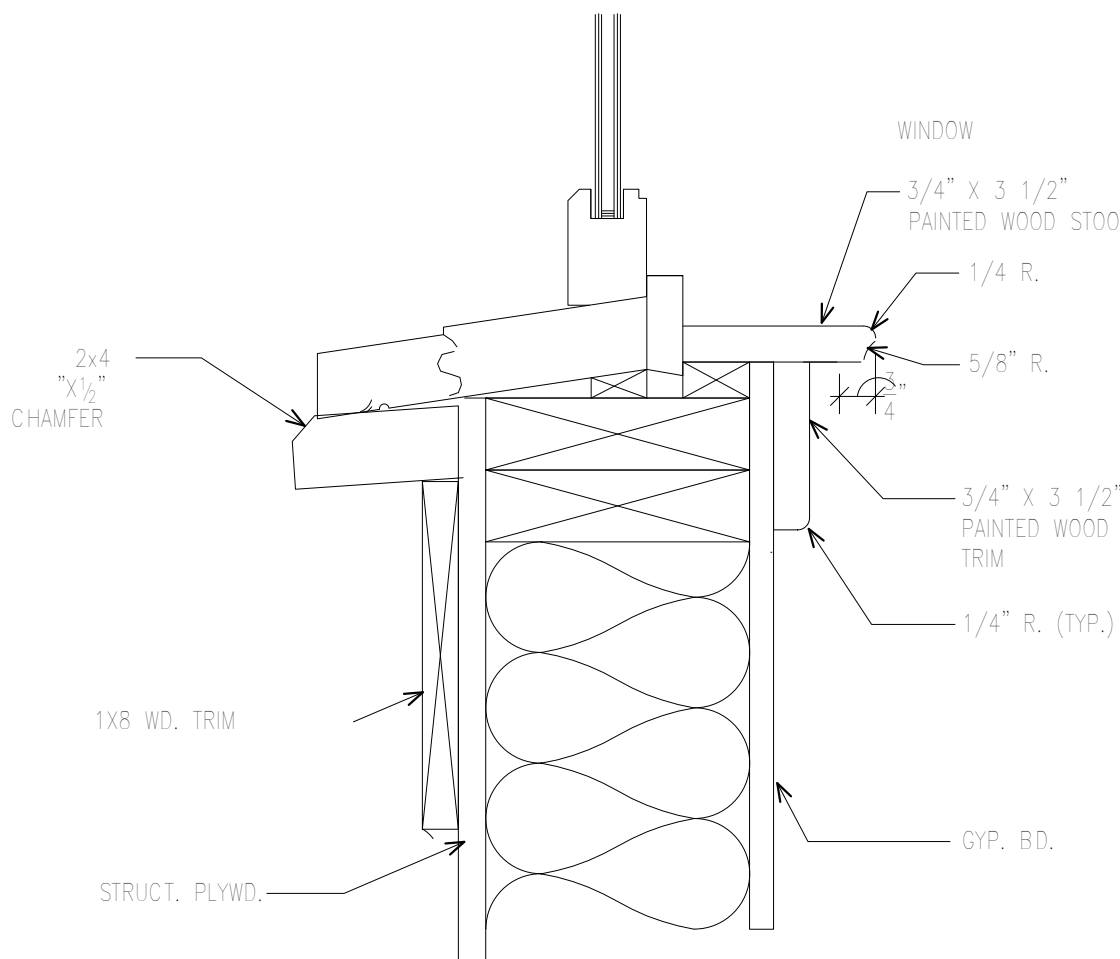

WINDOW SILL

SCALE: 3"=1'-0"

Door Schedule					
Door Number	Door Type	Door Size	Description	Finish	
				Frame	Comments
1	34	36" x 80"	EXTERIOR	1 3/4"	
2	23	36" x 80"	INTERIOR	1 3/8"	
3	23	36" x 80"	INTERIOR	1 3/8"	
6	3	72" x 80"	SLIDING CLOSET	1 3/8"	
7	3	72" x 80"	SLIDING CLOSET	1 3/8"	
8	23	36" x 80"	INTERIOR	1 3/8"	
9	23	36" x 80"	INTERIOR	1 3/8"	
10	23	36" x 80"	INTERIOR	1 3/8"	
11	62	72" x 82"	SLIDING GLASS	1 3/4"	
12	23	36" x 80"	INTERIOR	1 3/8"	
13	39	24" x 80"	INTERIOR	1 3/8"	
14	39	24" x 80"	INTERIOR	1 3/8"	
15	22	30" x 80"	EXTERIOR	1 3/4"	

Window Schedule							
Type Mark	Rough Opening		Type	Material	Glazing	Head Height	Comments
	Width	Height			Type		
B	4' - 0"	4' - 0"	Slider with Trim	VINYL		6' - 8"	
C	3' - 0"	2' - 0"	Slider with Trim	VINYL		6' - 8"	
D	4' - 0"	3' - 0"	Slider with Trim	VINYL		6' - 8"	
G	5' - 0"	3' - 0"	Slider with Trim	VINYL		6' - 8"	
H	1' - 4"	4' - 0"	Fixed with Trim	VINYL		6' - 8"	

Lighting Fixture Schedule					
Type Mark	Family and Type		Manufacturer	Model	Type Comments
	Ceiling Light - Flat Round: 60W - 120V				A-19
	Outdoor Wall Sconce Wall Mount : CB3325-2N75(120V)[BC BL][TC TL]		Visa Lighting Milwaukee WI USA (800-788-VISA)	CB3325	75W MED A19 Incandescent

Room Number	Room Name	Room Finish Schedule				Comments
		Floor	Base	Wall	Ceiling	
1	GREAT ROOM	Vinyl/Laminate	4" MDF Painted	GYP BD	GYP BD ceil. hgt varies	orange peel finish all walls and ceiling
2	BEDROOM 1	Carpet	4" MDF Painted	GYP BD	GYP BD ceil hgt 8'	orange peel finish all walls and ceiling
3	LAUNDRY	Vinyl/Laminate	4" MDF Painted	GYP BD	GYP BD ceil hgt 8'	orange peel finish all walls and ceiling
4	Bath 2	Vinyl/Laminate	4" MDF Painted	GYP BD	GYP BD ceil hgt 8'	orange peel finish all walls and ceiling
5	BATH	Vinyl/Laminate	4" MDF Painted	GYP BD	GYP BD ceil hgt 8'	orange peel finish all walls and ceiling
6	BEDROOM 2	Carpet	4" MDF Painted	GYP BD	GYP BD ceil hgt 8'	orange peel finish all walls and ceiling
7	Linen	Vinyl/Laminate	4" MDF Painted	GYP BD	GYP BD ceil hgt 8'	orange peel finish all walls and ceiling

JMB  
ARCHITECTURE  
ARCHITECTURE  
PLANNING

4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: jmbarchitect@snowcrest.net



67 Walnut Way PO BOX 1567  
WILLOW CREEK, CA 95573  
707.629.3000 fax 707.629.3011  
email: tvce@tvce.biz


Electrical Consultant Pace Engineering  
Address 1730 South Street  
Redding, CA 96001  
Phone 530 244-0202  
Fax 530 244  
e-mail

Bldg. Energy Consultant Abby Technical Services  
Address Anny McQuerry  
1125 16th Street, Ste. 216  
Arcata, CA 95521  
Phone 707.826.1433  
Fax 707-826-1430  
e-mail annymc@abbaytechnicalservices.com

KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House

No.	Description	Date

Schedules	
Project number	ktha 2015
Date	07/05/2015
Drawn by	RKH
Checked by	JMB
A8	
Scale	

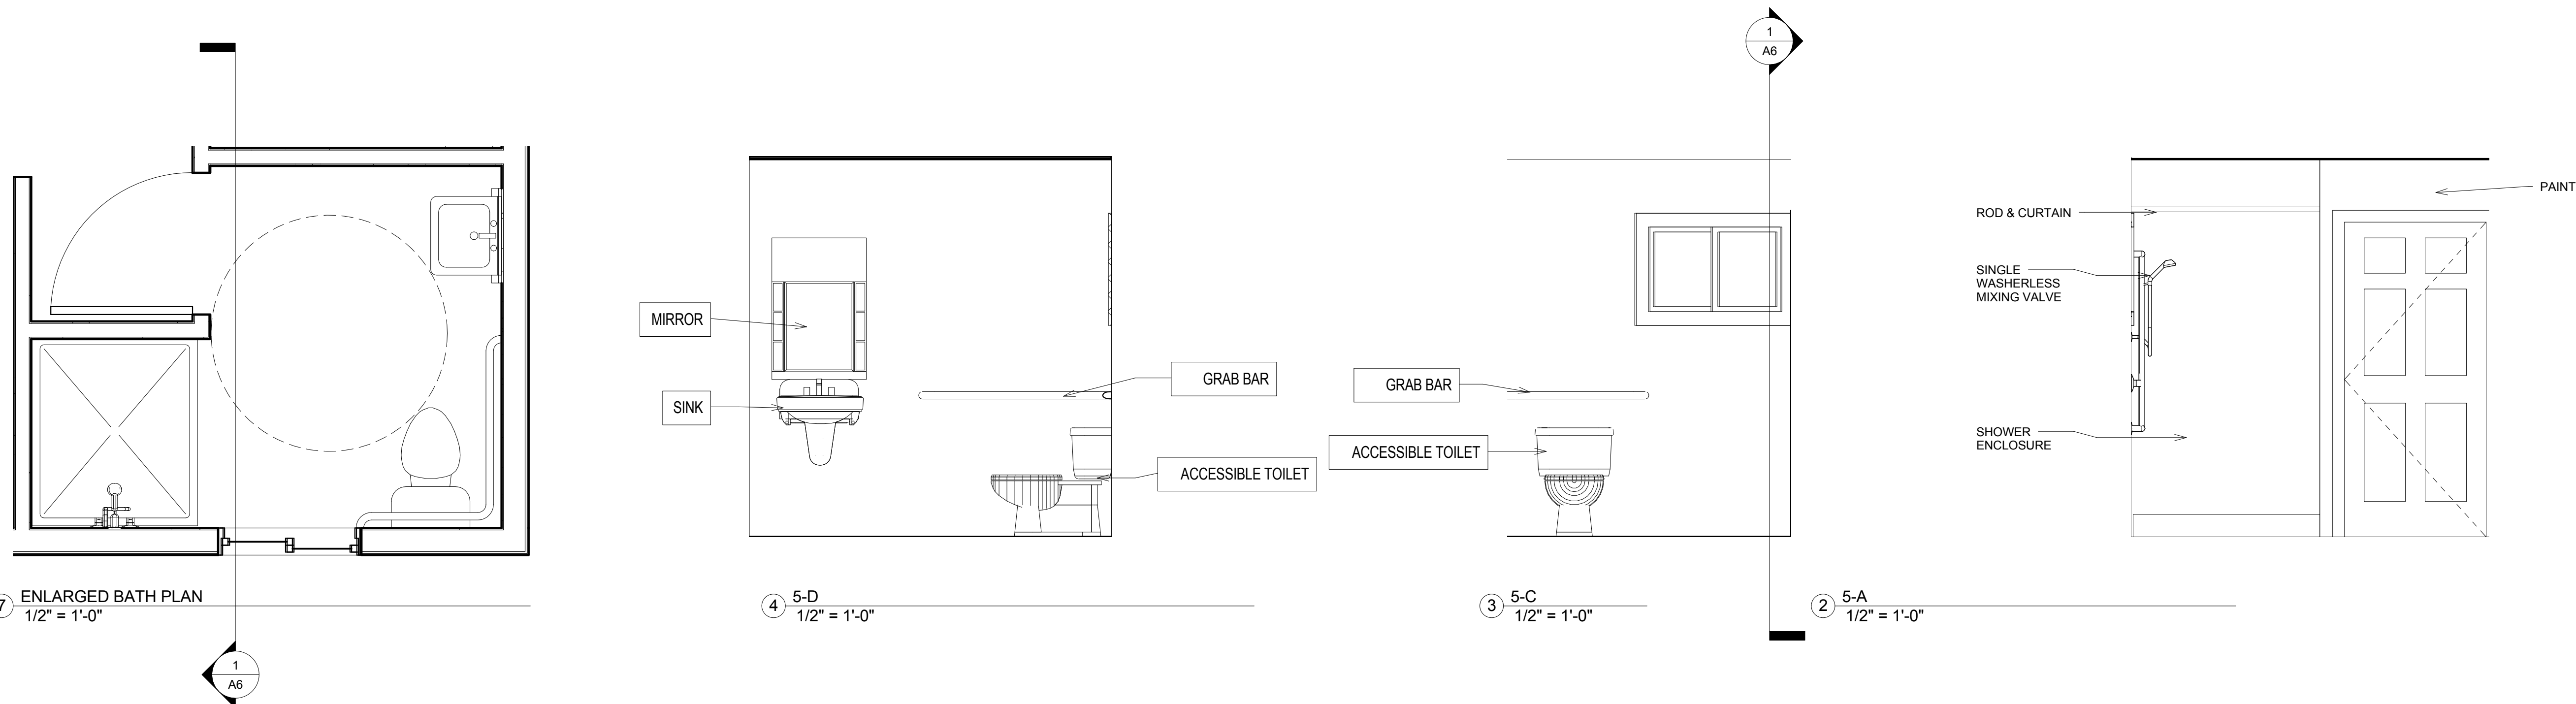


7 ENLARGED BATH PLAN  
1/2" = 1'-0"


4 5-D  
1/2" = 1'-0"

3 5-C  
1/2" = 1'-0"


2 5-A  
1/2" = 1'-0"

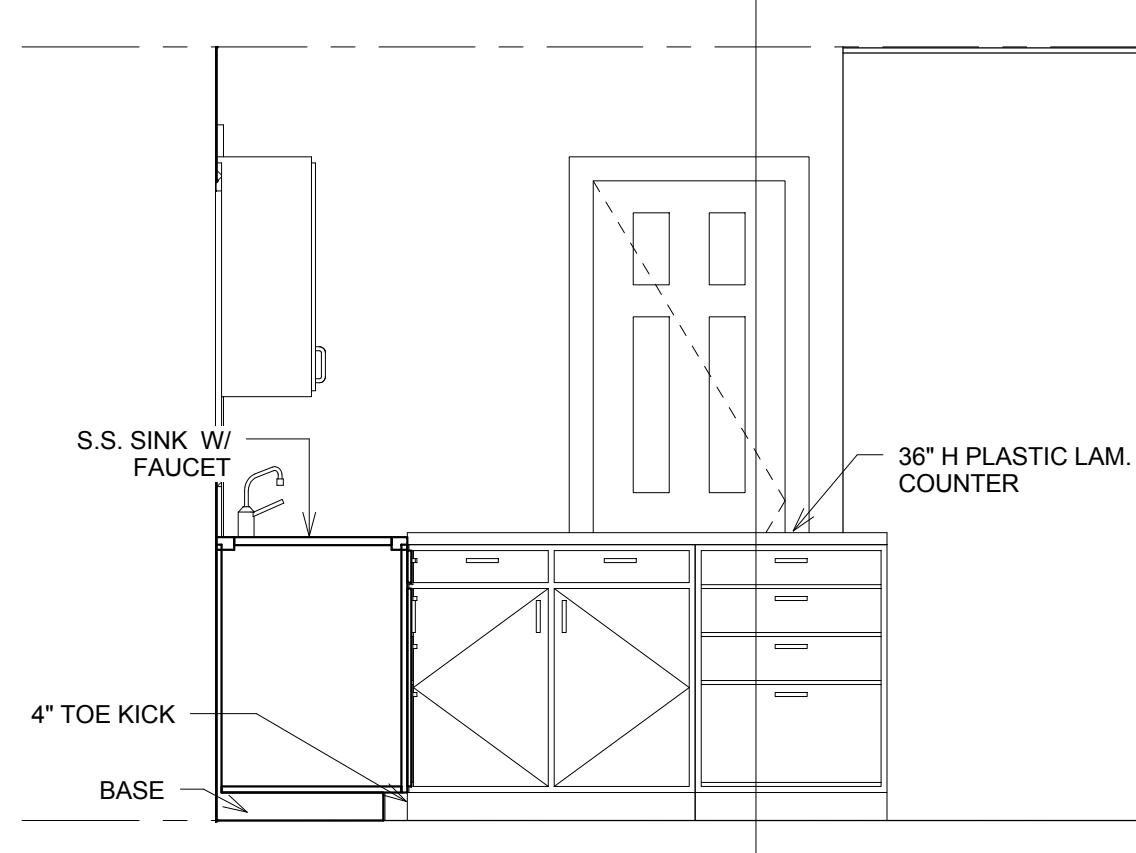


6 Elevation 1 - d  
1/2" = 1'-0"

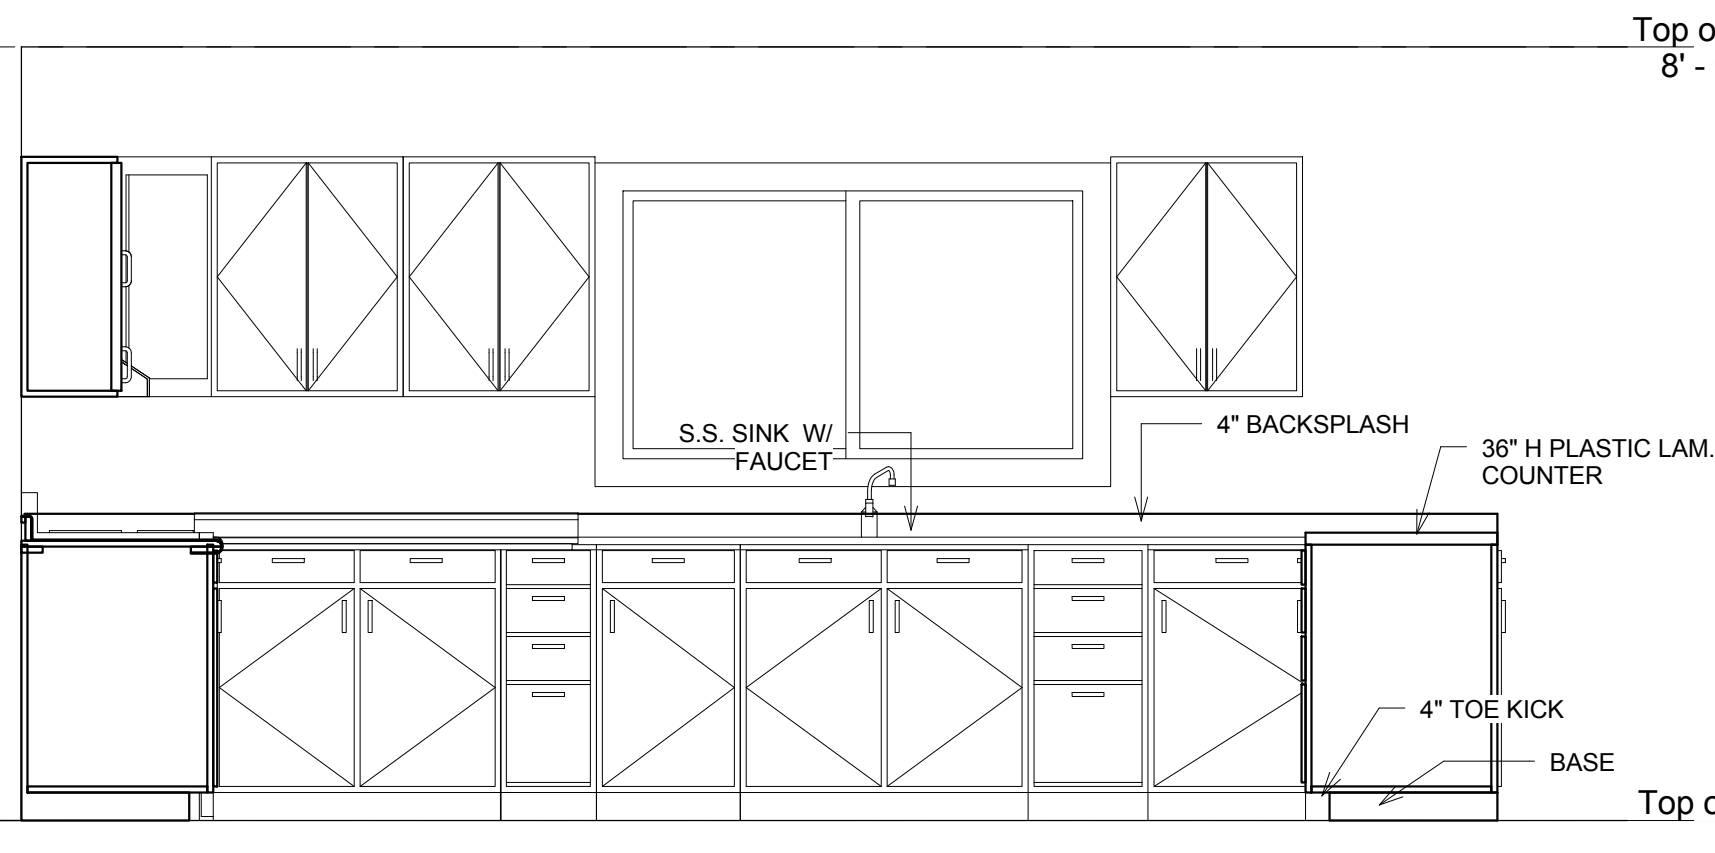


5 Elevation 1 - b  
1/2" = 1'-0"

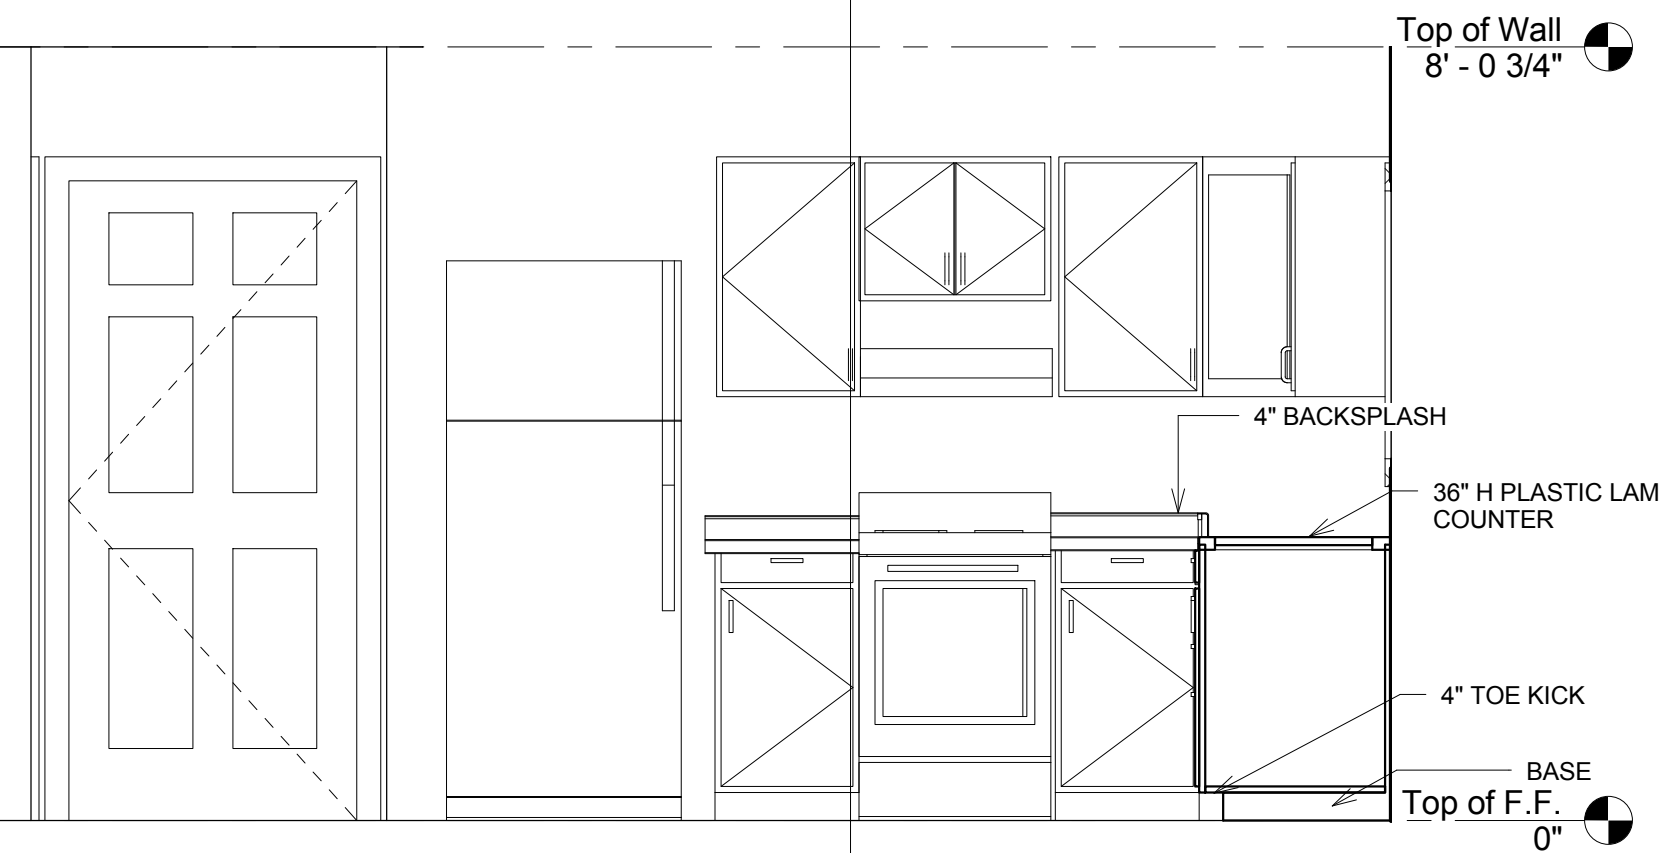

1 Elevation 1 - a  
1/2" = 1'-0"

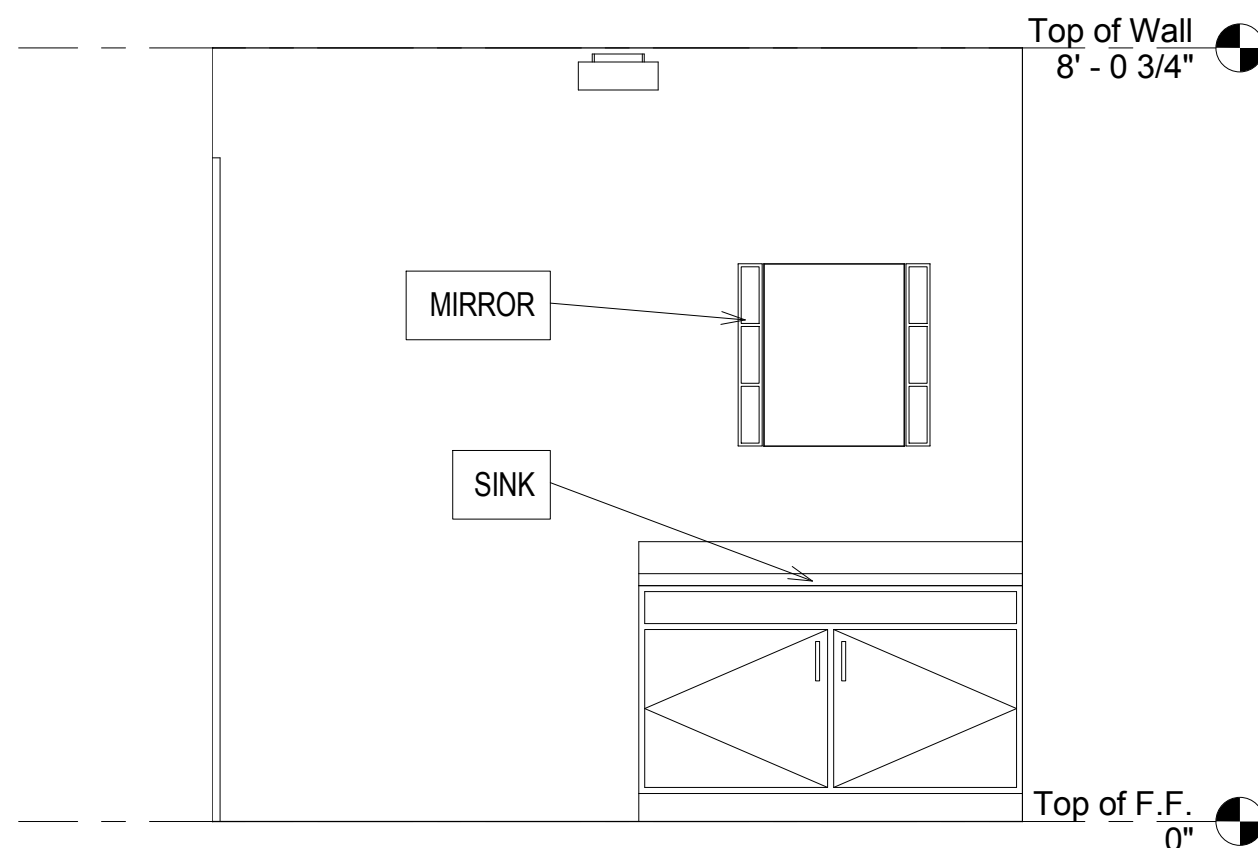


9 Elevation 2 - d  
1/2" = 1'-0"

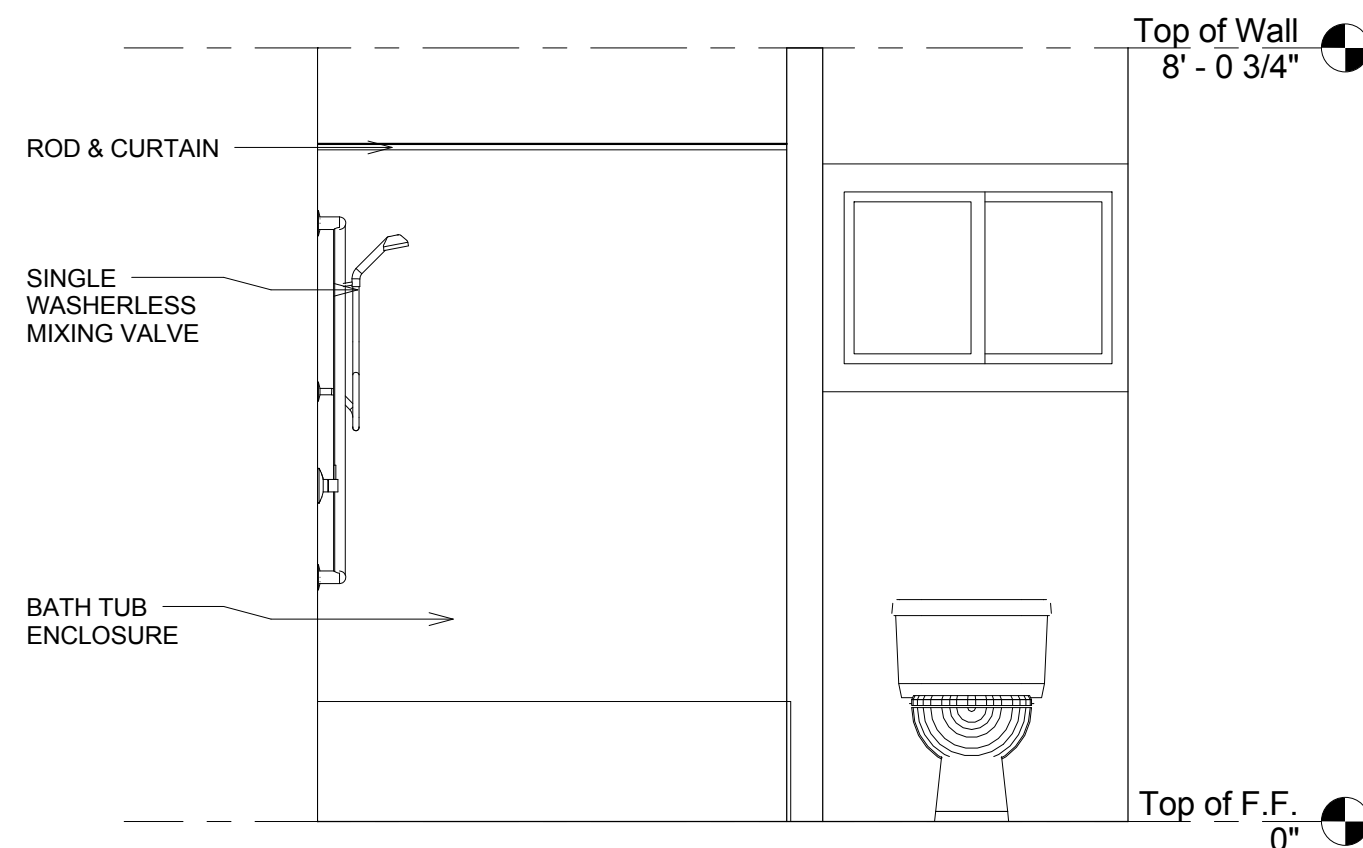

8 Elevation 2 - a  
1/2" = 1'-0"

JMB  
ARCHITECTURE  
ARCHITECTURE  
PLANNING

4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: jmbarchitect@snowcrest.net

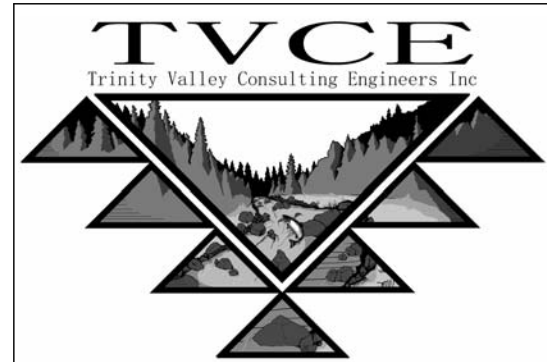

67 Walnut Way PO BOX 1567  
WILLOW CREEK, CA 95573  
707.629.3000 fax 707.629.3011  
email: tvce@tvce.biz

Electrical Consultant Pace Engineering  
Address 1730 South Street  
Redding, CA 96001  
Phone 530 244-0202  
Fax 530 244  
e-mail

Bldg. Energy Consultant Abbey Technical Services  
Address Anny McQuerry  
1125 16th Street, Ste. 216  
Arcata, CA 95521  
Phone 707.826.1433  
Fax 707-826-1430  
e-mail anny@abbaytechnicalservices.com

KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House

No.	Description	Date

Interior Elevations


Project number ktha 2015  
Date 07/05/2015  
Drawn by RKH  
Checked by JMB

A9

Scale 1/2" = 1'-0"



4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: [jmbarchitect@snowcrest.net](mailto:jmbarchitect@snowcrest.net)

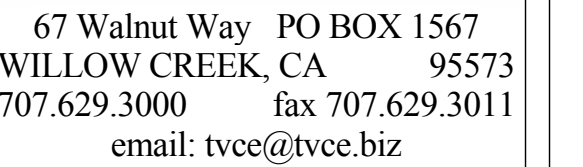

Address 1730 South Street  
Redding, CA  
96001  
Phone 530 244-0202  
Fax 530 244  
e-mail



Bldg. Energy Consultant Address	Abbey Technical Services Anny McQuenny 1125 16th Street, Ste. 216 Arcata, CA 95521
Phone	707.826.1433
Fax	707-826-1430
e-mail	anny@ abbaytechnicalservices.com

## Two Bedroom House

## Plumbing Plan

Checked by	JMB	PM


Scale	1/4" = 1'-0"
-------	--------------



Pressure Range—40 to 46 psi										
METER AND SERVICE PIPE (inches)	DISTRIBUTION PIPE (inches)		MAXIMUM DEVELOPMENT LENGTH (feet)							
	40	46	60	80	100	120	140	160	180	200
1/2	3	2.5	2	1.5	1.5	1.5	1.5	1.5	1.5	1.5
3/4	9.5	9.5	8.5	7	5.5	4.5	3.5	3	2.5	2
1	32	32	32	26	18	13.5	10.5	9	7.5	6
1 1/4	32	33	33	32	21	15	11.5	9.5	7.5	6.5
1 1/2	32	32	32	32	32	32	32	27	21	16.5
1 3/4	80	80	80	80	65	52	42	35	26	20
2	80	80	80	75	50	40	30	28	20	15
2 1/2	87	87	87	87	87	87	87	78	65	55
3	151	151	151	151	151	131	109	93	75	63


a. The fixture-unit value 2.5 assumes a flow demand of 2.5 gpm, such as for an individual low-sprinkler device. If a hose bibb/direct cock will be required to furnish a greater flow rate, the equivalent fixture-unit value may be obtained from Table P2903.6 or Table P2903.7.

NOTES  
SEE ATTACHED SHEET P2 FOR PLUMBING NOTES AND DETAILS  
ALL PLUMBING MATERIALS AND INSTALLATIONS TO BE DONE PER NATIONAL, STATE AND LOCAL CODES  
USE REMOVABLE TRAPS UNDER ALL SINKS TO PROVIDE CLEANOUT ACCESS  
A TEMPERATURE-LIMITING DEVICE CONFORMING TO ASSE 1070 IS REQUIRED AT WHIRLPOOL TUBS AND BATH TUBS TO LIMIT WATER TEMPERATURE TO 120 DEGREES F

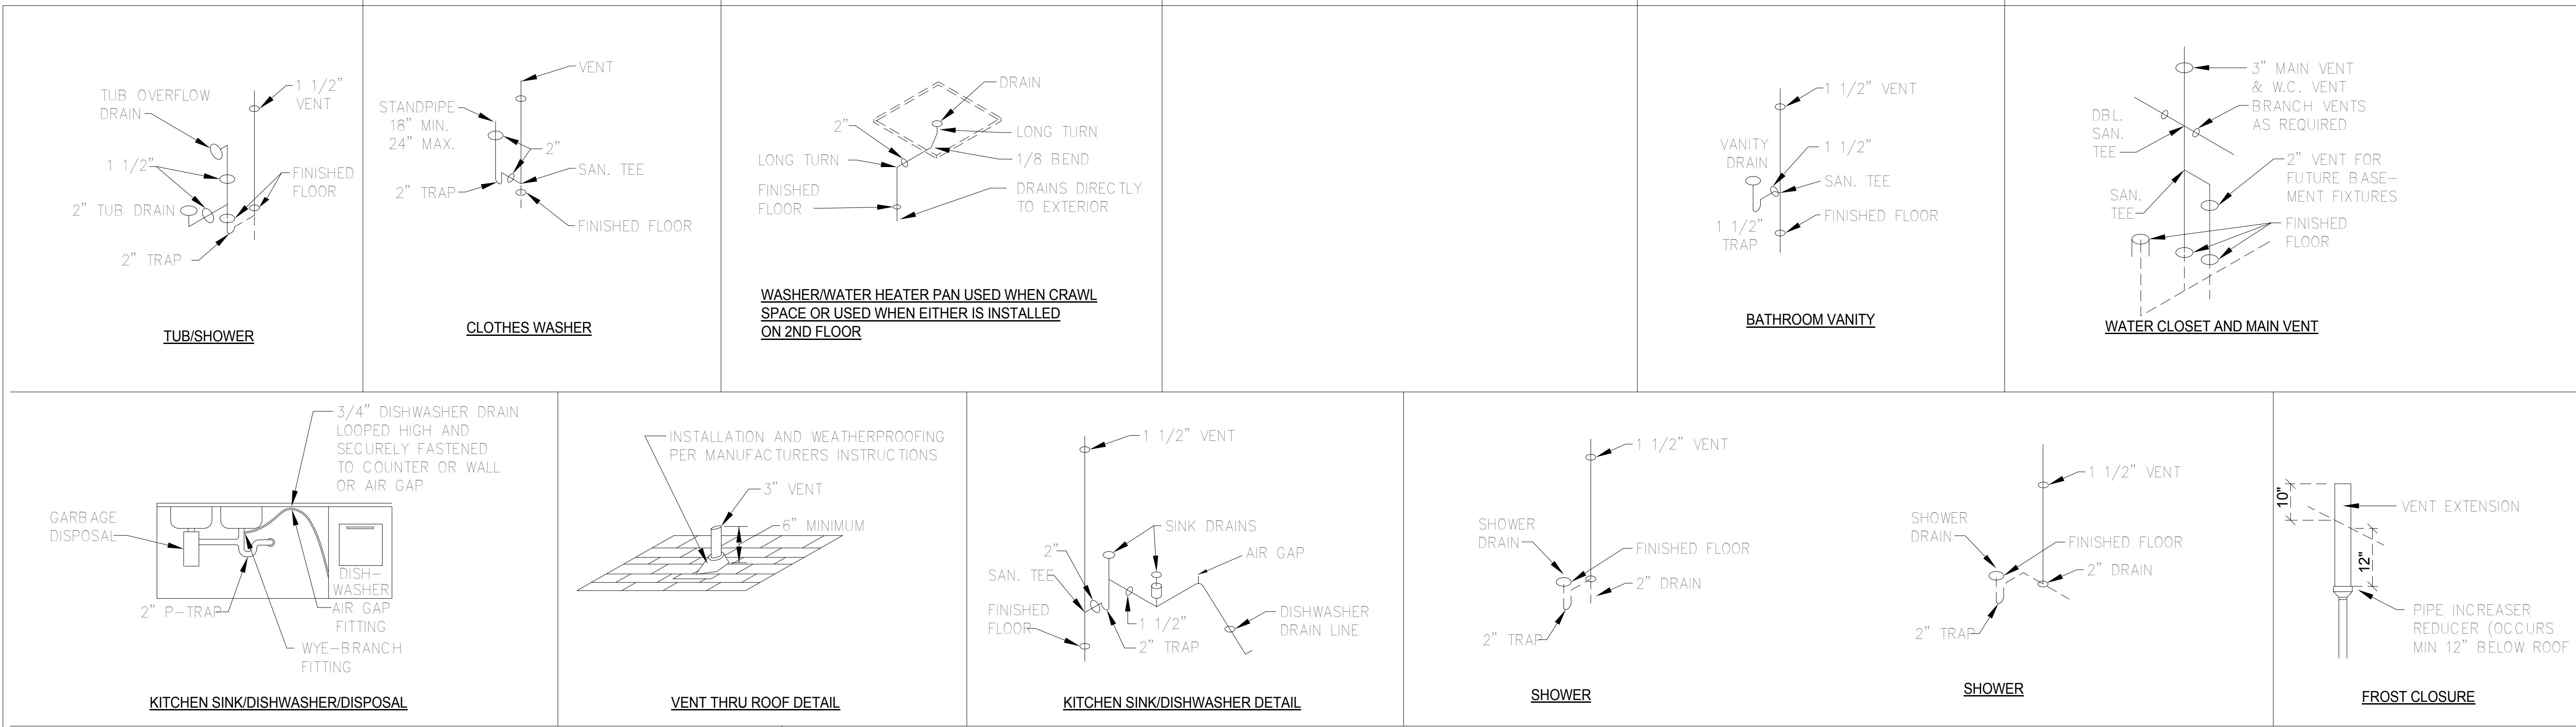

DWV NOTES:

- ALL WASTE AND VENT LINES ARE TO BE ABS OR PVC PIPE PROVIDED DWELLING DOES NOT EXCEED TWO STORIES IN HEIGHT. SUPPLY LINES ARE TO BE COPPER.
- PITCH ON HORIZONTAL WASTE LINES SHALL BE 1/4", IF A SPECIAL CONSTRUCTION CONDITION EXISTS, LOCAL AUTHORITIES MAY GIVE APPROVAL FOR 1/8" SLOPE ON PIPE DIAMETERS OF 4" OR GREATER.
- WASTE LINES: INSTALL WYE W/ CLEANOUT PRIOR TO EXITING WALL FOR CONNECTION TO DISPOSAL SYSTEM.
- PVC-DWV PIPE SUPPORTS: AT BRANCHES, CHANGES IN DIRECTION AND AT THE BASE, EACH FLOOR AND MID STORY (VERTICAL) MAXIMUM EVERY 3'-0" AT THE END OF BRANCHES, AND CHANGE OF DIRECTION OR ELEVATION. 4" MINIMUM MAIN WASTE TO SEPTIC (BY BUILDER).
- PLASTIC PIPE SHALL NOT PENETRATE FIRE RATED ASSEMBLIES INCLUDING FLOOR/CEILING. PIPING SHALL BE FIRESTOPPED WHERE REQUIRED WITH MATERIAL EQUIVALENT TO CONSTRUCTION WHICH IT PENETRATES & BE SUITABLE TO PIPE MATERIAL OR USE METAL PIPE FROM A MIN. OF ABOVE ASSEMBLY & DOWN.
- EACH DWELLING SHALL HAVE ONE MAIN 3 INCH MIN. STACK FROM BUILDING DRAIN AND AT A MIN. OF 6" ABOVE THE ROOF LINE
- ALL TRAP ARMS MUST BE SUPPORTED WITH 3/4" MINIMUM BEARING.
- ALL PLASTIC PIPE MUST BE SUPPORTED AT INTERVALS IN ACCORDANCE WITH APPLICABLE PLUMBING CODES
- HORIZONTAL TO HORIZONTAL & VERTICAL TO HORIZONTAL DRAIN CHANGES IN DIRECTION SHALL BE 45 DEGREE WYES, LONG SWEEP 90 DEGREE ELBOWS, LONG SWEEP TY'S, 6TH., 8TH. OR 16TH BENDS, APPROVED COMBINATIONS OF THESE OR EQUIVALENT LONG SWEEP FITTINGS. SHORT SWEEPS PERMITTED IN SINGLE BRANCH HORIZONTAL TO VERTICAL CHANGES IN DIRECTION ON 3 INCH OR LARGER.
- TRAPS SHALL BE PLACED AS CLOSE AS POSSIBLE TO FIXTURE OUTLET. MAXIMUM VERTICAL DROP FROM FIXTURE OUTLET TO TRAP WEIR IS 24"
- INACCESSIBLE TRAPS SHALL NOT HAVE UNIONS, CLEANOUTS OR SLIPJOINTS. ACCESSIBLE TRAPS SHALL BE REMOVABLE WITH UNION IN TRAP SEAL OR HAVE CLEANOUT OPENING SAME SIZE AS TRAP.
- ALL HORIZONTAL VENT BRANCH PIPING SHALL BE LOCATED A MINIMUM OF 6" ABOVE THE FLOOD LEVEL OF THE HIGHEST FIXTURE IN THAT BRANCH.
- MAXIMUM DISTANCE OF FIXTURE TRAP WEIR TO VENT SHALL BE IN ACCORDANCE WITH ALL APPLICABLE PLUMBING CODES.
- PLASTIC PIPING SHALL BE PROTECTED WITH 1/16" (15 GAUGE) STEEL PLATE WHEN PIPE PASSES THRU WOOD MEMBERS LESS THAN 1 1/4 INCHES FROM EDGE OF MEMBER. CPC2001 313.9
- FALL IN TRAP NOT ACCEPTABLE IN CPC
- THE VENT PIPE OPENING FROM A SOIL OR WASTE PIPE, EXCEPT FOR WATER CLOSET AND SIMILAR FIXTURES, SHALL NOT BE BELOW THE WEIR OF THE TRAP. CPC2001 1002.4

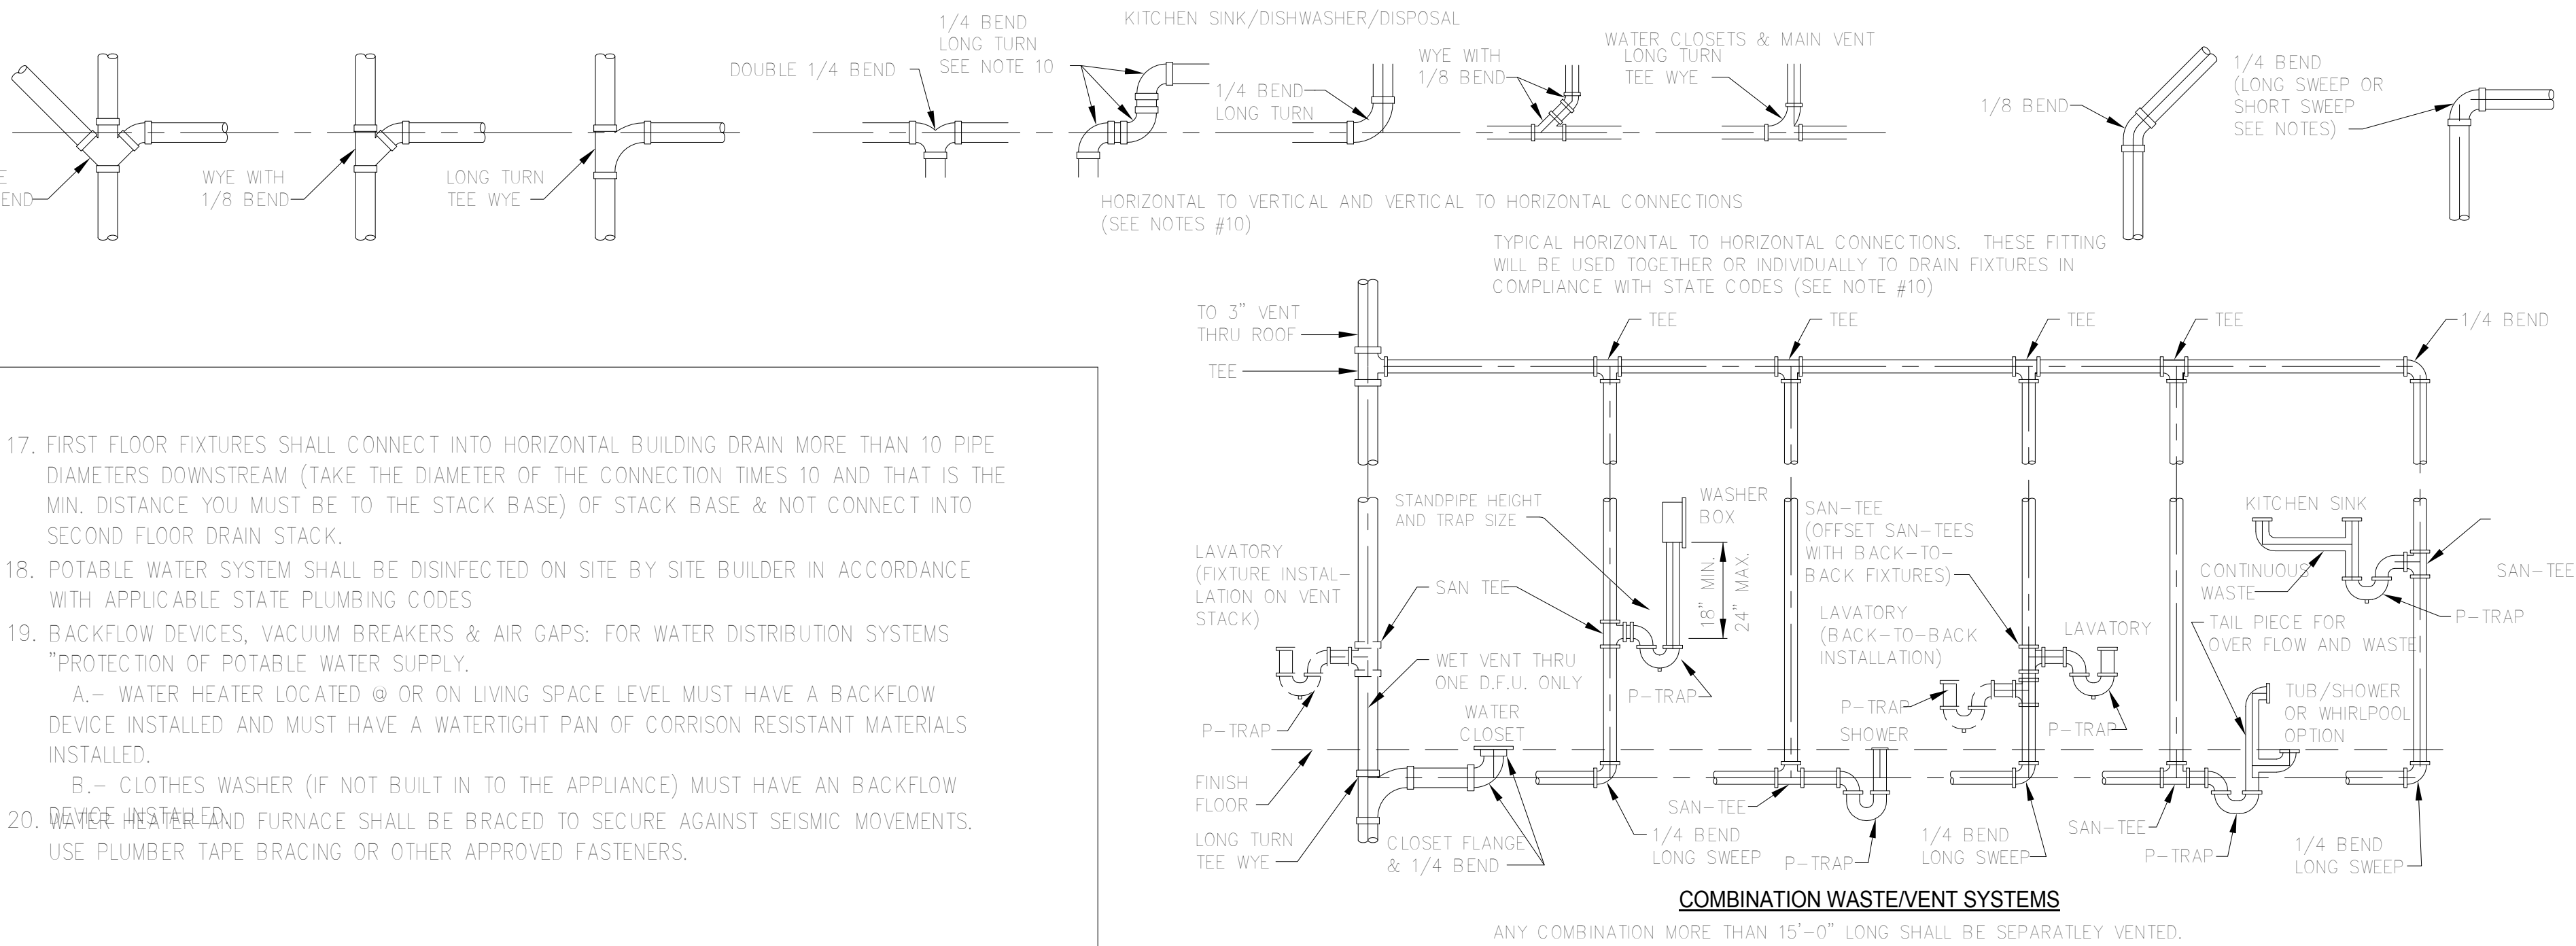

- FIRST FLOOR FIXTURES SHALL CONNECT INTO HORIZONTAL BUILDING DRAIN MORE THAN 10 PIPE DIAMETERS DOWNSTREAM (TAKE THE DIAMETER OF THE CONNECTION TIMES 10 AND THAT IS THE MIN. DISTANCE YOU MUST BE TO THE STACK BASE) OF STACK BASE & NOT CONNECT INTO SECOND FLOOR DRAIN STACK.
- POTABLE WATER SYSTEM SHALL BE DISINFECTED ON SITE BY SITE BUILDER IN ACCORDANCE WITH APPLICABLE STATE PLUMBING CODES
- BACKFLOW DEVICES, VACUUM BREAKERS & AIR GAPS: FOR WATER DISTRIBUTION SYSTEMS "PROTECTION OF POTABLE WATER SUPPLY.  
A.- WATER HEATER LOCATED @ OR ON LIVING SPACE LEVEL MUST HAVE A BACKFLOW DEVICE INSTALLED AND MUST HAVE A WATERTIGHT PAN OF CORRISON RESISTANT MATERIALS INSTALLED.  
B.- CLOTHES WASHER (IF NOT BUILT IN TO THE APPLIANCE) MUST HAVE AN BACKFLOW DEVICE INSTALLED.
- WATER HEATER AND FURNACE SHALL BE BRACED TO SECURE AGAINST SEISMIC MOVEMENTS. USE PLUMBER TAPE BRACING OR OTHER APPROVED FASTENERS.

JMB  
ARCHITECTURE  
ARCHITECTURE  
PLANNING  
4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: jmbarchitect@snowcrest.net

TVCE  
Twin Valley Consulting Engineers Inc.  
67 Walnut Way PO BOX 1567  
WILLOW CREEK, CA 95573  
707.629.3000 fax 707.629.3011  
email: tvce@tvce.biz

Electrical  
Consultant

Pace Engineering  
1730 South Street  
Redding, CA 96001  
530 244-0202  
530 244

Bldg. Energy  
Consultant  
Address

Abbey Technical Services  
Anny McQuerry  
1125 16th Street, Ste. 216  
Arcata, CA 95521  
707.826.1433  
707-826-1430  
anny@abbeytechnicalservices.com


KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House

No.	Description	Date
Plumbing Notes and Details		
Project number	ktha 2015	
Date	07/05/2015	
Drawn by	RKH	
Checked by	JMB	
P2		
Scale	3/8" = 1'-0"	

1 Btm. of Ftg.  
3/8" = 1'-0"

8/8/2015 2:40:15 PM



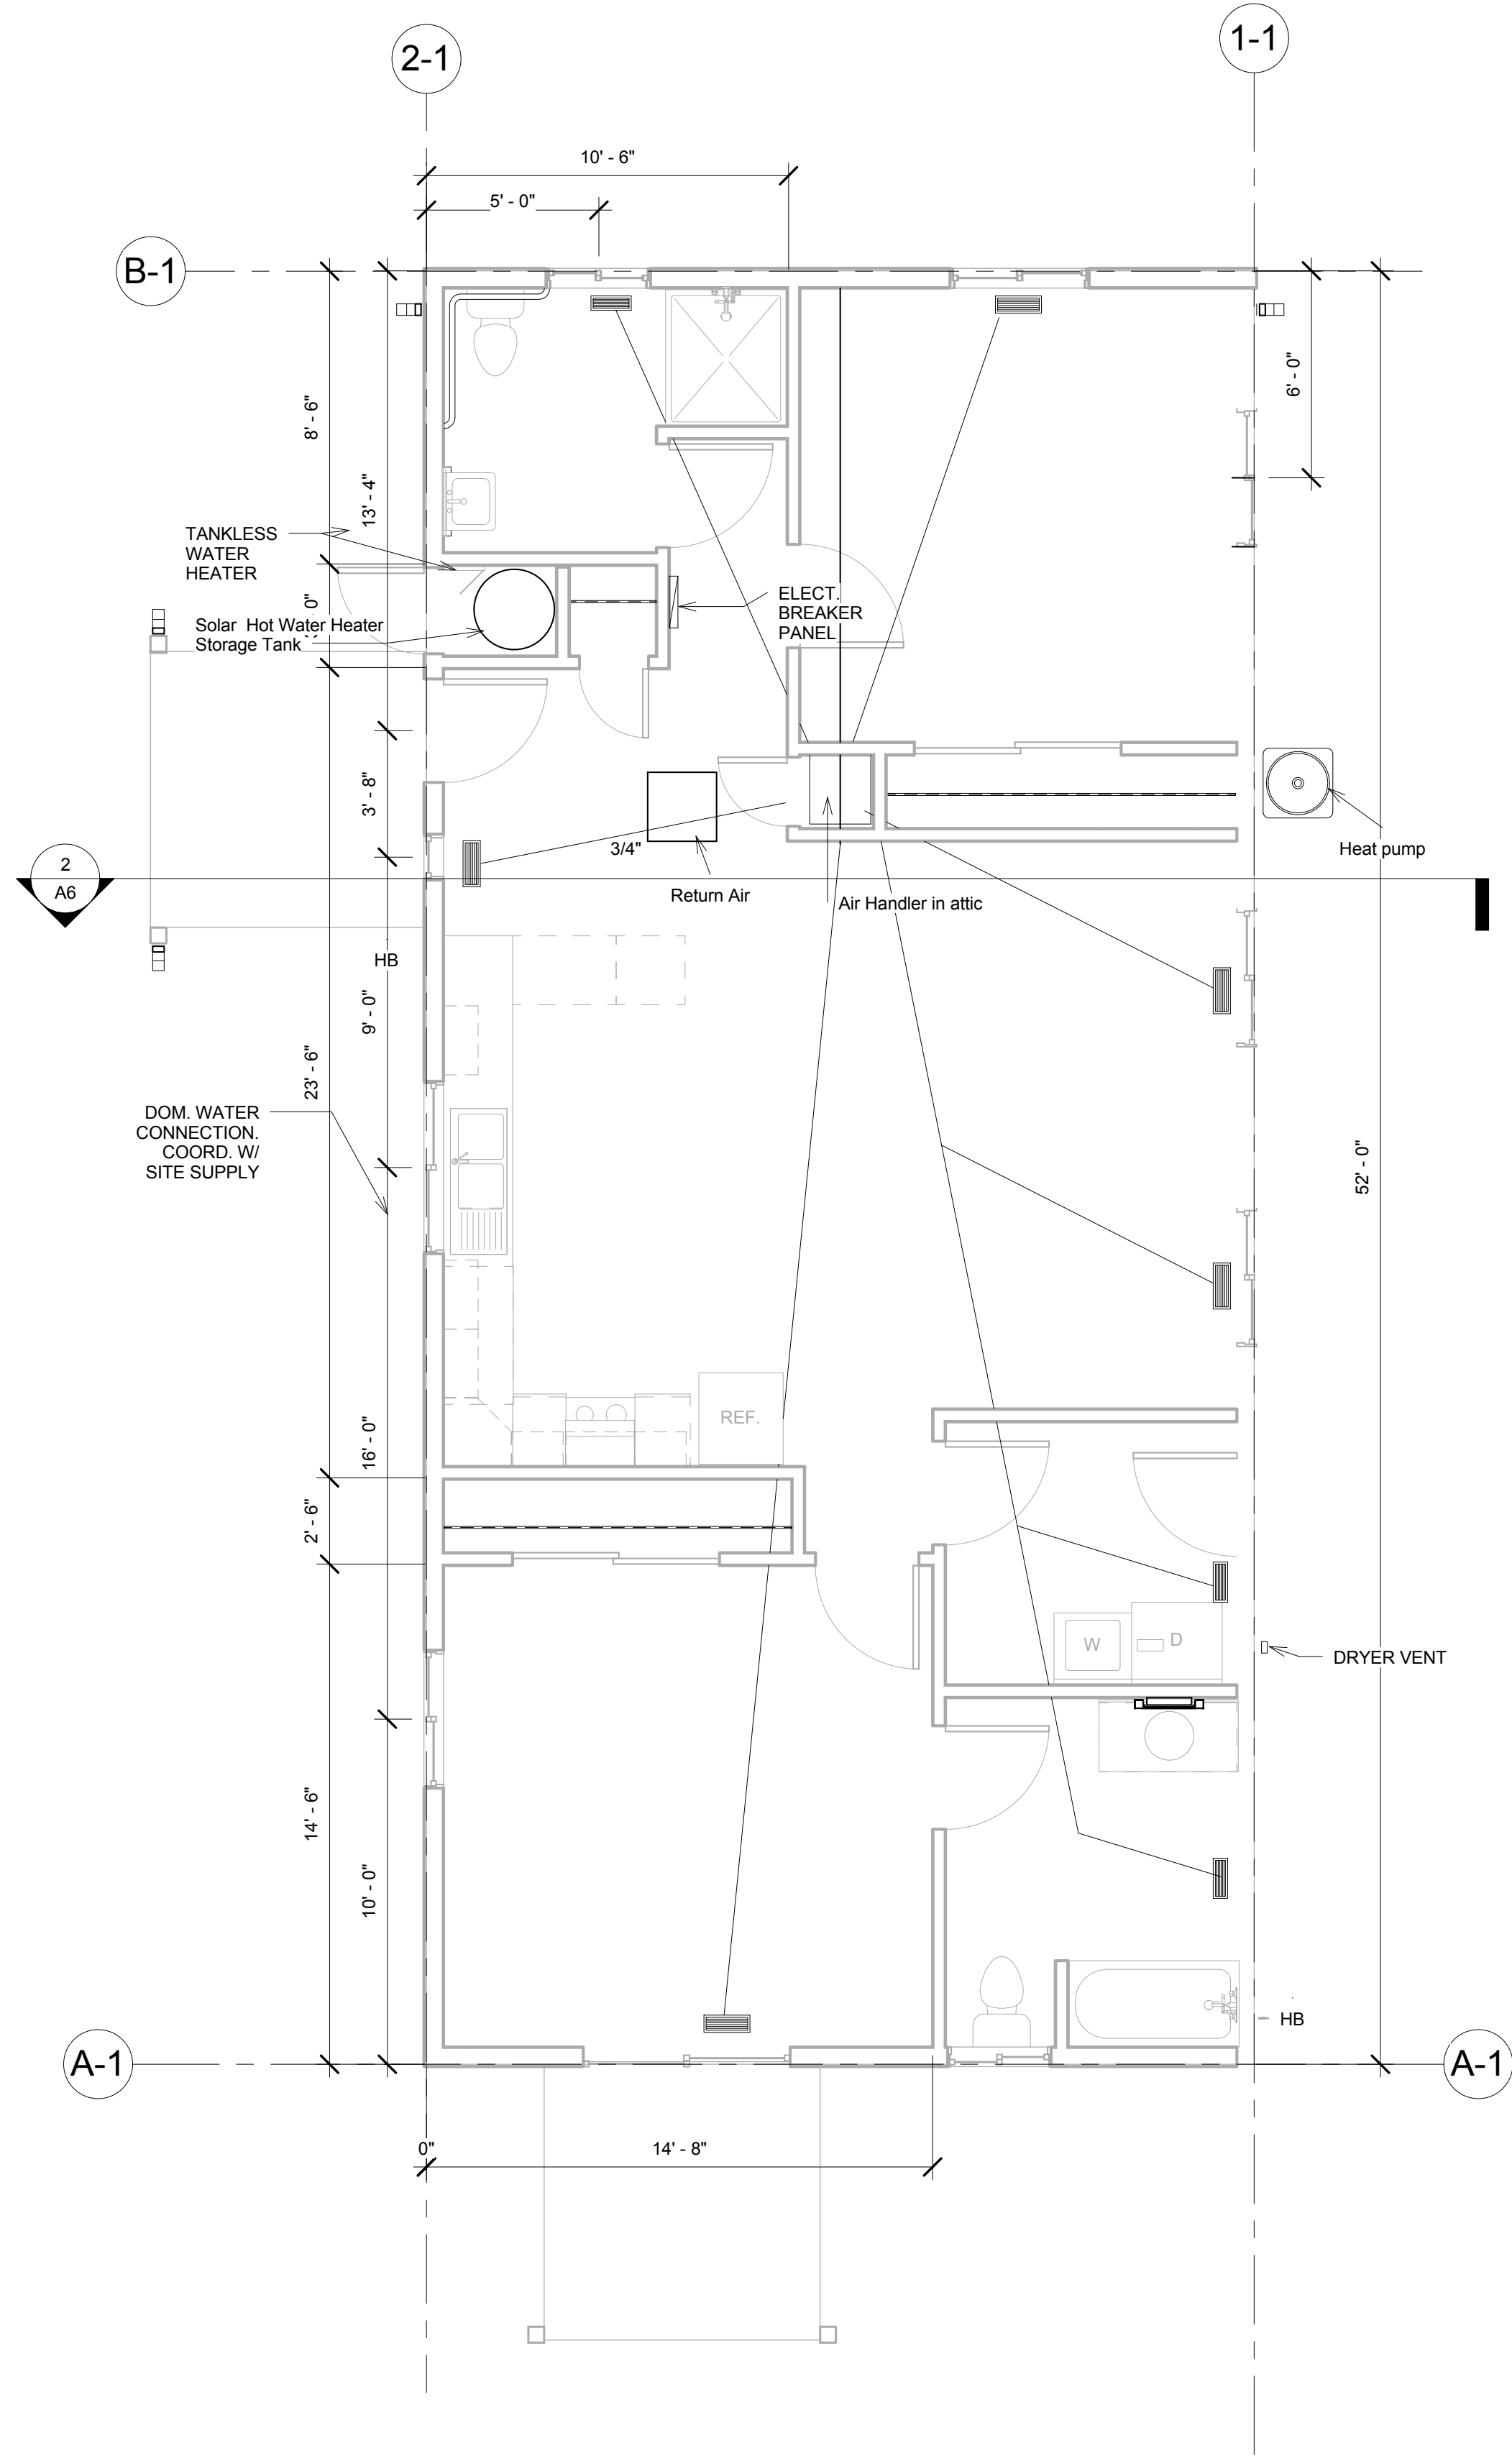

DISCLAIMER:  
HEATING PLANS ARE SHOWN FOR REPRESENTATION ONLY.  
HEATING AND COOLING SYSTEMS WILL BE DESIGNED AND INSTALLED BY THE HEATING SYSTEM SUPPLIER  
AND WILL BE REVIEWED AND APPROVED BY LOCAL JURISDICTIONS HAVING AUTHORITY

- NOTES:
1. UNIT TO BE BRYANT OR EQUAL WITH THE AIR HANDLER IN THE ATTIC AND HEAT PUMP OUTSIDE ON GROUND.
  2. FLEX DUCTING
  3. ALL AIR DISTRIBUTION SYSTEMS, DUCTS, PLENUMS AND OTHER EQUIPMENT SHALL BE DESIGNED AND INSTALLED IN ACCORDANCE WITH CMC AND UL 181 STANDARDS.
  4. BUILDING HEATING AND COOLING LOADS SHALL BE DETERMINED USING THE ASHRAE OR SMACNA STANDARDS.
  5. ALL DUCT SEAL AND INSULATION SHALL MEET THE CENC REQUIREMENTS.
  6. ALL METAL DUCTS FOR STATIC AIR PRESSURE SHALL COMPLY WITH TABLE 6-1 2001 CMC

1 Mechanical Plan  
1/4" = 1'-0"

JMB  
ARCHITECTURE



**ARCHITECTURE  
PLANNING**

4767 HIGHWAY 96 PO BOX 1170  
WILLOW CREEK, CA 95573  
707.629.0010 fax 707.629.2348  
email: jmbarchitect@snowcrest.net



67 Walnut Way PO BOX 1567  
WILLOW CREEK, CA 95573  
707.629.3000 fax 707.629.3011  
email: tvce@tvce.biz

Electrical  
Consultant

Pace Engineering

Address 1730 South Street  
Redding, CA  
96001  
Phone 530 244-0202  
Fax 530 244  
e-mail

Bldg. Energy  
Consultant  
Address  
Phone  
Fax  
e-mail

Abbey Technical Services  
Anny McQuerry  
1125 16th Street, Ste. 216  
Arcata, CA 95521  
707.826.1433  
707-826-1430  
anny@  
abbaytechnicalservices.com

KARUK TRIBE  
HOUSING AUTHORITY  
Two Bedroom House

No.	Description	Date

Mechanical Plan

Project number	ktha 2015
Date	07/05/2015
Drawn by	RKH
Checked by	JMB

M1


Scale	1/4" = 1'-0"
-------	--------------

GENERAL NOTES

- UNLESS OTHERWISE INDICATED, RECEPTACLES AND JUNCTION BOXES SHALL BE CONNECTED TO THE CIRCUIT INDICATED USING 1/2" C-2#12,1#12G. RECEPTACLE CIRCUITS SHALL BE CONCEALED IN WALLS OR ABOVE CEILINGS.
- MAINTAIN A MINIMUM 30"W x 36"D CLEAR SPACE IN FRONT OF ALL ELECTRICAL DISCONNECTS AND PANELS PER THE CEC.
- MAINTAIN WORKING SPACE AND 6"-6" HEAD ROOM IN FRONT OF ALL ELECTRICAL EQUIPMENT IN ACCORDANCE WITH CEC.
- CONDUCTORS SHALL BE NON-METAL SHEATHED CABLE (ROMEX) UNLESS OTHERWISE SHOWN.
- RECEPTACLES SHALL BE SPECIFICATION GRADE WITH NUMBER OF POLES AS REQUIRED. RECEPTACLES SHALL BE PROVIDED WITH GROUND TERMINALS AND SCREW TERMINALS SUITABLE FOR NO. 10 CONDUCTORS. RECEPTACLES SHALL BE WHITE AND RATED FOR 15A, 120V WITH A NEMA 5-15R CONFIGURATION. DEVICE PLATE SHALL BE PLASTIC WITH COLOR TO MATCH RECEPTACLES.
- PANELBOARDS SHALL BE RATED AS SHOWN AND PROVIDED WITH TIN-PLATED ALUMINUM BUS, THERMAL MAGNETIC CIRCUIT BREAKERS AS SHOWN, AND NEMA 1 ENCLOSURE UNLESS OTHERWISE INDICATED.

KEY NOTES

- PROVIDE AND INSTALL RECEPTACLE 6" ABOVE COUNTER HEIGHT.
- SWITCHED GARBAGE DISPOSAL RECEPT.
- A-19 INCANDESCENT LIGHT FIXTURE TO BE DETERMINED.
- 2 TUBE, F32W T8 SURFACE MOUNT FLUORESCENT FIXTURE.
- WALL SCONCE LIGHT FIXTURE TO BE DETERMINED.
- ARC FAULT RECEPT.
- PROVIDE AND INSTALL IN ACCORDANCE WITH UTILITY REQUIREMENTS.
- PROVIDE RECEPTACLES TO MATCH EQUIPMENT CONFIGURATION.
- PROVIDE AND INSTALL SMOKE DETECTOR IN LOCATION SHOWN.
- PROVIDE AND INSTALL RECEPTACLE 48" ABOVE FINISHED FLOOR.

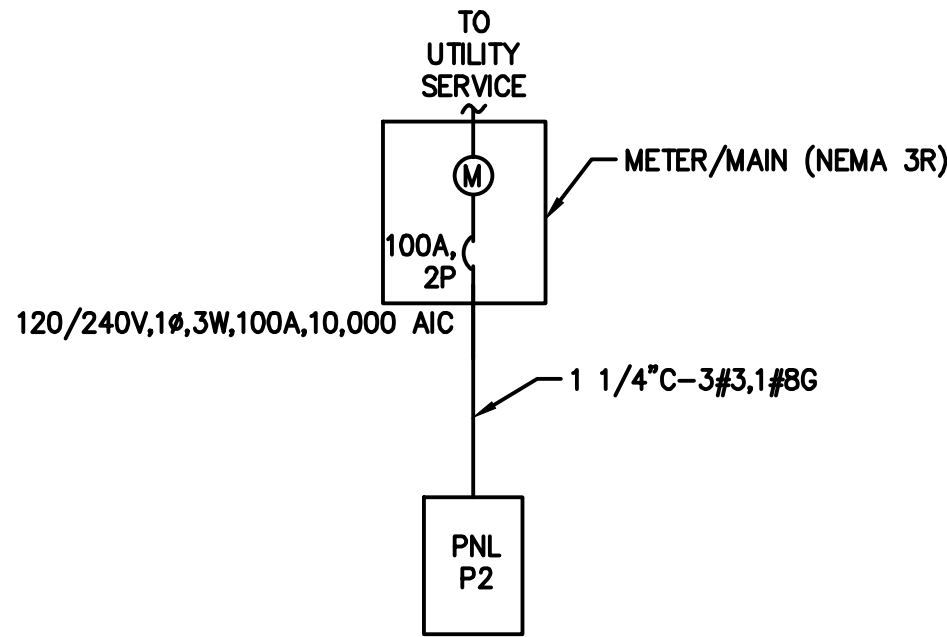

ONE-LINE DIAGRAM


		100A BUS		CIRCUIT AMPS			
		MLO					
BEDROOM 2 RECEPT	20	8	1	2	5	20	RESTROOM RECEPT
LAUNDRY RM RECEPT	20	3	3	4	10	20	WASHER
DRYER	30	20	5	6	8	20	GREAT RM RECEPT
REFRIG	20	7	9	10	2	20	GREAT RM RECEPT
GARBAGE DISPOSAL	50	10	11	12	2	20	COUNTER RECEPT
OVEN	30	13	14	2	2	20	COUNTER RECEPT
BEDROOM 1 RECEPT	20	30	15	16	2	20	COUNTER RECEPT
BEDROOM 1&2 LTG	20	7	17	18	3	20	EXTERIOR RECEPT
GREAT RM/CLOSET LTG	20	4	19	20	4	20	RESTROOM/LAUNDRY LTG
SPARE	20	3	21	22	2	20	EXTERIOR LTG
SPARE	20		23	24		20	SPARE
SPARE	20		25	26		20	SPARE
SPARE	20		27	28		20	SPARE
SPARE	20		29	30		20	SPARE
		75	67	NEUTRAL	22	26	RIGHT SIDE AMPS
				GROUND	75	67	LEFT SIDE AMPS
					97	93	TOTAL AMPS

PANEL P2


VOLTAGE: 120/240V  
LOCATION: LAUNDRY RM  
MOUNTING: SURFACE  
AMPS IC: 10,000

ELECTRICAL SYMBOLS

- CONDUIT EXPOSED
- CONDUIT CONCEALED or BURIED
- CROSSHATCHES ON CONDUIT RUN INDICATES NUMBER OF #12 CONDUCTORS
- SUBSCRIPT G INDICATES GREEN GROUND CONDUCTOR
- LA-2 HOME RUN-DESTINATION SHOWN
- SURFACE MOUNT PANELBOARD
- LUMINAIRE
- LUMINAIRE
- WALL MOUNTED LUMINAIRE
- SMALL LETTER SUBSCRIPT AT SWITCH AND LUMINAIRE INDICATES SWITCHING
- CONVENIENCE RECEPTACLE, DUPLEX UNLESS SPECIFIED OTHERWISE
- 4-PLEX CONVENIENCE RECEPTACLE
- TELEPHONE/DATA RECEPTACLE (OUTLET BOX ONLY)
- WALL SWITCH: 3-THREE WAY
- CIRCUIT BREAKER, THERMAL MAGNETIC TRIP SHOWN, 3-POLE UNLESS INDICATED OTHERWISE
- WP-WEATHERPROOF
- AFCI-ARCH FLASH
- CURRENT INTERRUPTER
- GFI-GROUND FAULT INTERRUPTER
- MOUNT 15" AFF FROM THE BOTTOM OF THE RECEPT UNLESS OTHERWISE NOTED.
- MOUNT SWITCHES 48" AFF TO TOP OF DEVICE UNLESS OTHERWISE INDICATED. TYPE INDICATED SEE LUMINAIRE AND DEVICE SCHEDULE.

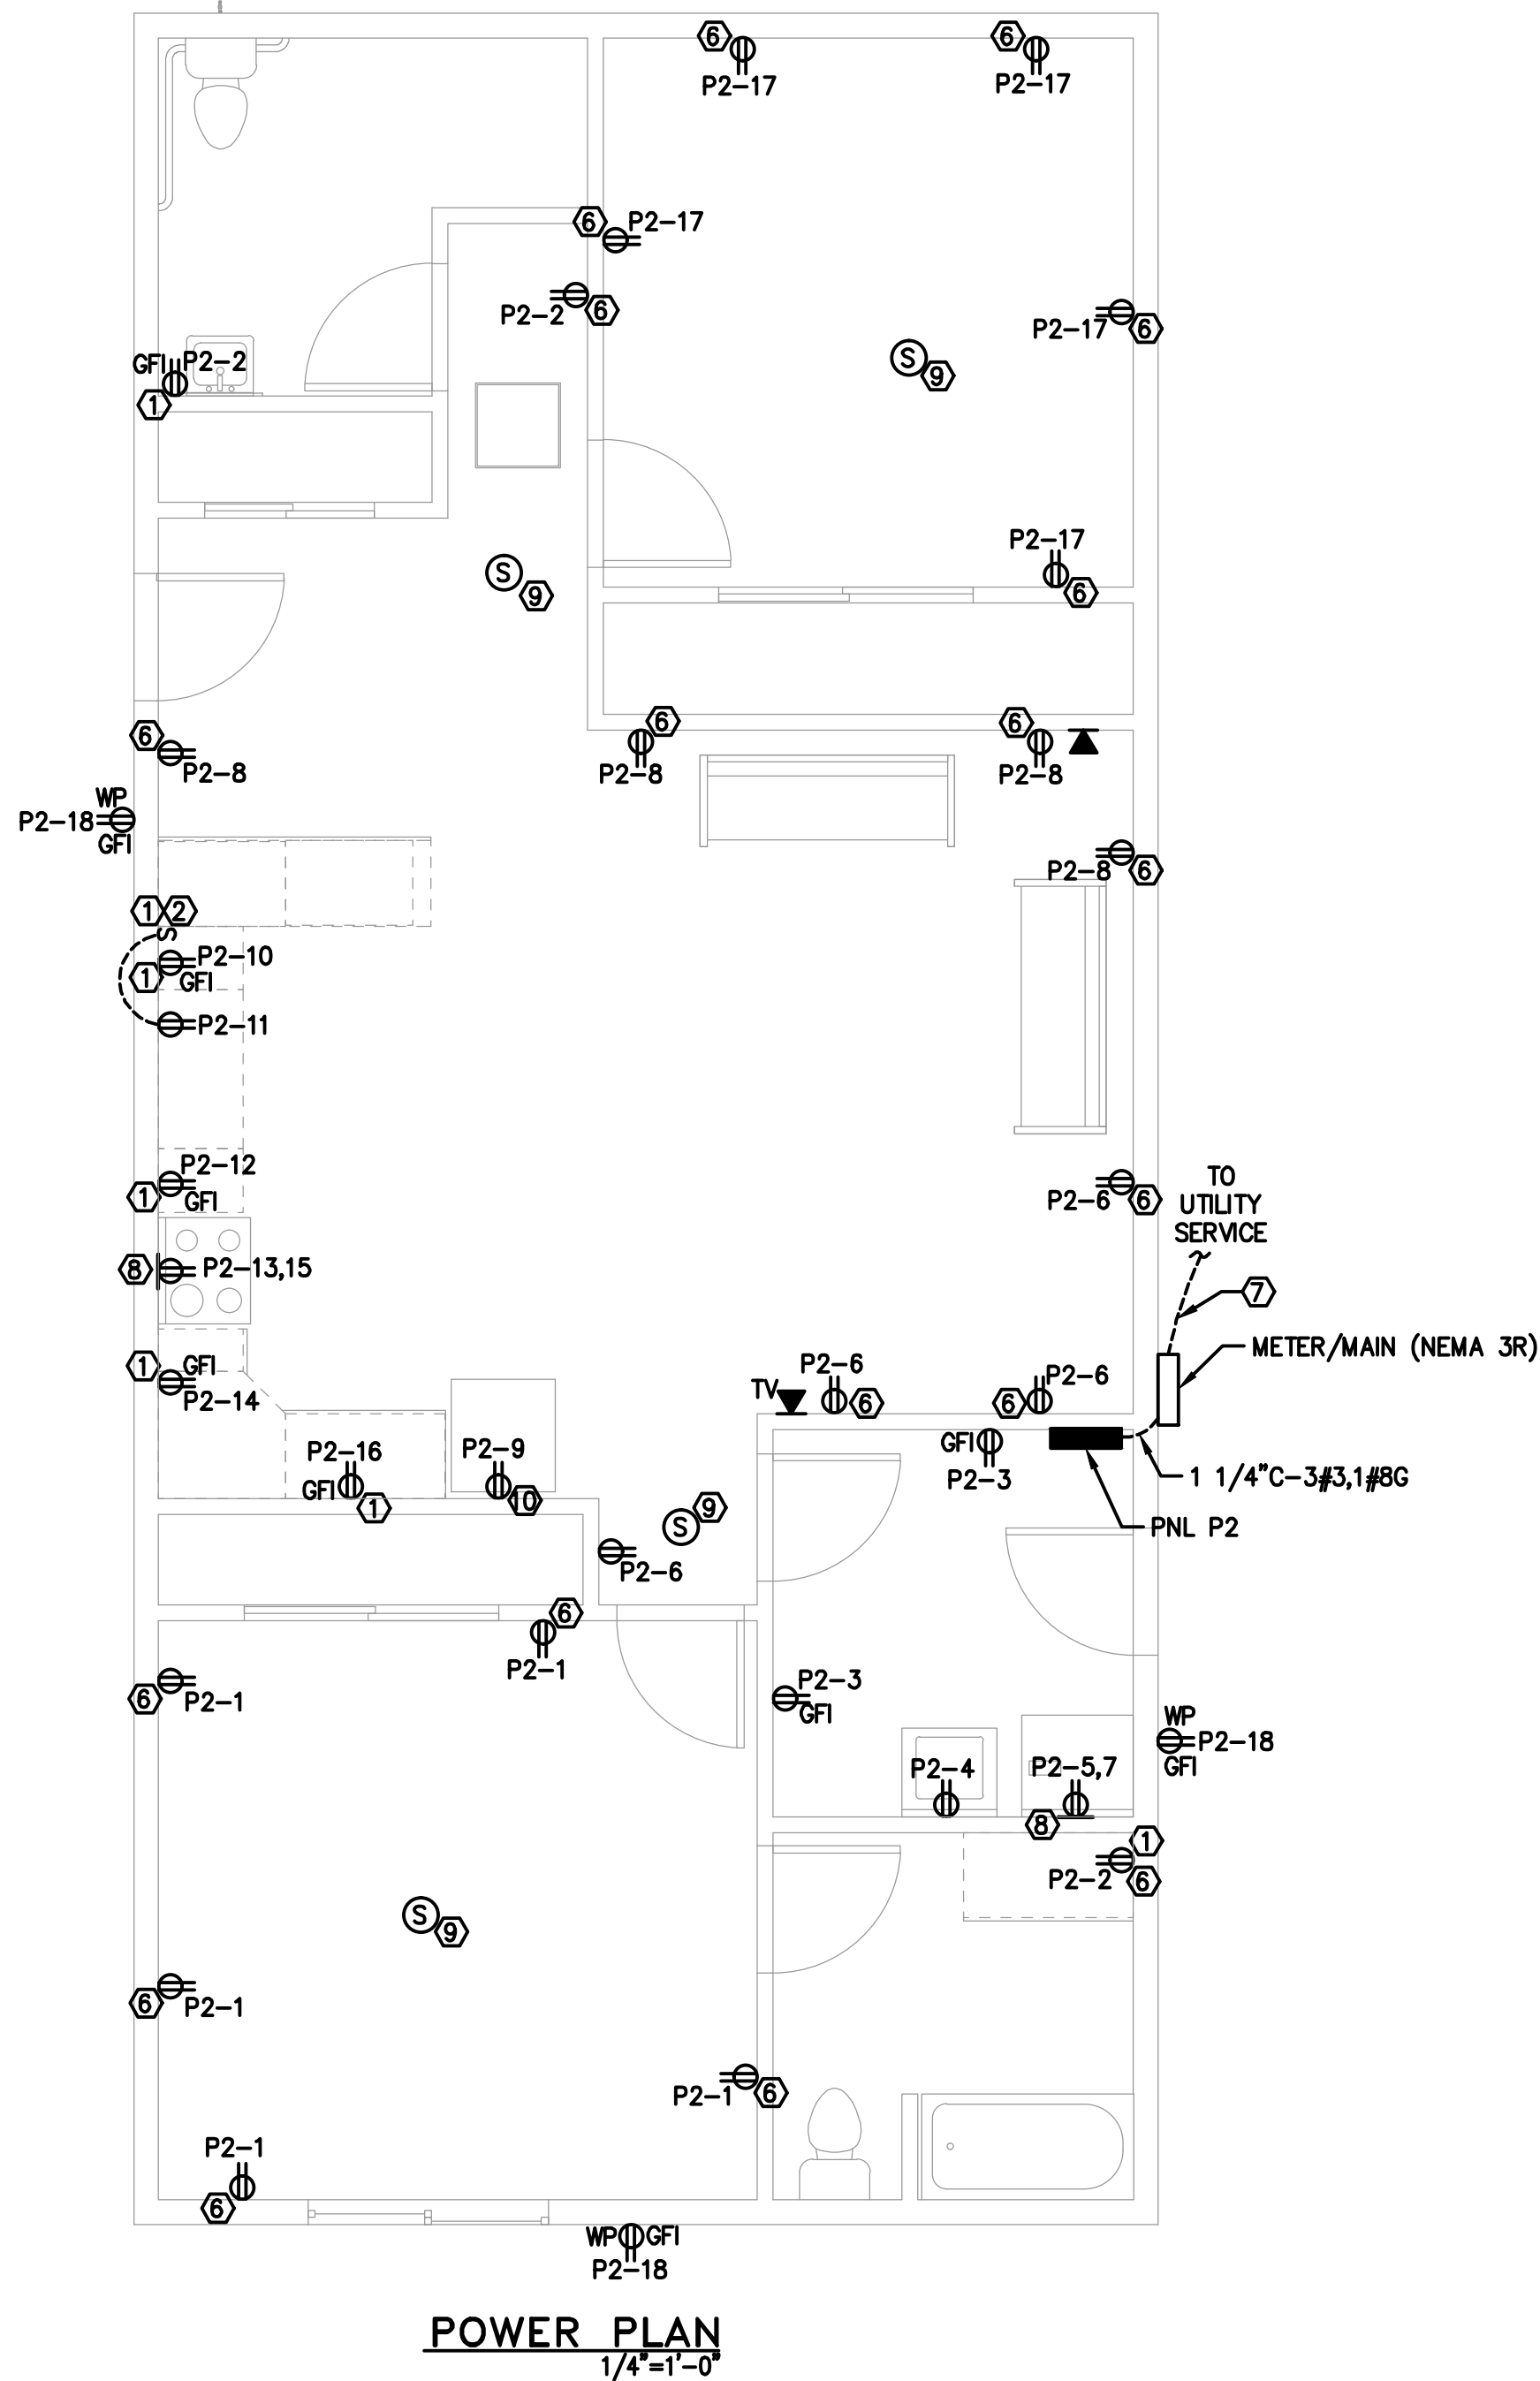


POWER PLAN  
1/4"=1'-0"

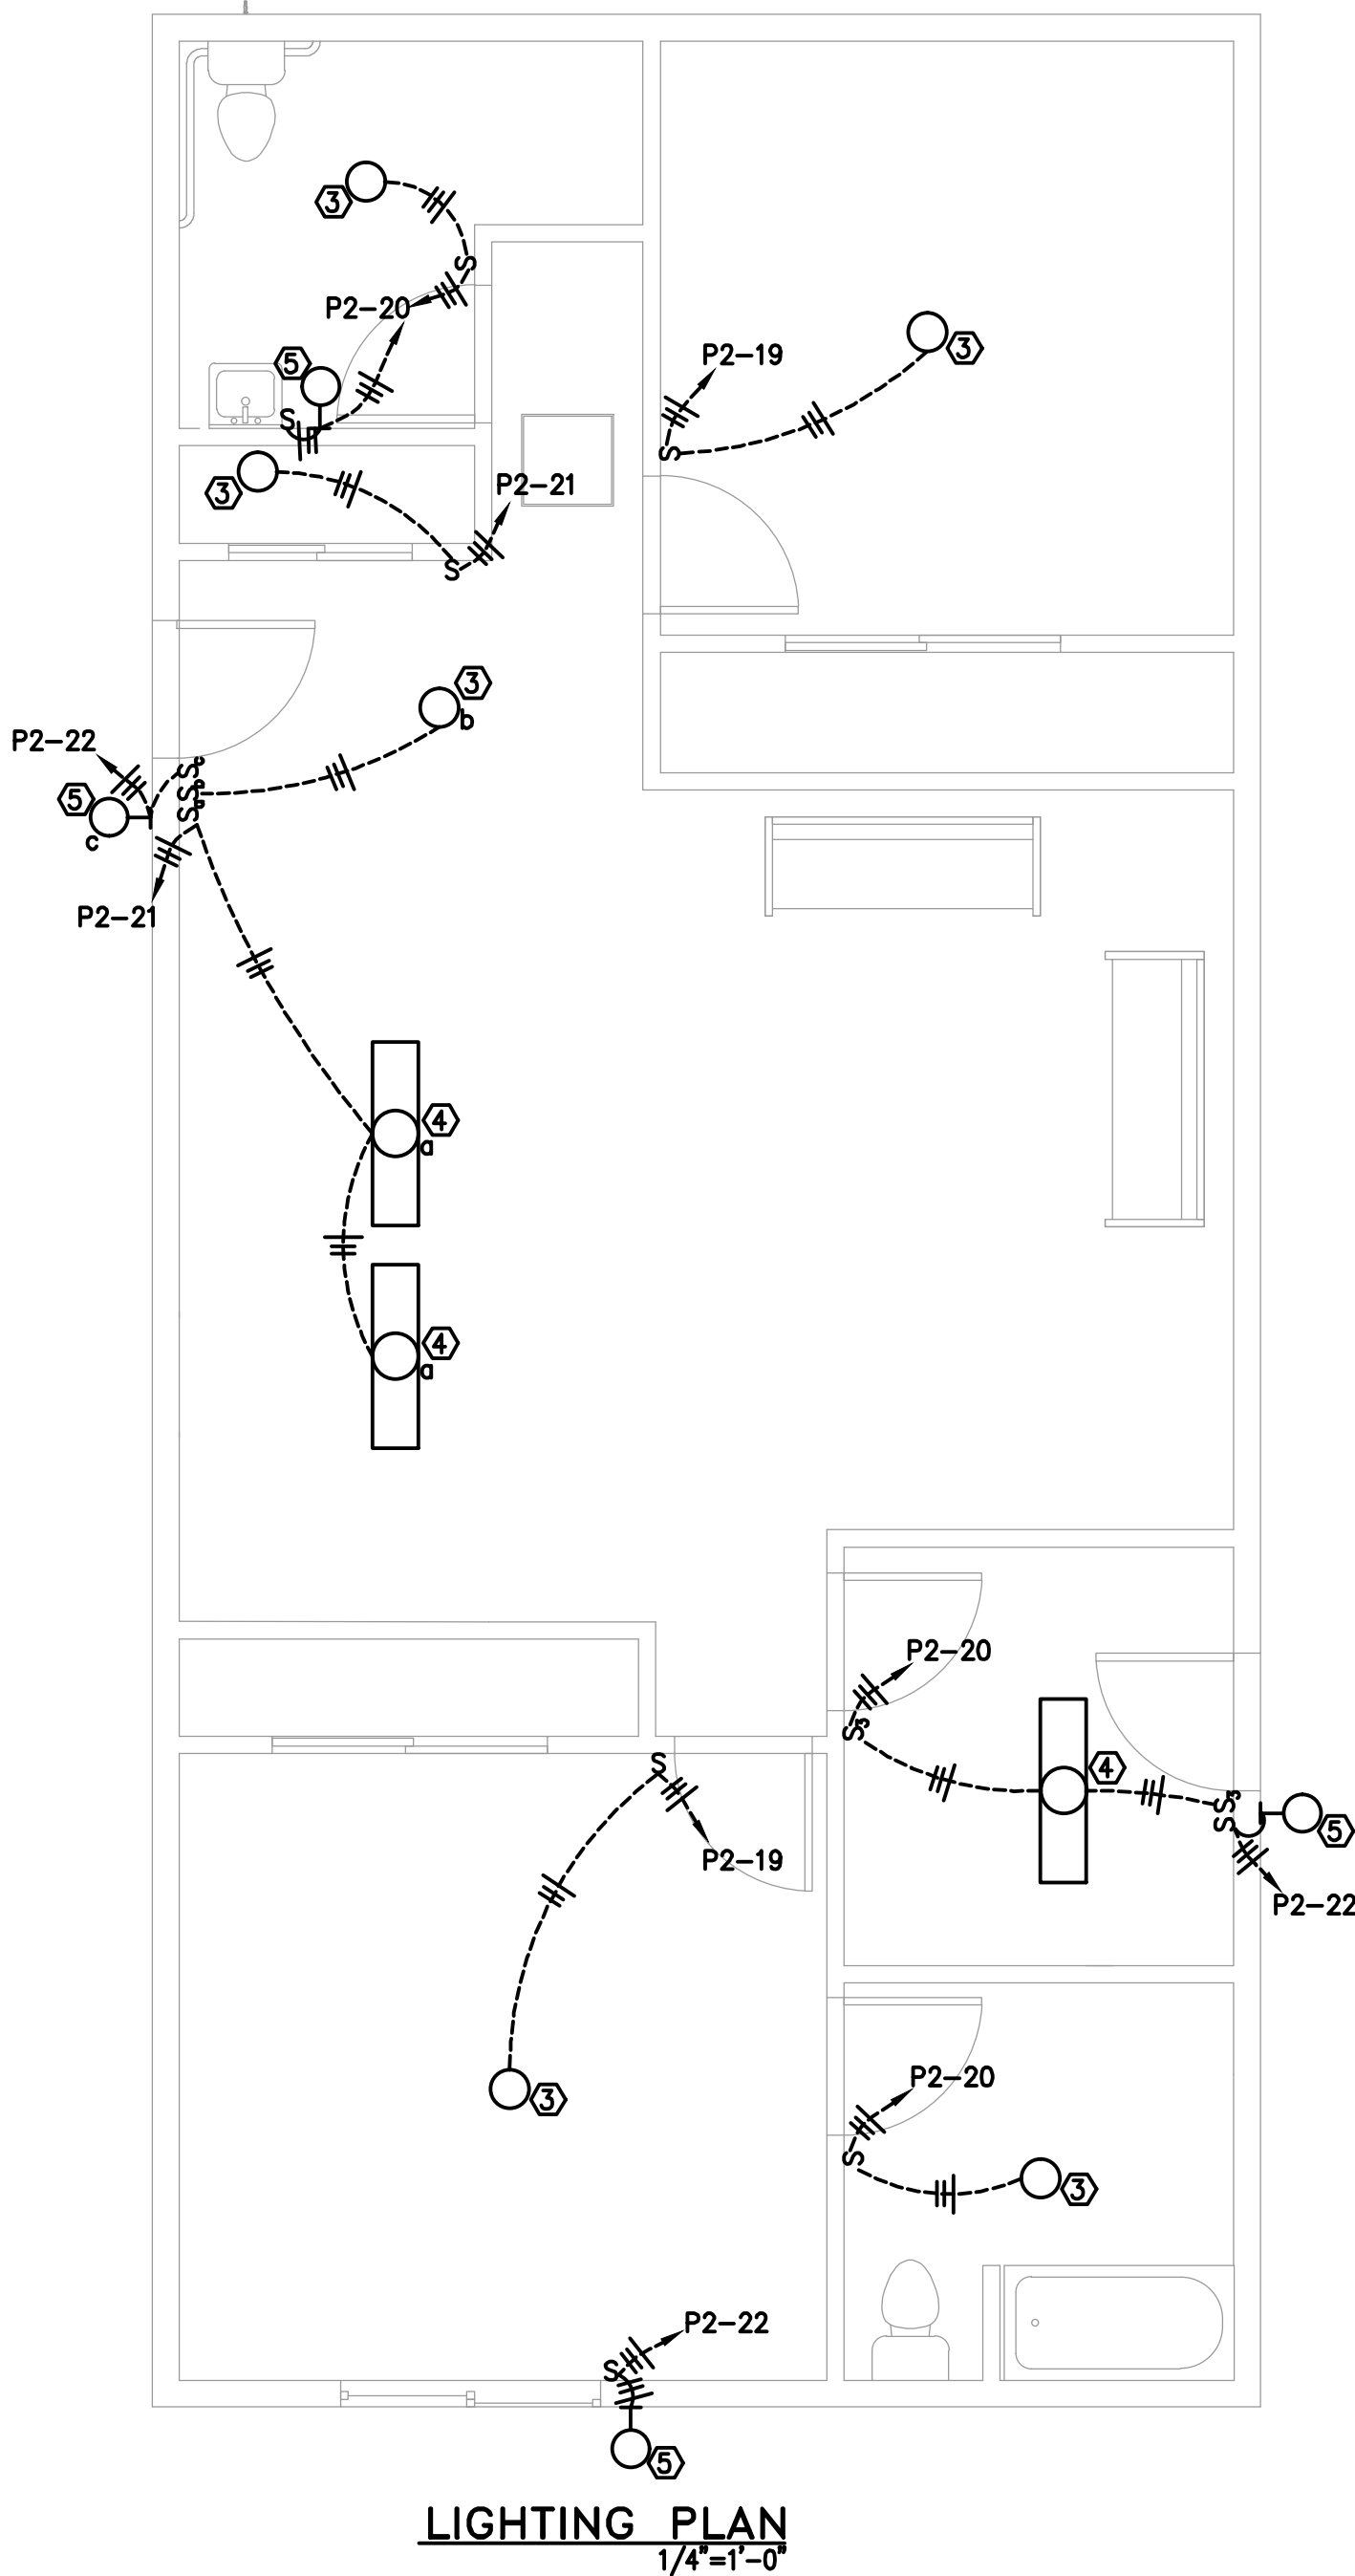

LIGHTING PLAN  
1/4"=1'-0"

**PACE**  
ENGINEERING  
REDDING, CALIFORNIA

DES CA	CKD CA	JOB NO.
DRN JS	DATE 08/05/15	2274.17

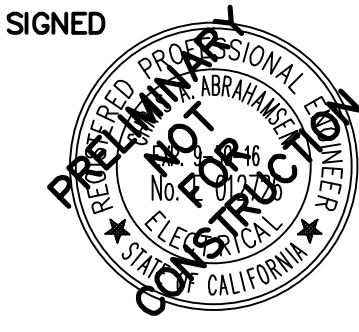

KARUK TRIBE HOUSING AUTHORITY  
635 JACOBSON WAY  
HAPPY CAMP, CA 96039  
TWO BEDROOM FLOOR PLAN

SHEET  
**E2.2**